


Switchboard Rescue

Power Networks Work Instruction

Hazards	Personal Protective Equipment	Tools & Equipment
Electric Shock Fire Explosion	Hard Hat Safety Glasses Full Body Flame Resistant Clothing Safety Boots	Switchboard Rescue Kit (LV Gloves, Insulated Crook – Tested to 5kv, Non Conductive Torch, Emergency Isolation Tag, Fire Blanket, Burns Dressing)

Rescue from Switchboard can be performed where an employee is in contact with or in close proximity to live LV mains or apparatus and the rescue can be performed without breaching HV approach clearances.

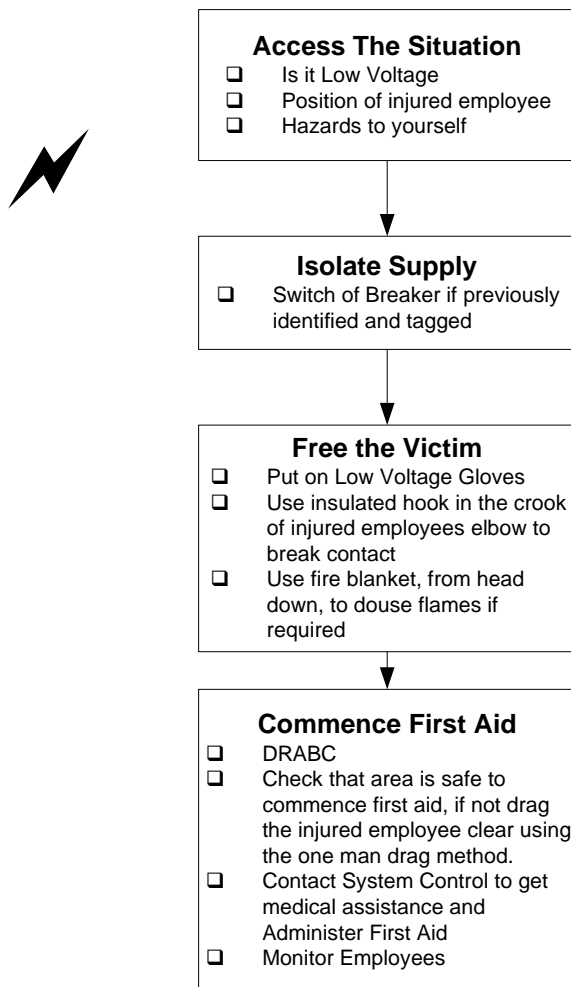

“Isolate here in Emergency”

Tags shall be applied to isolation equipment if it is practical to operate the equipment in an emergency prior to commencing live low voltage work.



Danger



Caution



Tag



Environmental



Permit



Document

Approved by:	Prepared by:	Issue Date:	Status:
Bertram Birk General Manager Power Networks	David Totham Network Facilitator	13 April 2006	Approved
		File No:	Version:
		F2006/2282	1