



NOTES

1. ALL RM6 ENCLOSURES SHALL BE SUITABLE FOR 4 WAY RMU'S.
2. ALL RMU ENCLOSURES SHALL BE BOLTED TO THE RMU FOUNDATION. REFER TO S02-2-6-23 FOR 4 WAY RMU FOUNDATION.
3. ALL RMU ENCLOSURES SHALL HAVE ONE LOCKING GAS STRUT, STOCK CODE 413339.
4. REFER TO S02-1-4-24 FOR RM6 DETAILS.

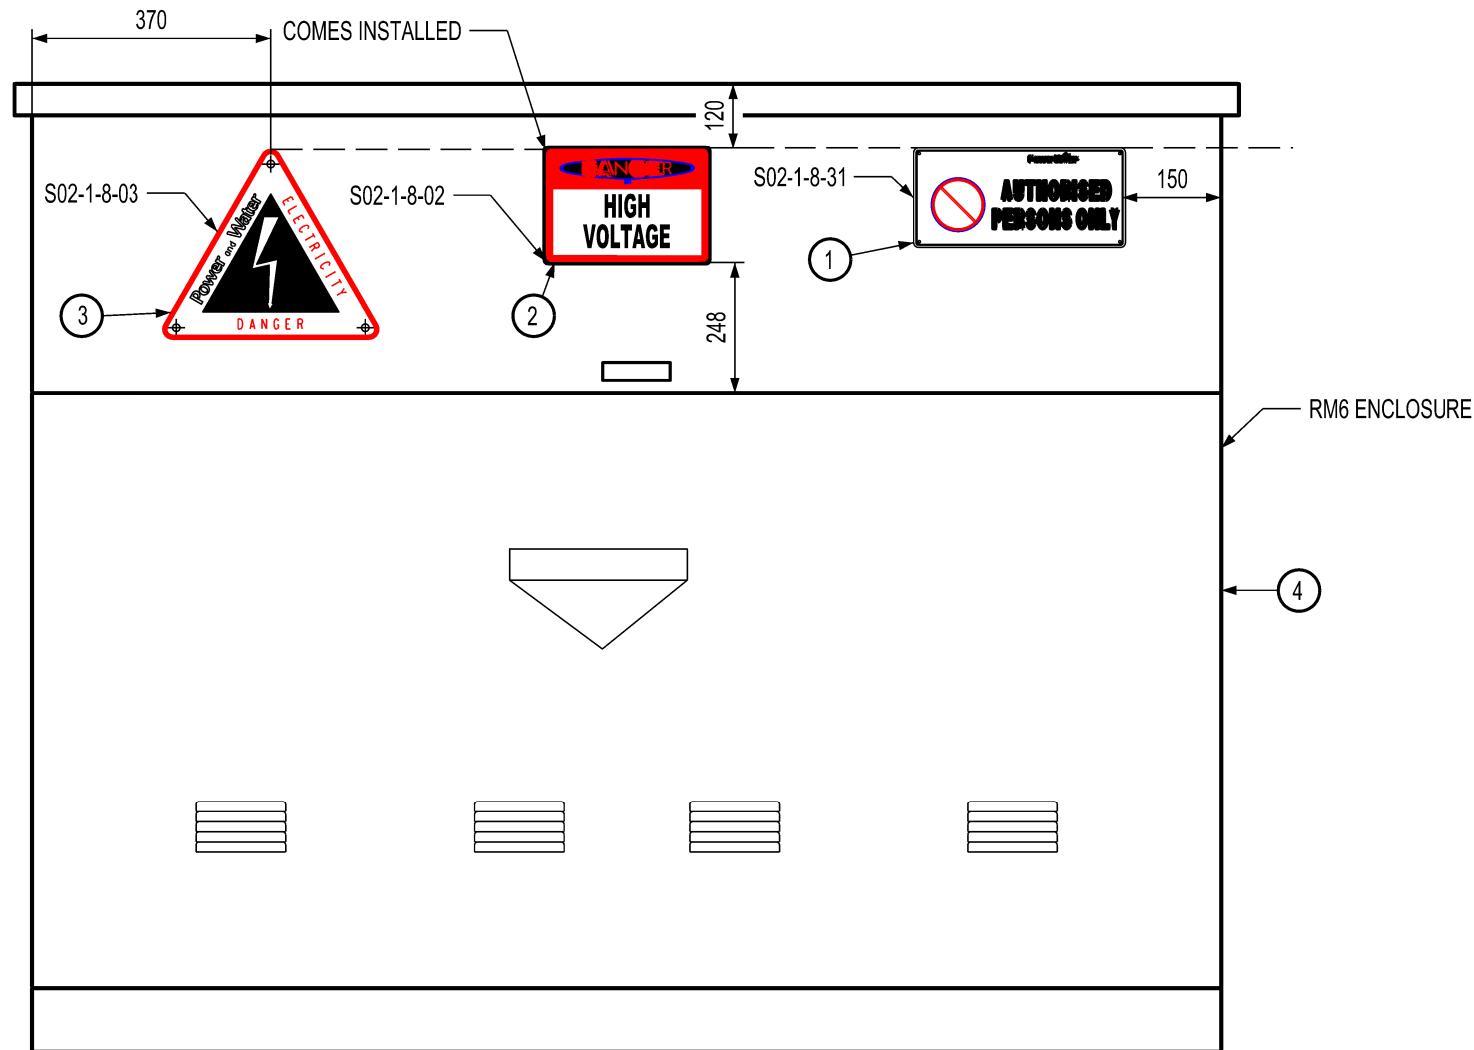

RM6 SAFETY SIGN LAYOUT
FRONT VIEW

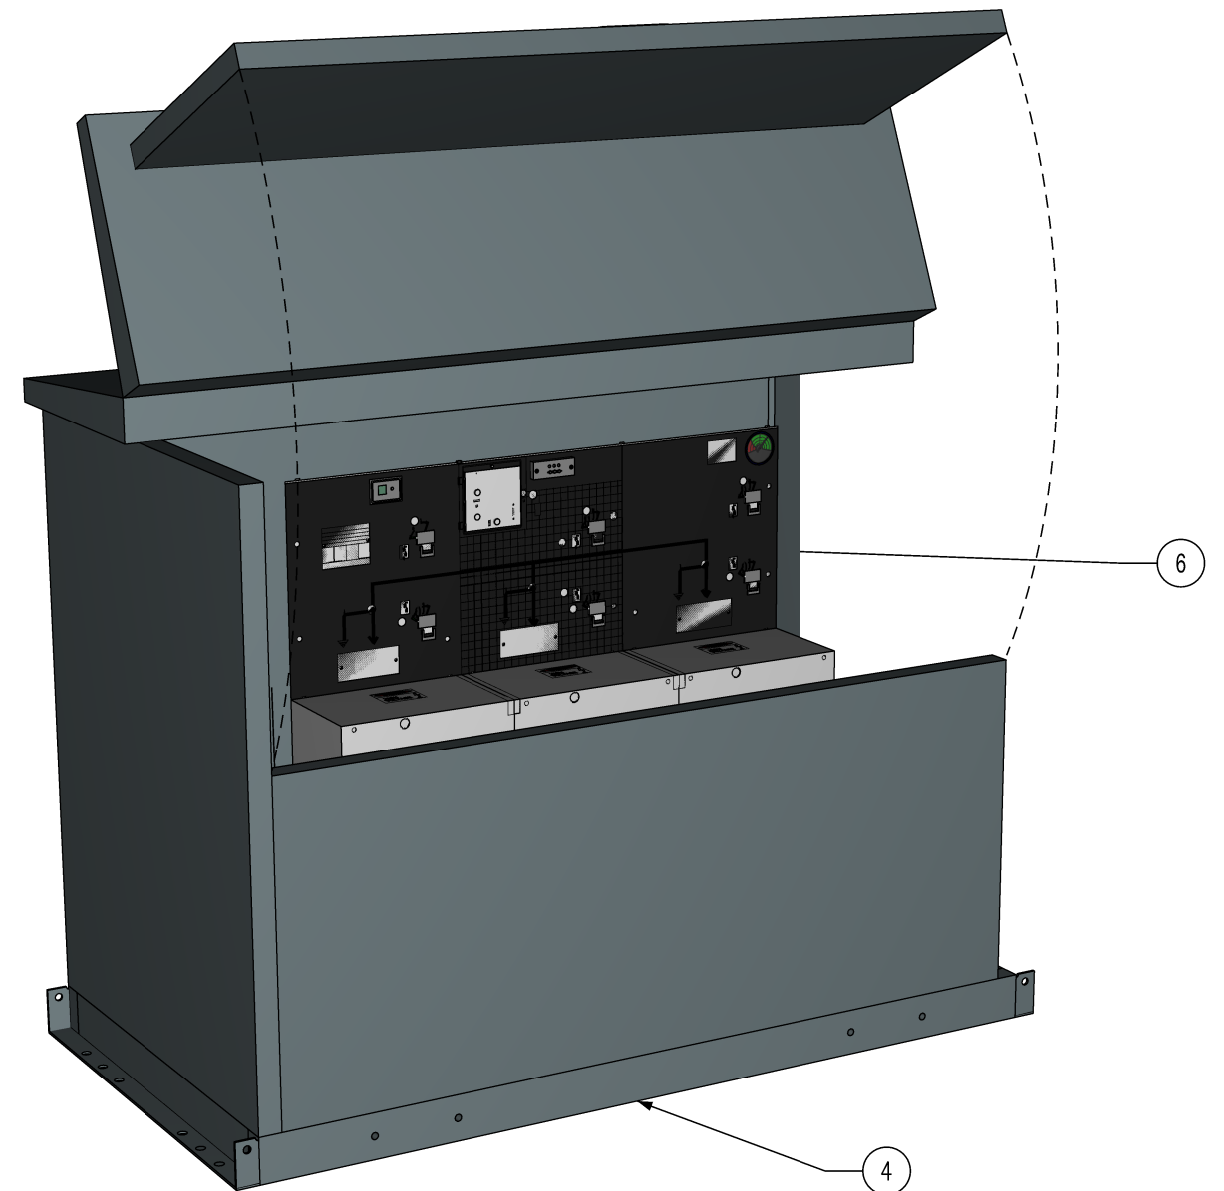

ITEM	QTY	DESCRIPTION	STOCK CODE	DWG No.
10	1	IID1 RM6 IN ENCLOSURE	503659	-
9	1	IIII RM6 IN ENCLOSURE	502394	-
8	1	IDI RM6 IN ENCLOSURE	503657	-
7	1	III RM6 IN ENCLOSURE	502392	-
6	1	RM6 RING MAIN UNIT	-	S02-1-4-24
5	1 MIN	GAS STRUT WITH LOCKING MECHANISM	413339	-
4	1	4-WAY RM6 RING MAIN UNIT ENCLOSURE WITHOUT RMU	288142	-
3	1	SIGN, DANGER ELECTRICITY, 250MM HIGH	6486	S02-1-8-03
2	1	SIGN, DANGER HIGH VOLTAGE, COMES INSTALLED	406832	S02-1-8-02
1	1	SIGN, PROHIBITION	-	S02-1-8-31

MATERIAL SCHEDULE

NO	DESCRIPTION	DRN	DATE	CKD	APPD
2	ITEMS 8 AND 10 UPDATED TO VIP45 RELAY	A.T.	MAY'16	I.B.	B.C.
1	ITEMS 7-10 ADDED	A.T.	JUN'14	B.C.	B.C.
0	ISSUED FOR CONSTRUCTION	J.C.	AUG '11	A.T.	B.C.
AMENDMENTS					



DES	A.T.	POWER STANDARD DRAWING		
DRN	J.C.	SWITCHGEAR RM6 4-WAY ENCLOSURE		
CKD	B.C.			
APPD	S.C.			
SCALE	N.T.S.			
ISSUED	AUG 2011	A3	DRAWING NUMBER	S02-1-4-19
ALL DIM.	IN mm			
DRAFTING STANDARD TO A.S.1100			CAD PRODUCT - DO NOT AMEND MANUALLY	



AMDT