



TOP VIEW

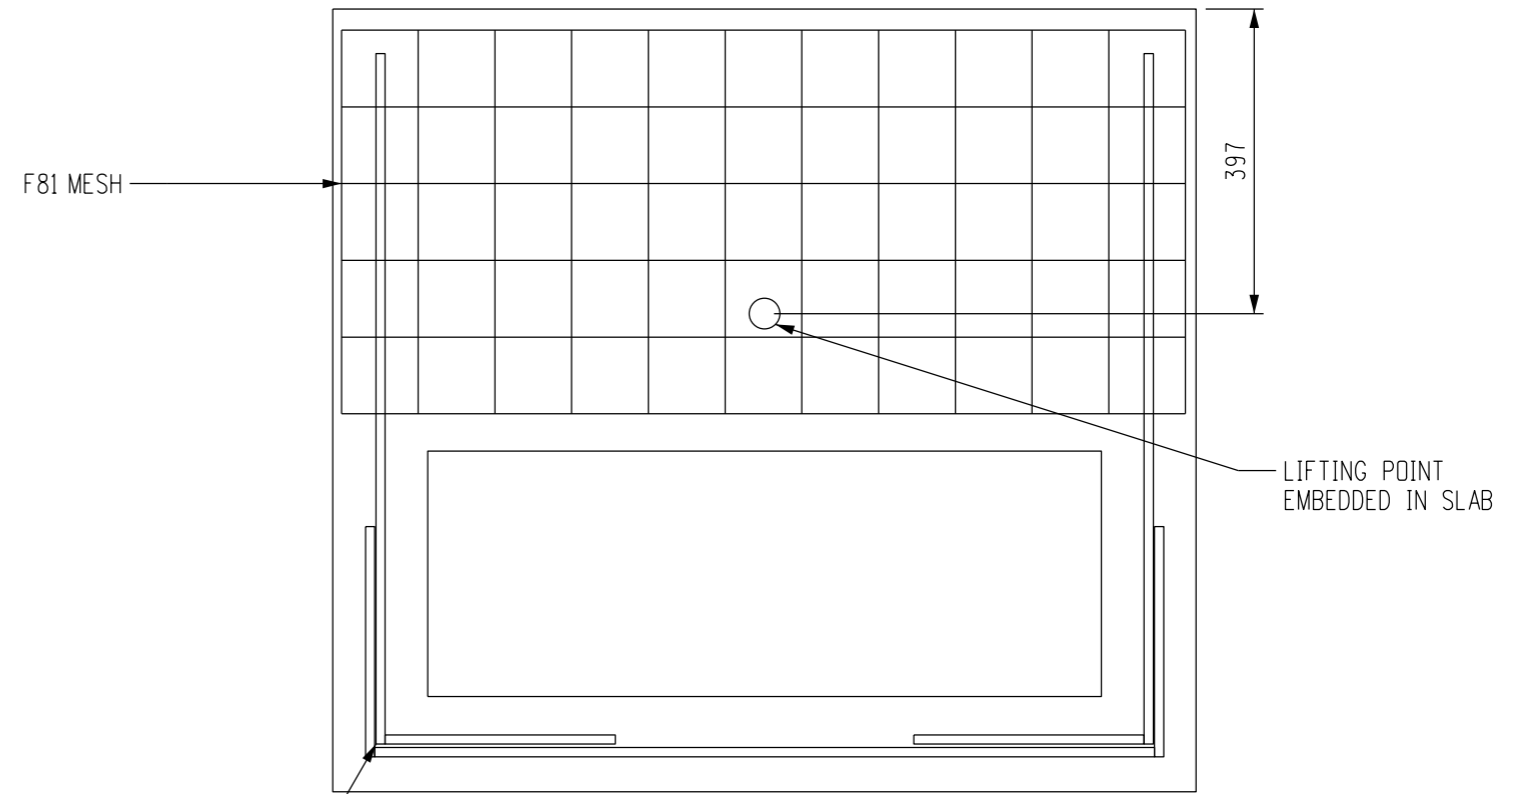

TOP VIEW SHOWING REINFORCEMENT

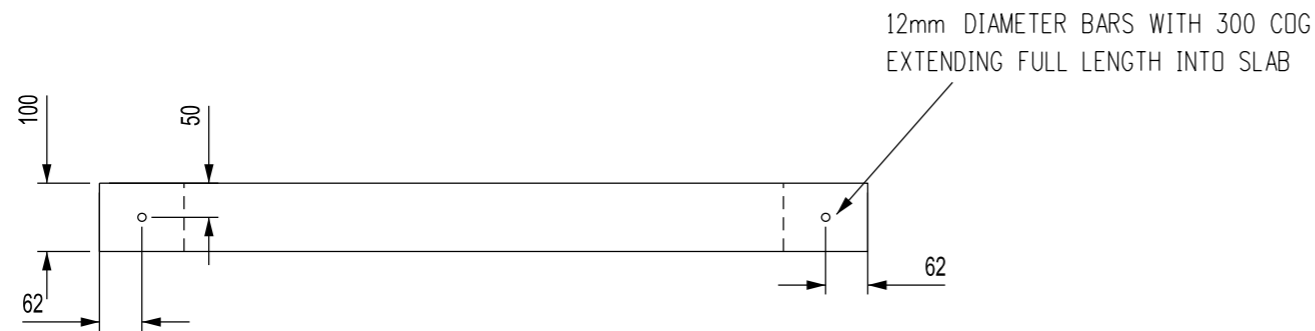

FRONT VIEW

NOTES:

1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS.
2. ATTACH NEW TOP SLAB TO EXISTING VAULT AND FILL IN ANY VOIDS BETWEEN THEM WITH EPOXY.

NO	DESCRIPTION	DRN	DATE	CKD	APPD
A	ISSUED FOR COMMENT AND TRIAL	A.T.	MAY '14	B.C.	B.C.
AMENDMENTS					



DES	A.TAYLOR	POWER STANDARD DRAWING		
DRN	A.TAYLOR	CIVIL 75KVA SINGLE PHASE SUBSTATION "SPUD" FOUNDATION DETAILS		
CKD	B.CHEUNG			
APPD	B.CHEUNG			
SCALE	AS SHOWN			
ISSUED	MAY '14	A3	DRAWING NUMBER	S02-2-6-35
ALL DIM. IN mm				
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT