



3RD ANGLE — DO NOT SCALE — REPORT ANY ERRORS. OMISSIONS TO DRAFTING OFFICE

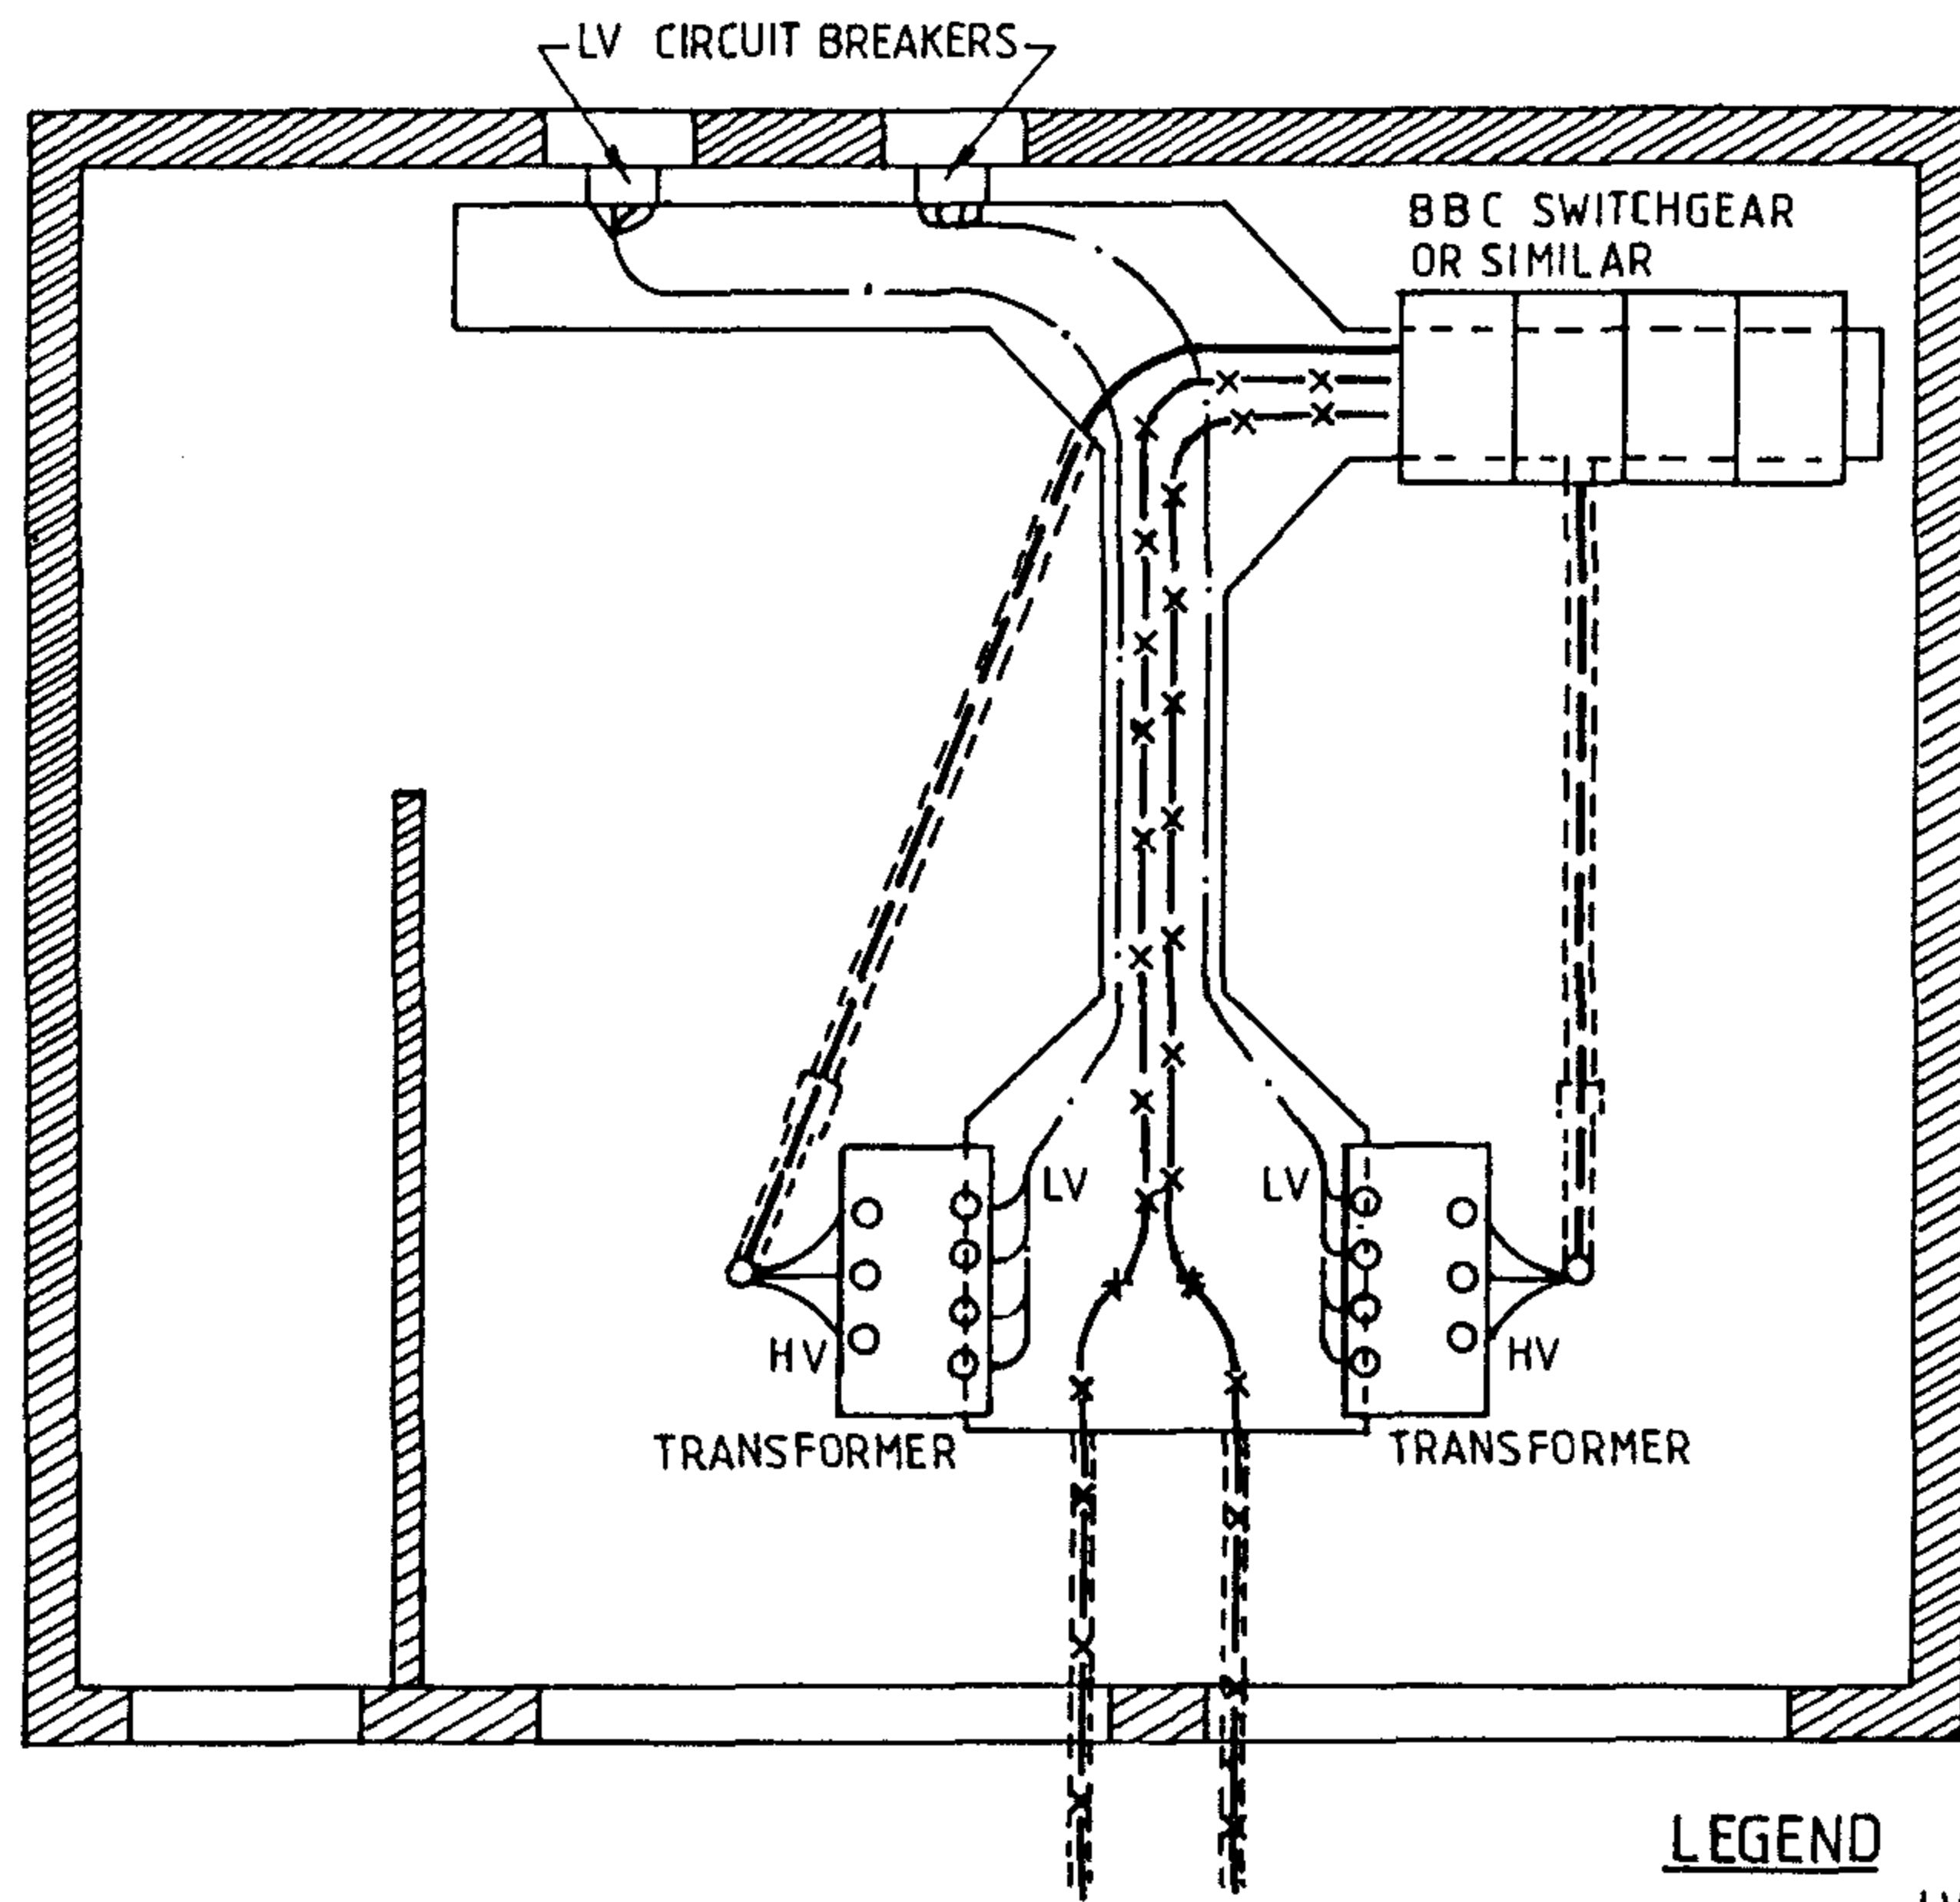



DOUBLE TRANSFORMER

**LEGEND**

- · — LV CABLES
- — — HV CABLES SWITCHGEAR TO TRANSFORMER
- x — HV FEEDER CABLES

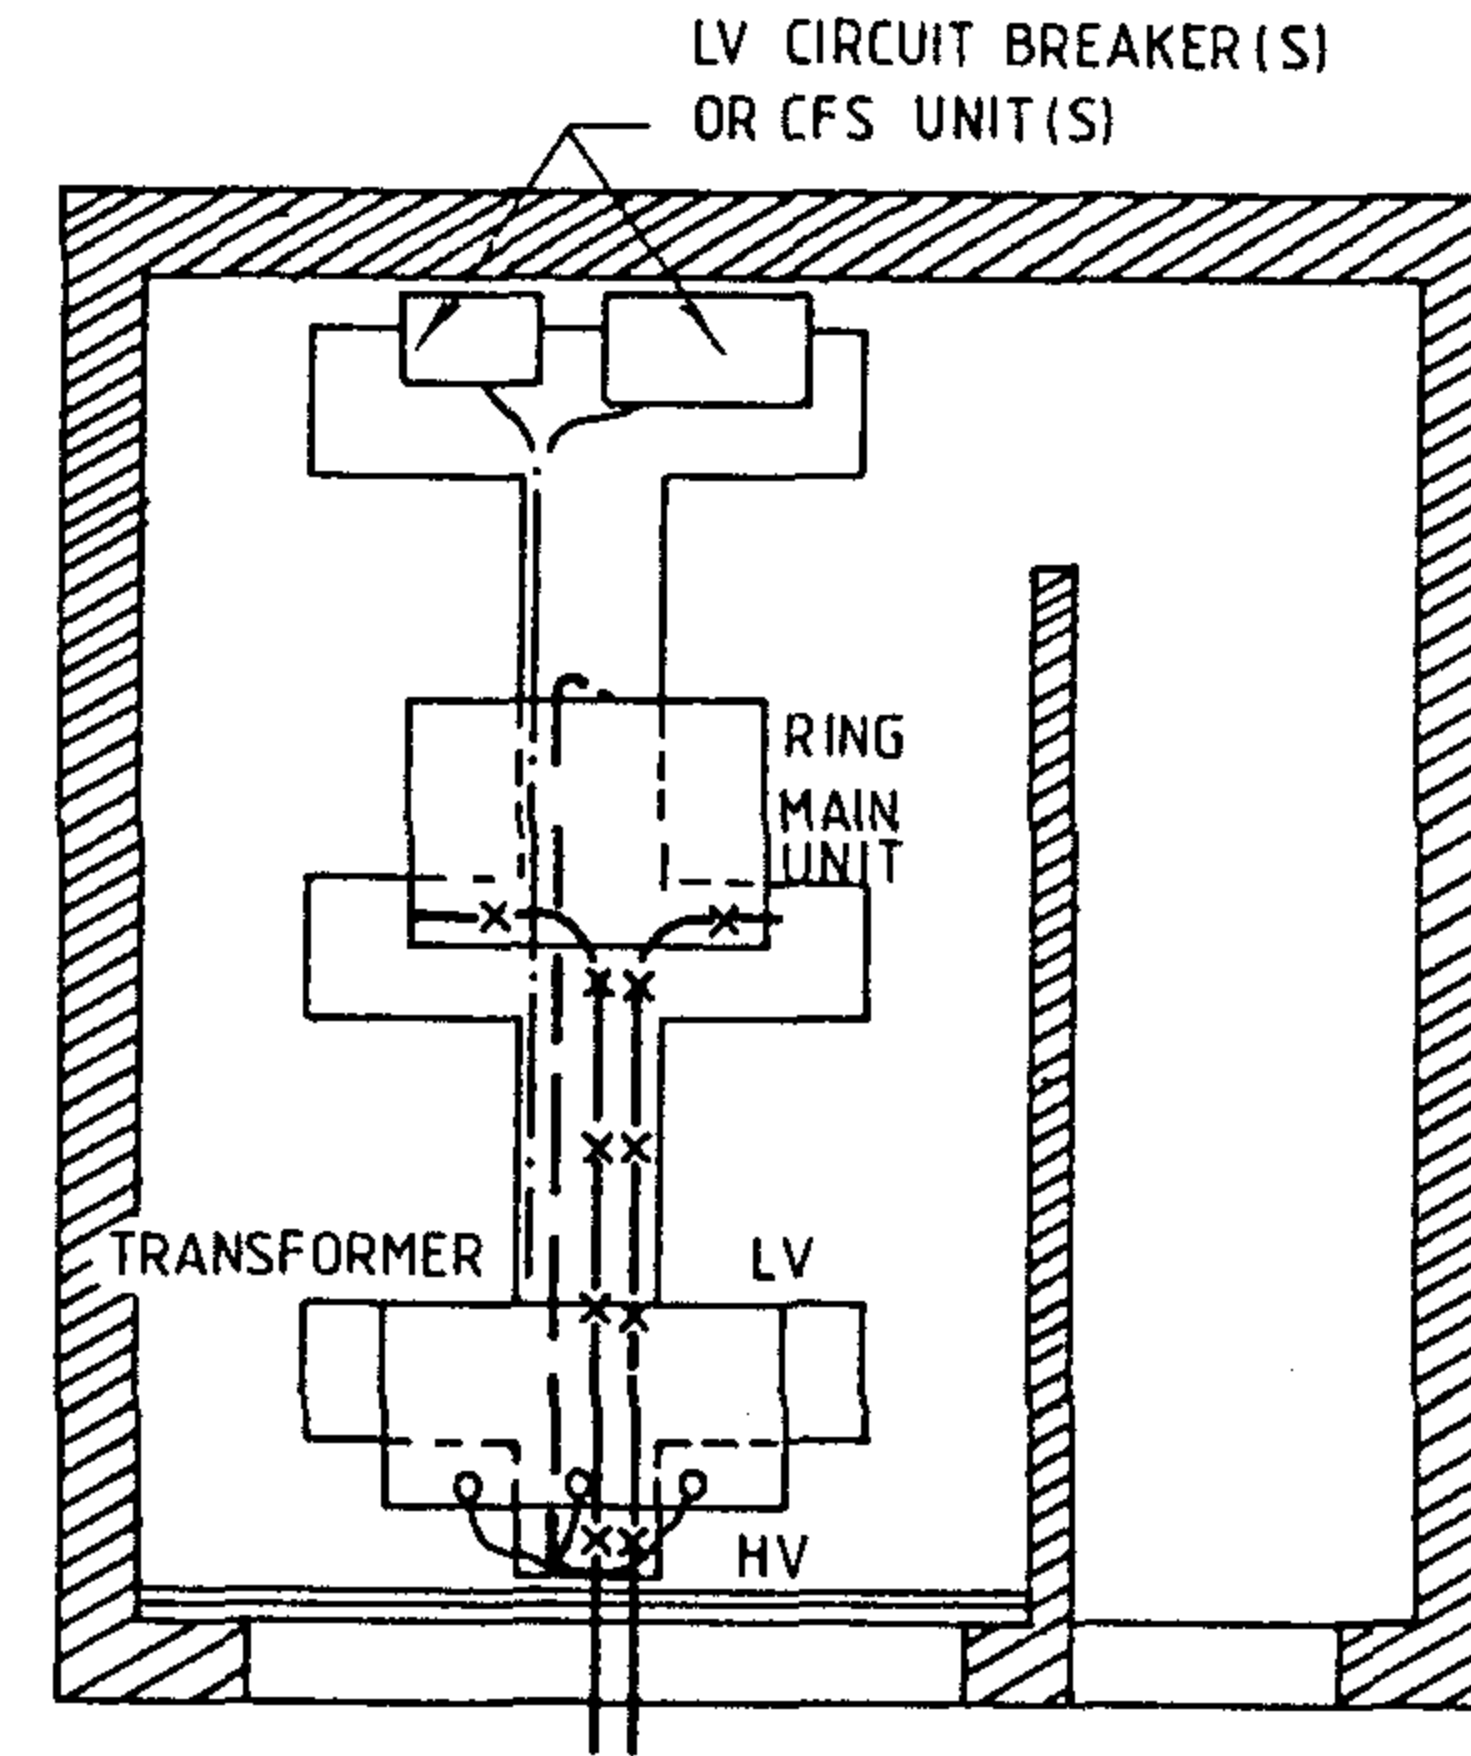

SINGLE TRANSFORMER

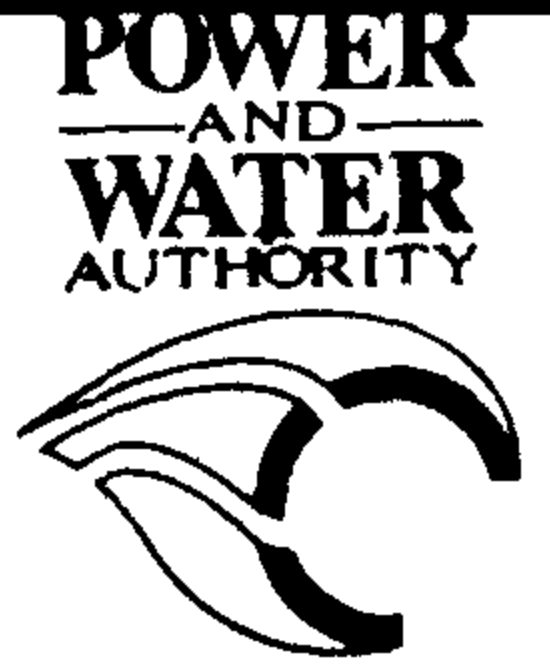				 <b>POWER AND WATER AUTHORITY</b> POWER DIRECTORATE	DES N. STUBBS	NT STANDARD DRAWING	
					DRN 200 10/85	TITLE	INDOOR SUBSTATION DOUBLE AND SINGLE TRANSFORMER SWITCHGEAR AND CABLE DUCT
				CKD <i>Gurmeet Singh</i>	APPD <i>wh</i>	ISSUED 5.2.86	DRAWING NUMBER
				DRAFTING STANDARD TO AS 1100	A3	S2-2-7-7	
				ALL DIM IN mm	SCALE NTS	SHEET	 AMP 1
1	TITLE AND DRG N° CHANGED	JUNE 88					
No	AMENDMENT	DATE	INIT				