


22KV VERTICAL LINE  
POST INSULATOR  
ITEM NUMBER 8375  
REFER DRG S01-01-03-07

CROSSARM TO RISER CONNECTION  
M24 GALVANISED THREADED ROD  
400 LONG, 2 x LARGE FLAT WASHERS,  
SPRING WASHERS AND NUTS

CROSSARM BRACE TO RISER CONNECTION  
M24 x 180 BOLT; 2 x LARGE FLAT WASHERS,  
SPRING WASHER AND NUTS

RISER TO WELDED POLE CONNECTIONS  
M24 GALVANISED THREADED ROD 500 LONG,  
2 x LARGE FLAT WASHERS, SPRING WASHERS  
AND NUTS

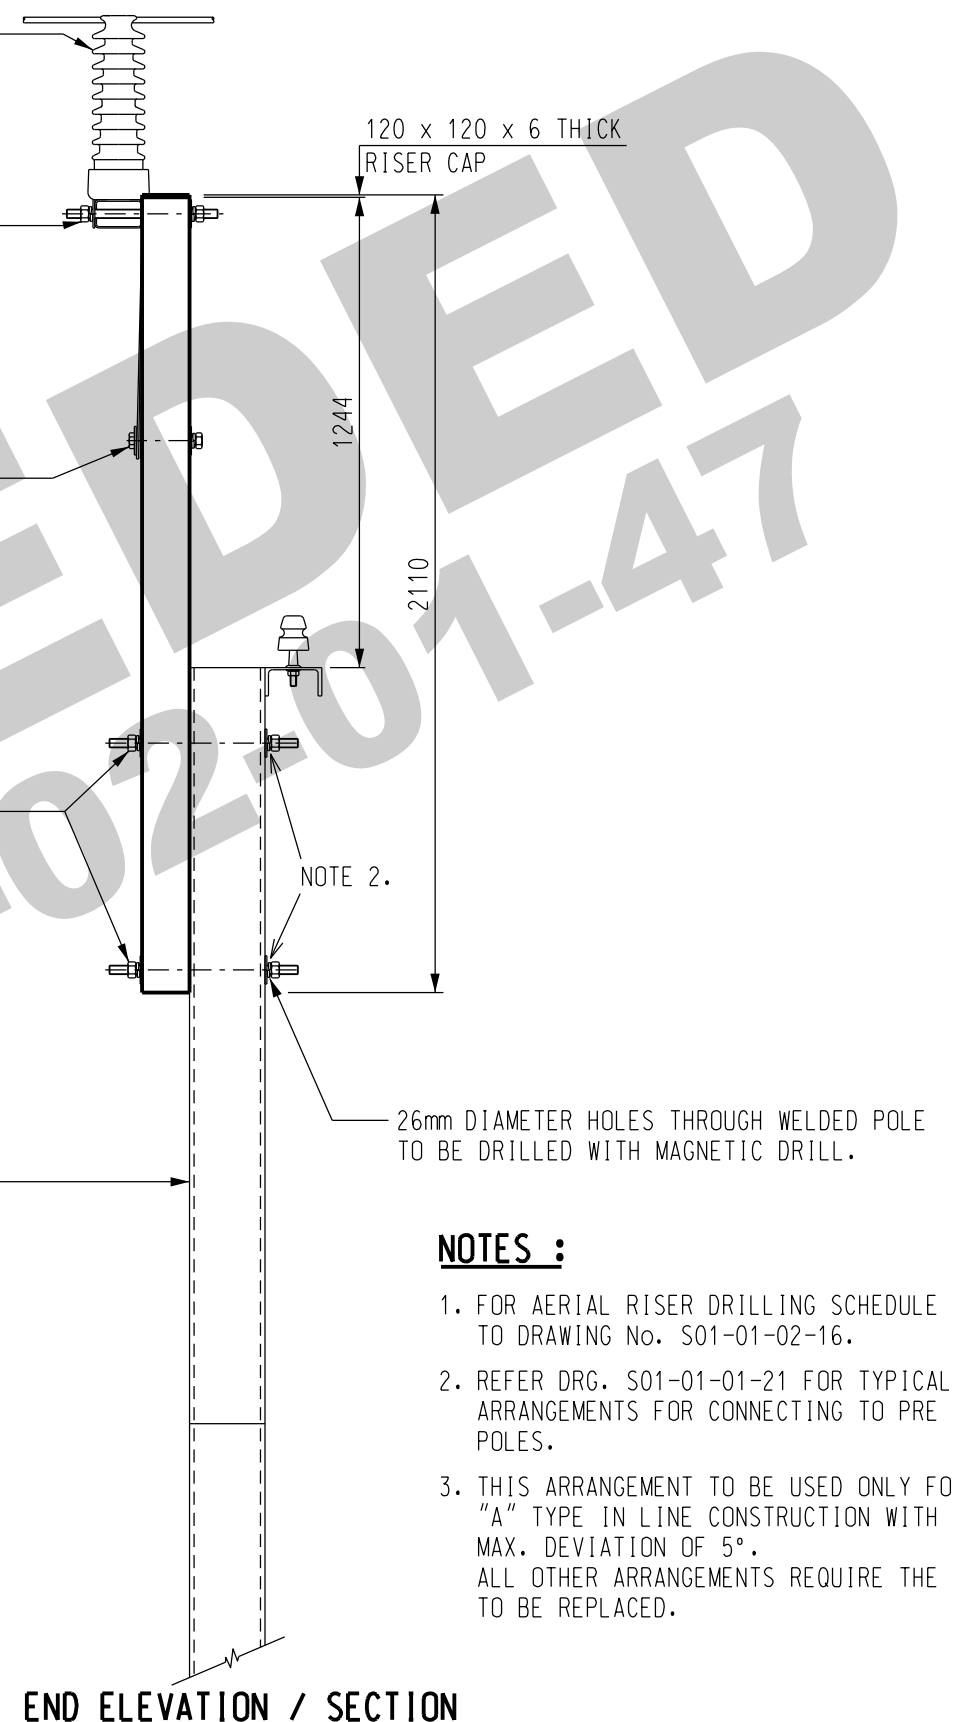

THIS ARRANGEMENT TO BE USED ONLY FOR  
"A" TOP IN LINE CONSTRUCTION WITH A  
DEVIATION OF 5°.  
ALL OTHER ARRANGEMENTS REQUIRE THE  
POLE TO BE REPLACED.

**NOTES :**

1. FOR AERIAL RISER DRILLING SCHEDULE REFER TO DRAWING No. S01-01-02-16.
2. REFER DRG. S01-01-01-21 FOR TYPICAL BOLTED ARRANGEMENTS FOR CONNECTING TO PRE BOLTED POLES.
3. THIS ARRANGEMENT TO BE USED ONLY FOR "A" TYPE IN LINE CONSTRUCTION WITH A MAX. DEVIATION OF 5°. ALL OTHER ARRANGEMENTS REQUIRE THE POLE TO BE REPLACED.

END ELEVATION / SECTION

2	SUPERSEDED TO S01-02-01-47	A.N.	FEB'22	A.N.	B.V.
1	TITLEBLOCK & DRAWING NUMBER FORMATTED	K.T.	DEC'18	C.C.	C.C.
0	ISSUED FOR CONSTRUCTION	A.S.	DEC'02	J.G.	M.B.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					



DES	M. BOCK	POWER STANDARD DRAWING			
DRN	A. SCHMID	<b>CROSSARMS LINE - RISER (MAX. 5° DEVIATION) BOLTED CROSSARM ATTACHMENT TO WELDED POLES</b>			
CKD	J. GOLDSMITH				
APPD	M. BOCK	<b>A3</b>	<b>DRAWING NUMBER</b>	<b>S01-01-02-18</b>	
SCALE	1 : 20				
ISSUED	OCT '02	DRAFTING STANDARD TO A.S.1100			
ALL DIM.	IN mm				
CAD PRODUCT - DO NOT AMEND MANUALLY			AMDT		2