


**POWER**  
—AND—  
**WATER**  
AUTHORITY

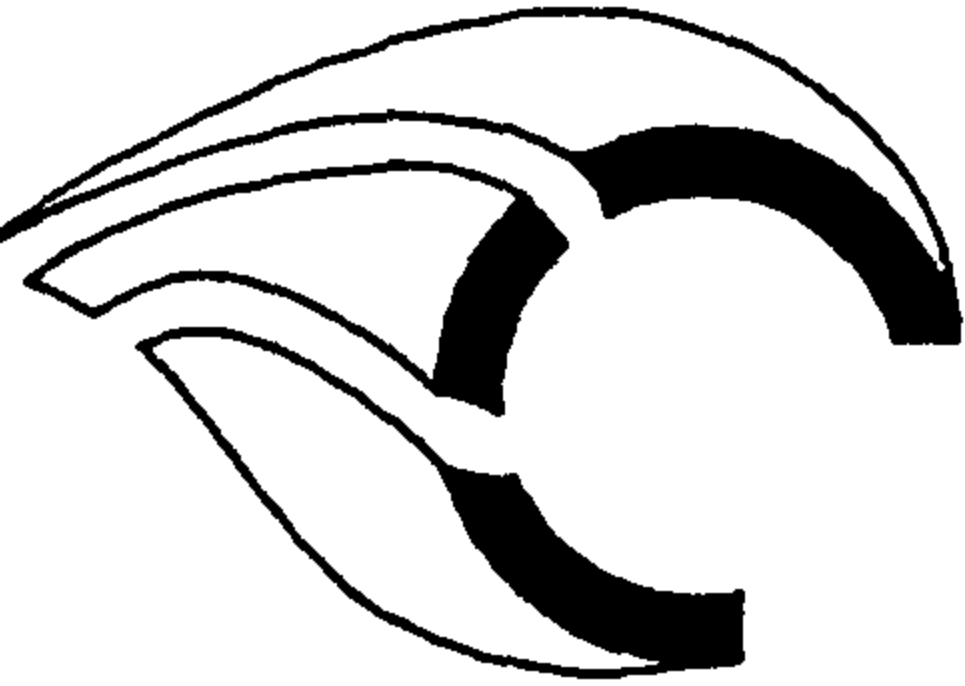

STANDARDS BRANCH  
-POWER DIVISION-

PAGE : 1 OF 3  
DATE : 24/6/88  
REVISION : 0  
DISTRIBUTION : VOLUME 2 HOLDERS  
PREPARED BY : ALAN MITCHELL  
AUTHORIZED BY : BRIAN KENT

---

STANDARDS BULLETIN No. : S2-003

---

SUBJECT : REMOVAL OF SEMICONDUCTIVE SCREEN

---

Attached is a Sigmaform instruction REF CODE: 060/88 on methods of removal of the semiconductive screen on solid dielectric cables (XLPE).

Adherence to either of the methods will prevent possible delamination of the semiconductive screen and possible failure of the termination.

Care with stripping of semiconductor screens on High Voltage XLPE cables is required with both Sigmaform and Raychem (Ramtech) heat shrink terminations.

A handwritten signature in black ink, appearing to read 'B. Kent'.

BRIAN KENT  
STANDARDS MANAGER POWER