



ELEVATION

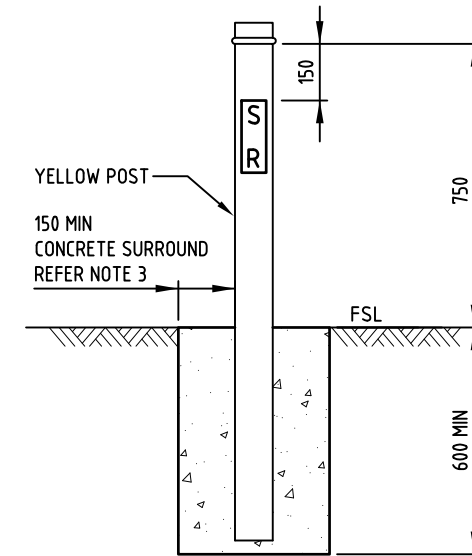

ELEVATION
MARKER POST
(NOT FOR ABORIGINAL COMMUNITIES)

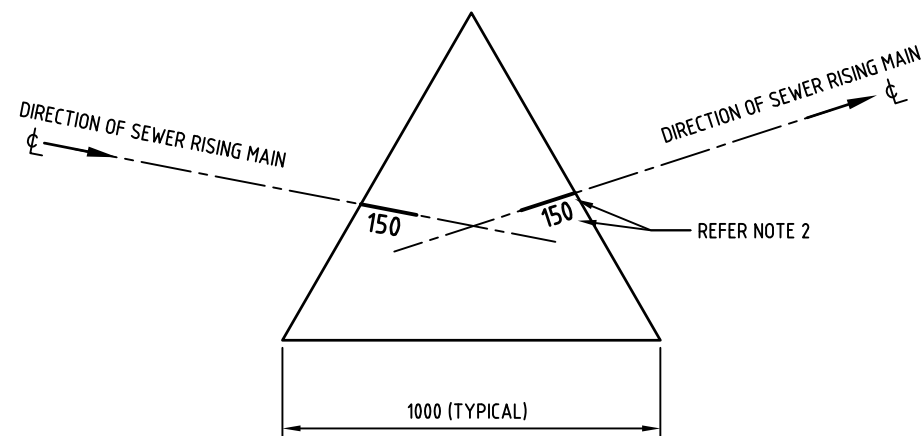

PLAN
CONCRETE MARKER
(FOR ABORIGINAL COMMUNITIES)

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. ENGRAVE OR SCORE MARKING TO SURFACE OF CONCRETE MARKER TO INDICATE DIRECTION AND NOMINAL DIAMETER OF SEWER RISING MAIN. DIRECTIONAL MARKING TO BE 100 MIN HIGH x 80 MIN WIDE x 5 MIN STROKE WIDTH x 5 MIN DEEP.
3. USE CONCRETE OF GRADE N25 MIN (25 MPa, 20 MAX SIZE AGGREGATE COMPLYING WITH AS1379).
4. USE ONLY THOSE MANUFACTURER'S PRODUCTS SHOWN APPROVED IN THE WATER AND SEWERAGE INFRASTRUCTURE PRODUCTS MANUAL.

2	GENERAL AMENDMENTS 2018.	P.W.	SEPT' 18	I.L.	D.C.
1	MARKER POST LETTERING CHANGED.	RGI	AUG' 08	R.J.	J.P.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
	AMENDMENTS				



DES	P.S. / I.W.	SEWERAGE STANDARD DRAWING		
DRN	A.GRAY	MAINLAYING		
CHK	I.WIGHT	SEWER RISING MAINS		
APPD	N.McCARTHY	LOCATION MARKING		
SCALE	N.T.S.	A3	DRAWING NUMBER	2
ISSUED	MAY' 01		W2-2-09	
ALL DIM. IN mm				
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		