

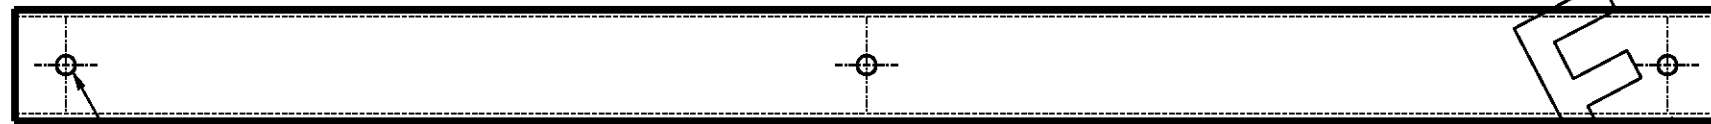
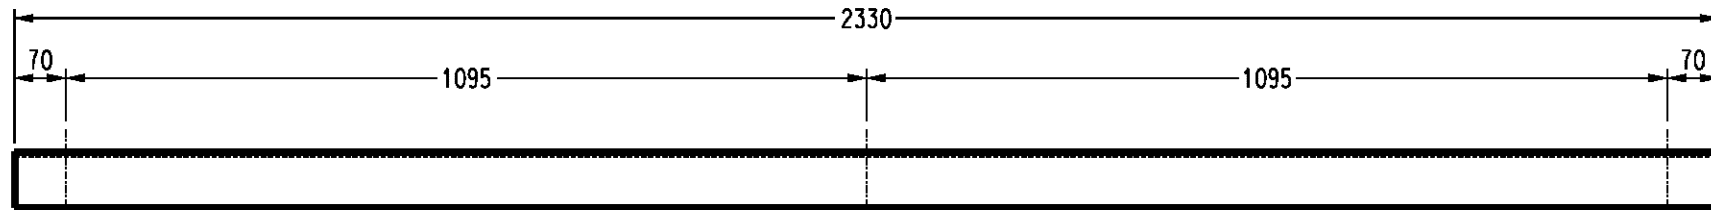


3RD ANGLE -DO NOT SCALE - REPORT ANY ERRORS,OMISSIONS TO DRAFTING OFFICE

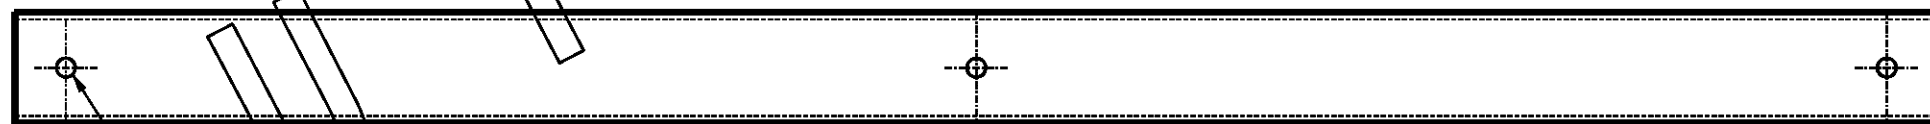

3 x \varnothing 26mm HOLES

11/22 kV STEEL CROSSARM STANDARD
STOCK CODES 9597 & 9605

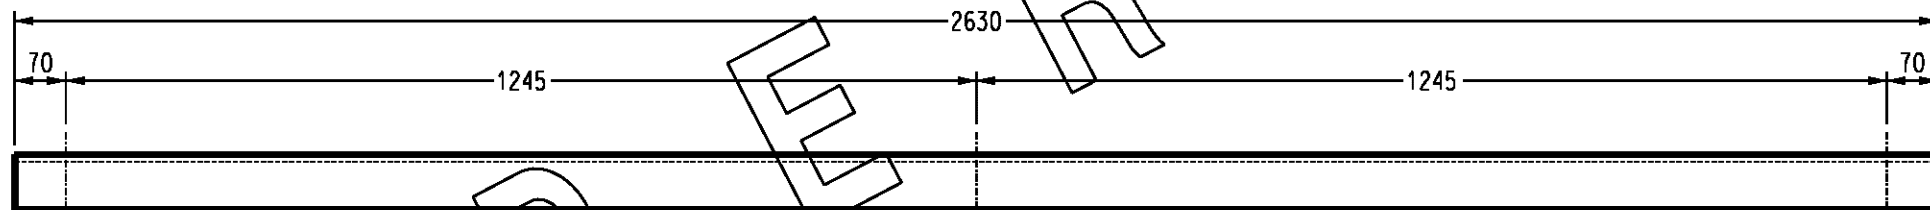

3 x \varnothing 26mm HOLES

22 kV STEEL CROSSARM (RURAL)
STOCK CODES 9613

ITEM	STOCKCODE	APPLICATION	SIZE
1	9597	ALL 11kV & 22kV URBAN	125 x 65 TFC
2	9605	22kV RURAL TERMINATION	150 x 75 PFC
3	9613	22kV RURAL INTERMEDIATE	125 x 65 TFC
4	STEEL REPLACEMENT FOR WOODEN TERMINATION XARM	150 x 75 PFC

NOTE:

1. ALL ROUGH OR BURRED EDGES ARE TO BE DRESSED CLEAN.

8	SUPERSEDED BY S01-01-02-10	A.T.	DEC'12	A.T.	B.C.
7	ITEM 4 ADDED, STEEL REPLACEMENT FOR WOODEN TERM XARM	R.I.	09/99	-	F.R.
6	REDRAWN ON CAD	A.D.	05/98	R.I.	F.R.
5	ITEM 1 AMENDED, ITEM 4 DELETED	N.S.	5/92	-	-
4	TITLE & NUMBER CHANGED	W.T	7/87	-	-
3	ITEM & STOCK Nos ADDED	W.T	1/87	-	B.K.
2	STORE Nos REVISED, 11kV HOLE SIZE ADDED	T.R.	2/85	-	G.Mc
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					

PowerWater
NORTHERN TERRITORY

DES	J.HASSANEN	POWER STANDARD DRAWING			
DRN	A.DAVIS	CROSSARMS STEEL HV			
CKD	R.INNES				
APPD	F.ROBSON				
SCALE	N.T.S.				
ISSUED	MAY'98	A3	DRAWING NUMBER	S01-01-02-02	8 AMDT
ALL DIM. IN mm		DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY	