


WARNING
CCTV EQUIPMENT INSTALLED ON STREETLIGHT POLES. CHECK FOR SECONDARY POWER SUPPLIES.

100

50


DETAIL C: CONTROL BOX TRAFFOLITE TAG
 BLACK LETTERS ON WHITE BACKGROUND
 SCALE 1:1

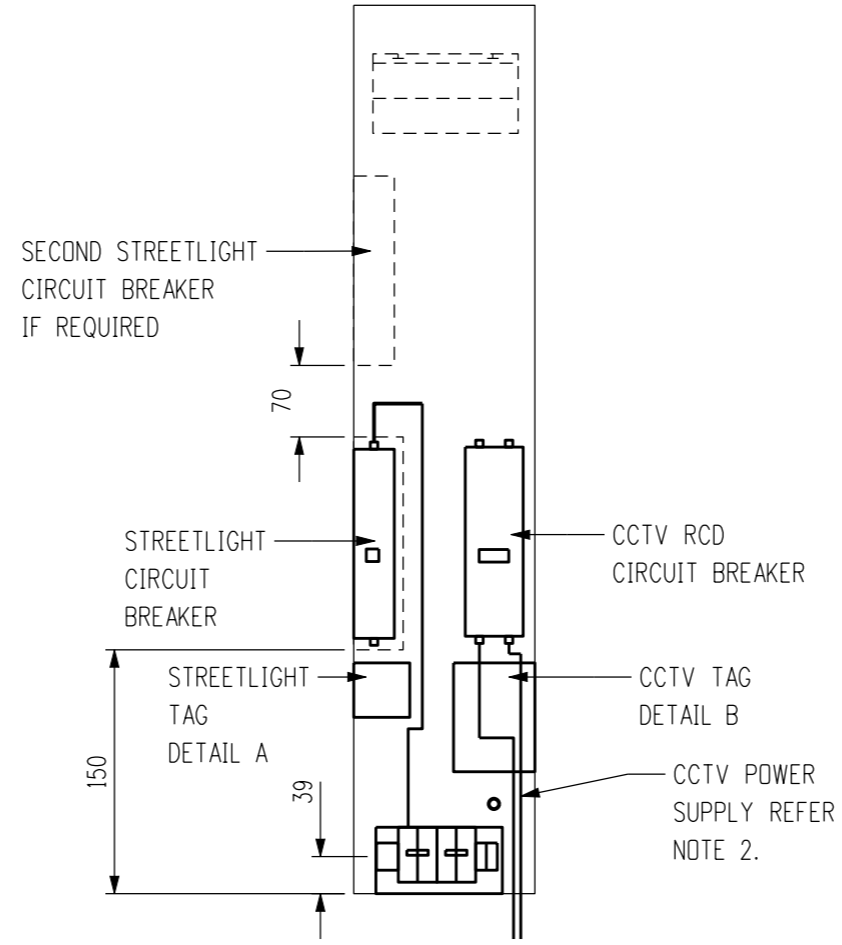


STREETLIGHT SWITCH PACK CCTV
 INSTALLATION DETAIL REFER TO
 S03-1-5-12 FOR FURTHER INFORMATION

NOTES:

1. STREETLIGHT COLUMN SHALL BE EITHER 9 OR 12M POLES AS SHOWN IN S03-1-1-01.
2. CCTV POWER SUPPLY SHALL BE SOURCED FROM AN UNMETERED SUPPLY AS SHOWN IN S02-2-1-02 WITH AN ISOLATION POINT ACESSIBLE TO PWC, UNLESS OTHERWISE AGREED TO UPON APPLICATION.
3. BOTH STREETLIGHT AND CCTV POWER SOURCES SHALL BE IDENTIFIED WITH DESTINATION TAGS, REFER S02-1-8-25, ON THEIR RESPECTIVE CABLES AND ALSO WITH A TRAFFOLITE TAG UNDER THEIR RESPECTIVE CIRCUIT BREAKERS, REFER DETAILS A AND B. REPLACE XXXXXXXX WITH ISOLATION LOCATION.
4. ALL EXTERNAL CCTV ASSOCIATED DEVICES AND CONDUITS SHALL BE BANDIT STRAPPED TO THE POLE.
5. ALL CCTV ASSOCIATED ELECTRICAL EQUIPMENT SHALL BE DOUBLE INSULATED.
6. ALL CCTV INSTALLATIONS SHALL BE UNDER A LICENSED AGREEMENT WITH POWER AND WATER.
7. A TRAFFOLITE WARNING LABEL SHALL BE INSTALLED IN THE STREETLIGHT CONTROL BOX ON EVERY CIRCUIT THAT HAS CCTV EQUIPMENT INSTALLED. REFER DETAIL C.

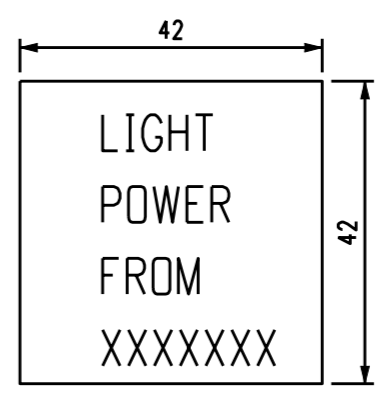

DETAIL A:
 STREETLIGHT TRAFFOLITE TAG
 BLACK LETTERS ON WHITE BACKGROUND
 SCALE 1:1

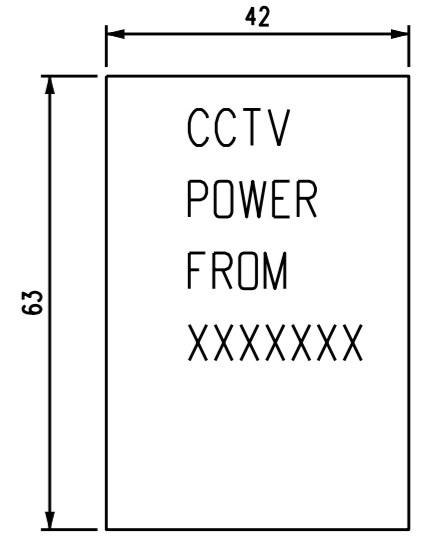

DETAIL B:
 CCTV TRAFFOLITE TAG
 WHITE LETTERS ON RED BACKGROUND
 SCALE 1:1

NO	DESCRIPTION	DRN	DATE	CKD	APPD
1	NOTE 2 AMENDED	A.T.	MAY'13	B.C.	B.S.
0	ISSUED FOR CONSTRUCTION	C.C	MAR'13	B.C.	B.S.
AMENDMENTS					



DES	B.CHEUNG	POWER STANDARD DRAWING		
DRN	A.TAYLOR	9.0 AND 12.0 METER COLUMN OUTREACH TYPE WITH CCTV INSTALLATION		
CKD	B.CHEUNG			
APPD	B.SMALL			
SCALE	AS SHOWN			
ISSUED	MAR 2013	A3	DRAWING NUMBER	S03-1-6-08
ALL DIM. IN mm				
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		 AMDT