


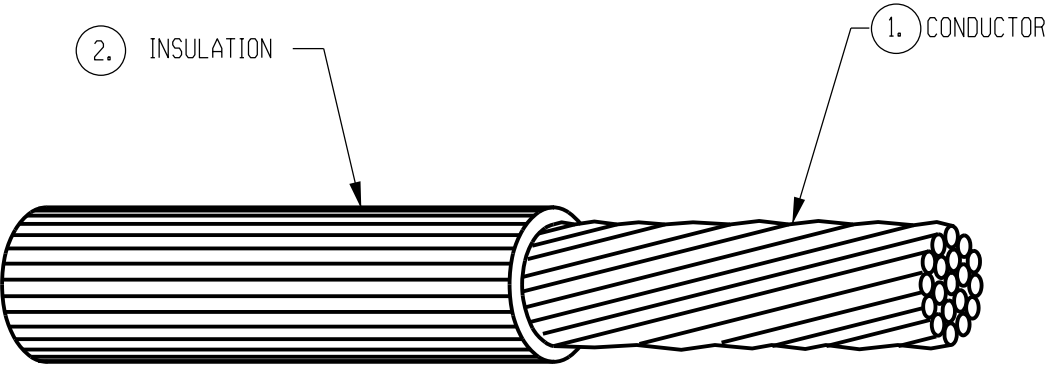

NOTES

- 1.CONDUCTOR TO BE COPPER
2.INSULATION PVC V75 GRADE
3.CABLES TO COMPLY WITH AS3147
4.INSULATION FOR ITEMS
15-20 TO COMPLY
WITH ESAA S(b)14-1980
5.'ST' INDICATES SPIRAL TRACE

ITEM	ITEM NUMBER	CONDUCTOR STRANDING	INSULATOR COLOUR	CROSS SECT. AREA mm ²	INSULATION THICKNESS mm	OVERALL DIA mm
1	19943	7/0.67	RED	2.5	0.8	3.6
2	213041	7/0.67	WHITE	2.5	0.8	3.6
3	19901	7/0.67	BLUE	2.5	0.8	3.6
4	191361	7/0.67	GREEN/YELLOW	2.5	0.8	3.6
11	20016	7/0.85	RED	4.0	1.0	4.9
12	196386	7/0.85	WHITE	4.0	1.0	4.9
13	246512	7/0.85	BLUE	4.0	1.0	4.9
14	246520	7/0.85	GREEN/YELLOW	4.0	1.0	4.9
15	246538	7/0.85	RED/BLACK	4.0	1.0	4.9
16	246546	7/0.85	RED/GREY	4.0	1.0	4.9
17	246553	7/0.85	WHITE/BLACK	4.0	1.0	4.9
18	246561	7/0.85	WHITE/GREY	4.0	1.0	4.9
19	246579	7/0.85	BLUE/BLACK	4.0	1.0	4.9
20	246587	7/0.85	BLUE/GREY	4.0	1.0	4.9
					0.8	

						 PowerWater NORTHERN TERRITORY	DES	A.B.	POWER STANDARD DRAWING			
							DRN	G.L.	CABLES COPPER-SINGLE CORE 0.6/1kV PVC - SHEET 2			
							CKD	A.B. /gmck				
							APPD	B.T.K.				
							SCALE	NTS				
							ISSUED	SEPT'91	A3	DRAWING NUMBER	S02-01-01-24	3
							ALL DIM. IN mm					
							DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT	