



LAMP OUTREACH  
REFER TO PAWA STD  
DRG NO S03-03-03-03

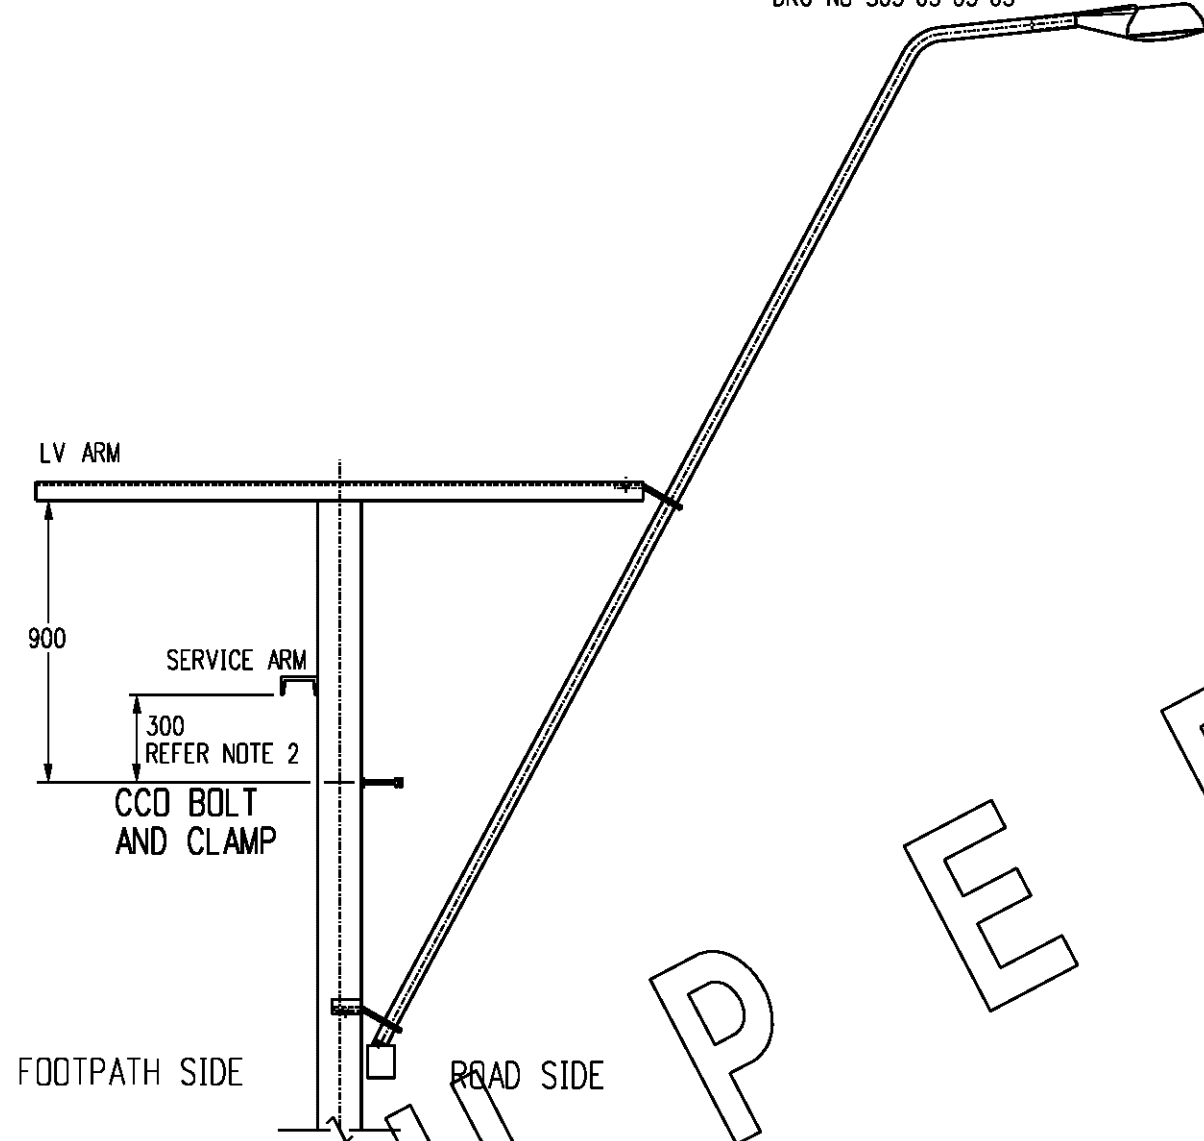

LANTERN OUTREACH CCD ATTACHMENT - CLEARANCES

1:25

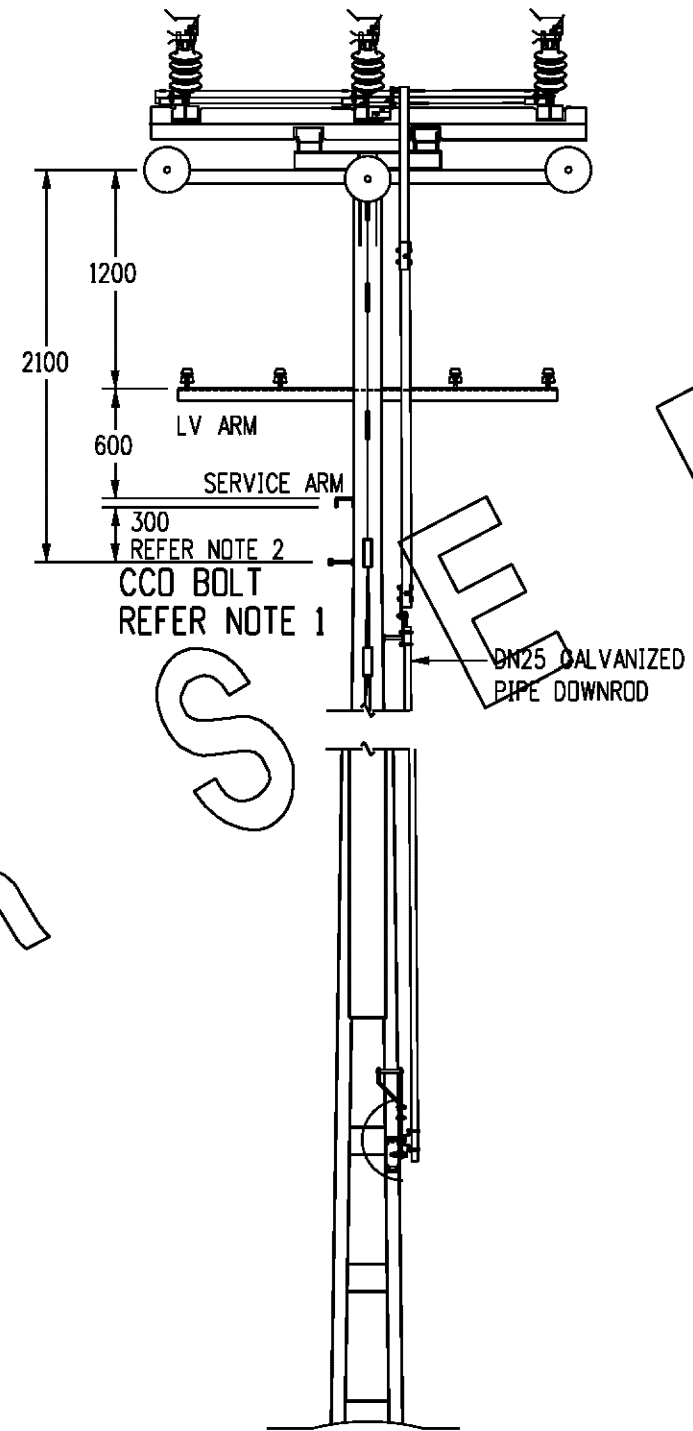

TYPICAL ABS - CCD ATTACHMENT

1:40

NOTES:

1. CCD ATTACHMENT BOLT TO BE LOCATED ON OPPOSITE SIDE OF AIR BREAK SWITCH OPERATING ARM.
2. 300mm MINIMUM CLEARANCE IS REQUIRED BETWEEN THE CCD BOLT AND CLAMP ATTACHMENT POINT. WHEN NON-INSULATED OR BARE CABLES AND FITTINGS ARE ATTACHED TO THE SERVICE CROSSARM OR POLE AND WORK IS TO BE PERFORMED AT OR NEAR THE CCD BOLT/CLAMP ATTACHMENT POINT, PAWA IS TO BE CONTACTED TO 'MAT UP' ALL LIVE COMPONENTS WITHIN 600mm OF THE WORK LOCATION.
3. CCD POWER SUPPLIES OR AMPLIFIERS ARE NOT TO BE ATTACHED TO AIRBREAK SWITCH, TRANSFORMER OR TEE-OFF POLES.

NO	DESCRIPTION	DRN	DATE	CKD	APPD
3	SUPERSEDED	A.T.	DEC'12	B.C.	B.C.
2	TEXT 'CETV' CHANGED TO 'CCO'.	RGI	APR'97	MWB	FRR
1	NOTE 2 RE SAFETY CLEARANCES ADDED.	RGI	OCT'96	MWB	PJD
AMENDMENTS					



DES	M.BOCK	POWER STANDARD DRAWING		
DRN	R.INNES	<b>CCO (COMMUNICATIONS CABLE OWNER) TYPICAL ATTACHMENT LANTERN OUTREACH / ABS</b>		
CKD	M.BOCK			
APPD	P.DEWAR			
SCALE	AS SHOWN			
ISSUED	06/09/96	A3	DRAWING NUMBER	S01-02-02-27
ALL DIM.	IN mm			
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT