


NOTES

1. ITEM 1 & 2 HAVE BUSHING PALMS.
2. ITEM 3 HAS 32mm BUSHING STEMS.
3. ALL CT's TO COMPLY WITH AS 1675.
4. ALL VT's TO COMPLY WITH AS 1243.
5. ALL METERING UNITS CATEGORY B.
6. ALL METERING UNITS ARE DUAL VOLTAGE
I.E. $\frac{22 \text{ kV}}{\sqrt{3}}$ OR $\frac{11 \text{ kV}}{\sqrt{3}}$ TO $\frac{110}{\sqrt{3}}$, 4 WIRE
7. STANDARD TECHNICAL SPECIFICATION, STS 026 REFERS.
8. SECONDARY TERMINAL BOX SHOWN WITH COVER REMOVED FOR THE SAKE OF CLARITY.

ITEM No.	STOCK CODE	CT CURRENT RATIO	CT VA OUTPUT	VT VA RATING	VT MIN. IMPULSE WITHSTAND	VT MIN. POWER FREQUENCY VOLTAGE
1	208165	100/50/25/5	15 VA	100 VA/ph	150 kV (Peak) for 22 kV	50 kV (RMS) for 22 kV
2	206938	400/200/100/5	15 VA	100 VA/ph	95 kV (Peak) for 11 kV	28 kV (RMS) for 11 kV
3	220525	1200/800/400/5	15 VA	100 VA/ph		

2	NOTES AMENDED, NOTE 7 REF TO STS 026 ADDED.	J.A.L.	S.C.M.	P.J.D.	APR'95
1	TERMINAL NUMBERS AMENDED.	gmck	N.S.	B.T.K.	APR'93
No.	AMENDMENT	DRN	CKD	APPD	DATE

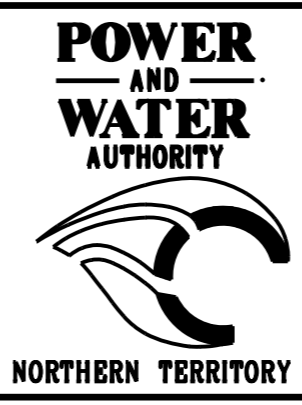

DES	J.W.	N.T. STANDARD DRAWING			
DRN	HT/pmc	METERING UNIT POLE TOP DUAL VOLTAGE RATIO - 11/22 kV			
CKD	N.S.				
APPD	B.KENT				
SCALE	N.T.S.				
ISSUED	DEC'89	A3	DRAWING NUMBER	S1-2-8-3	
ALL DIM. IN mm					
DRAFTING STANDARD TO AS 1100		CAD PRODUCT — DO NOT AMEND MANUALLY		AMDT	