



ITEM 1 CROSSARM-TRANSFORMER & CABLE TERMINATION-5 WIRE

STOCK CODE 9563

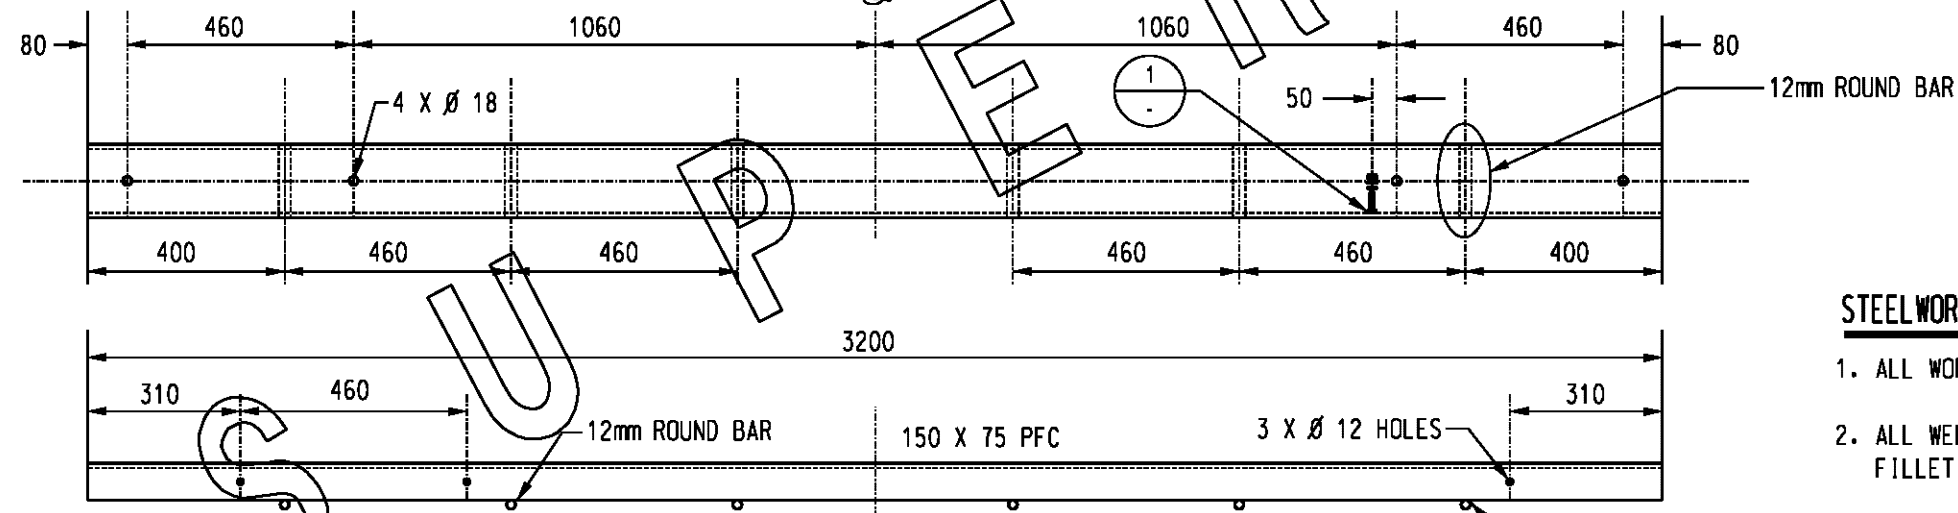


ITEM 2 CROSSARM-TRANSFORMER & CABLE TERMINATION-4 WIRE

STOCK CODE 245936

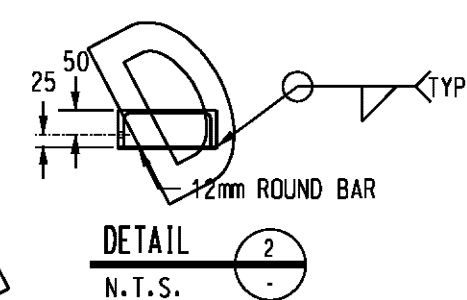

DETAIL 2
N.T.S.

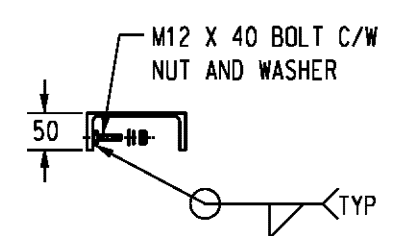

DETAIL 1
N.T.S.

STEELWORK NOTES :

1. ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH AS3678.
2. ALL WELDING AND WELD PREPARATION SHALL BE IN ACCORDANCE WITH AS1554. FILLET WELDS TO BE 5 mm UNLESS NOTIFIED OTHERWISE.
3. ALL ROUGH OR BURRED EDGES ARE TO BE DRESSED CLEAN.
4. BOLTS TO BE METRIC, PROPERTY CLASS 4.6 AND SHALL BE IN ACCORDANCE WITH AS1111.

NO	DESCRIPTION	DRN	DATE	CKD	APPD
3	SUPERSEDED	A.T.	DEC'12	B.C.	B.C.
2	DETAIL 2 CHANGED TO 12mm ROUND BAR.	K.I.	JAN'05	R.C.	C.C.
1	REDRAW ON MICROSTATION. CHANGE TO AUSTRALIAN STANDARD.	J.A.L.	JUN'98	F.R.R.	
AMENDMENTS					



DES	-	N.T. STANDARD DRAWING		
DRN	G.L.	CROSSARMS STEEL L.V. TRANSFORMER AND CABLE TERMINATION		
CKD	gmck/N.S.			
APPD	B.KENT			
SCALE	1:20			
ISSUED	MAY'91	A3	DRAWING NUMBER	S01-1-2-05
ALL DIM. IN mm U.N.O.				
DRAFTING STANDARD TO AS 1100		CAD PRODUCT - DO NOT AMEND MANUALLY		AMDT

