

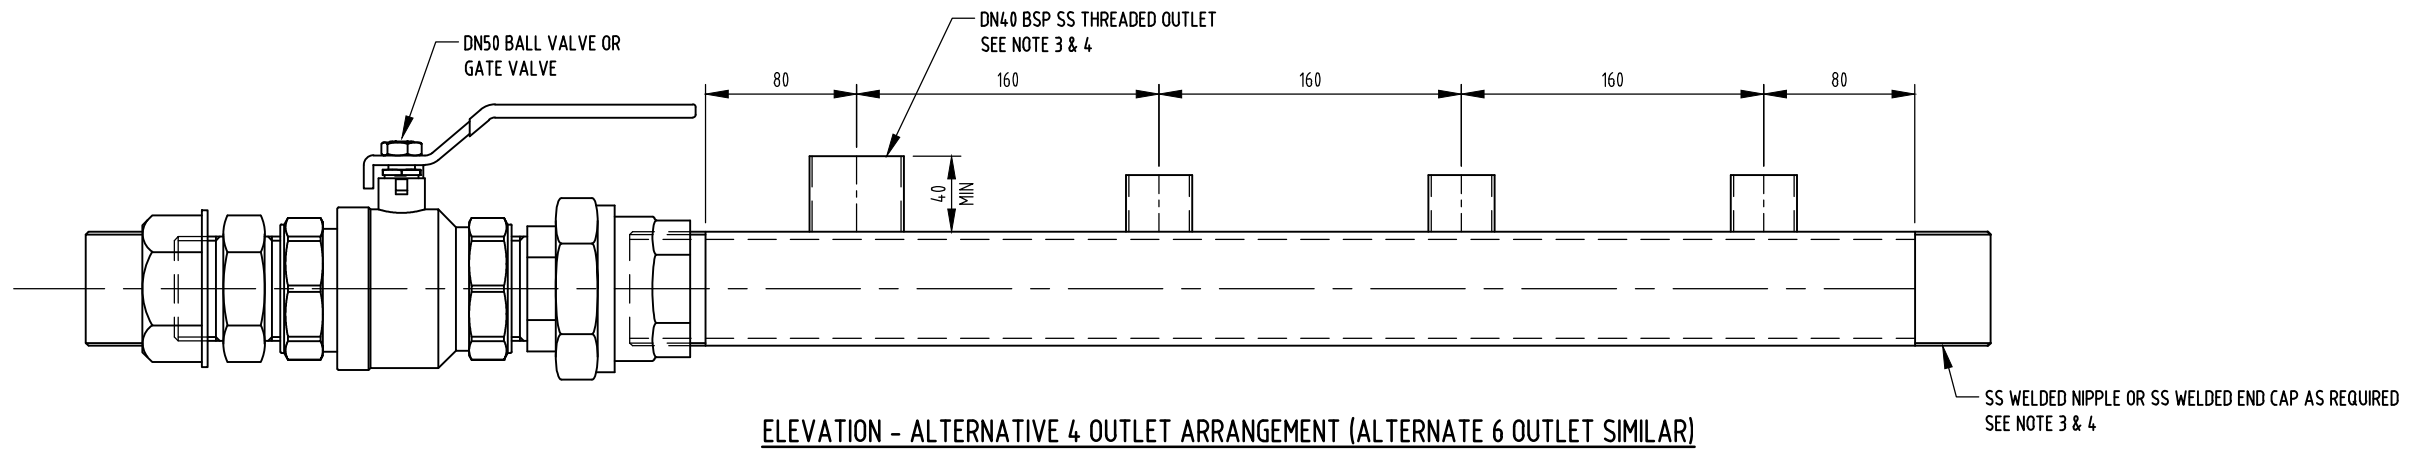


NOTES:

1. PASSIVATE ALL STAINLESS STEEL AFTER WELDING.
2. USE DR COPPER ALLOY OR STAINLESS STEEL 25/20 REDUCING BUSH FOR DN20 UPTAKE.
3. USE SILVER BRAZING ALLOY (MIN 38% SILVER TO AS 1167.1) FOR ALL CAPILLARY JOINTS OF STAINLESS STEEL PIPES AND FITTINGS.
4. USE FILLER RODS OF LOW CARBON STAINLESS STEEL NOT GREATER THAN 2mm IN DIAMETER AND COMPLYING WITH AS 1167.2.

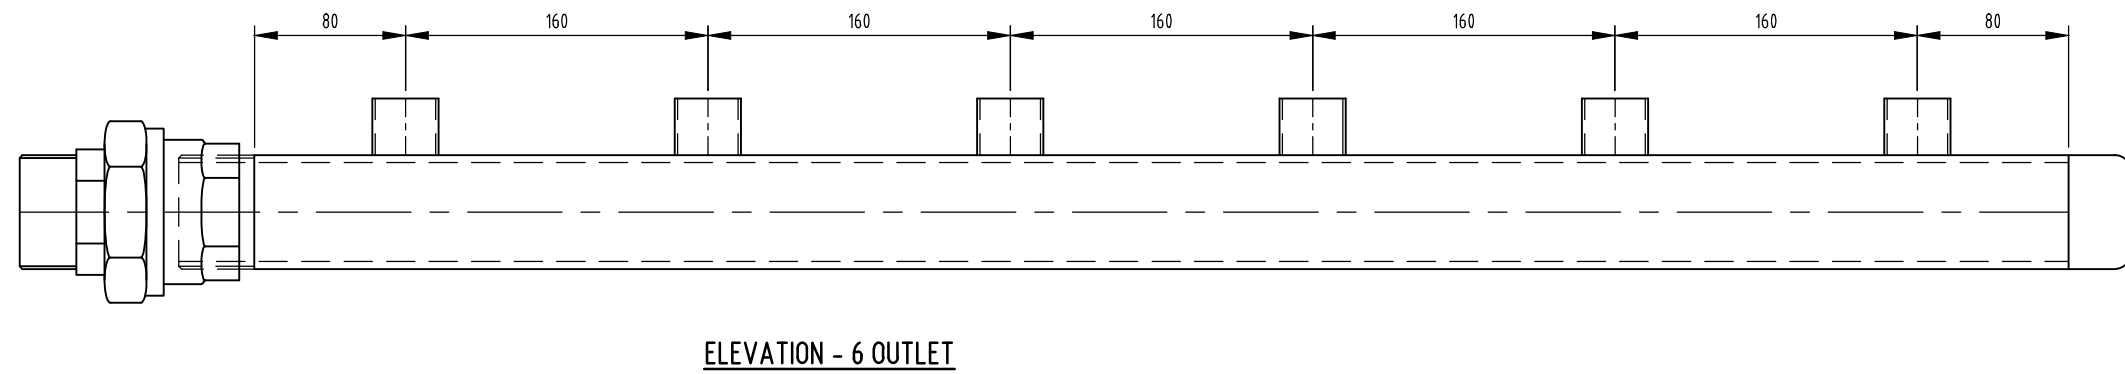

3	GENERAL AMENDMENTS 2020.	PW	JUL '20	JR	DC
2	REDRAWN IN AUTOCAD	AW	JUNE '18	JR	DC
1	4 OUTLET ARRANGEMENT MODIFIED	AW	MAR '17	RJ	RJ
NO	DESCRIPTION	DRN	DATE	CKD	APPD
	AMENDMENTS				

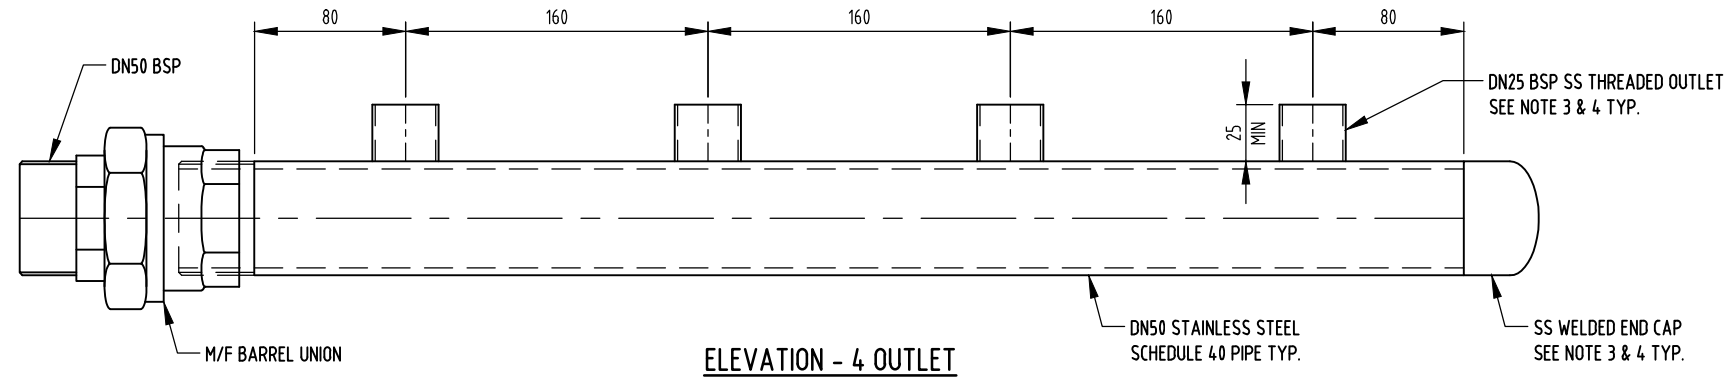

DES	RJ	WATER STANDARD DRAWING SERVICES MULTI METERING MANIFOLD FOR DN20 AND DN25 METERS	3
DRN	RI		
CHK	RJ		
APPD	JP		
SCALE	N.T.S.		
ISSUED	NOV '08	A3	DRAWING NUMBER
ALL DIM. IN mm			W1-1-18C
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY	
			AMDT