



**FOR POTABLE WATER ONLY**

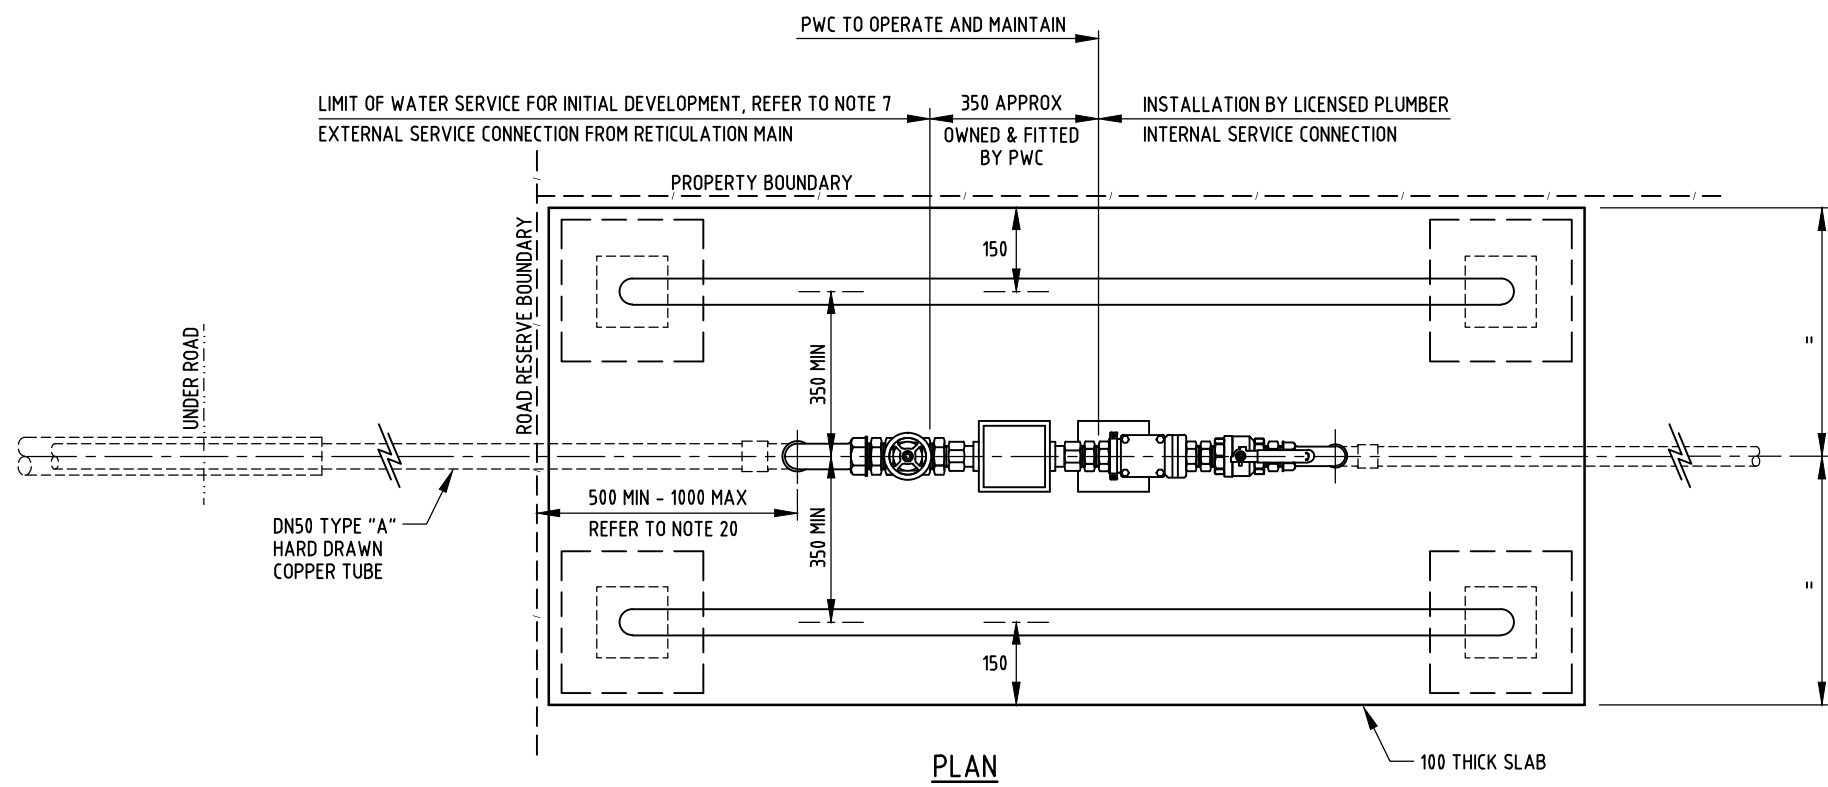

**PLAN**

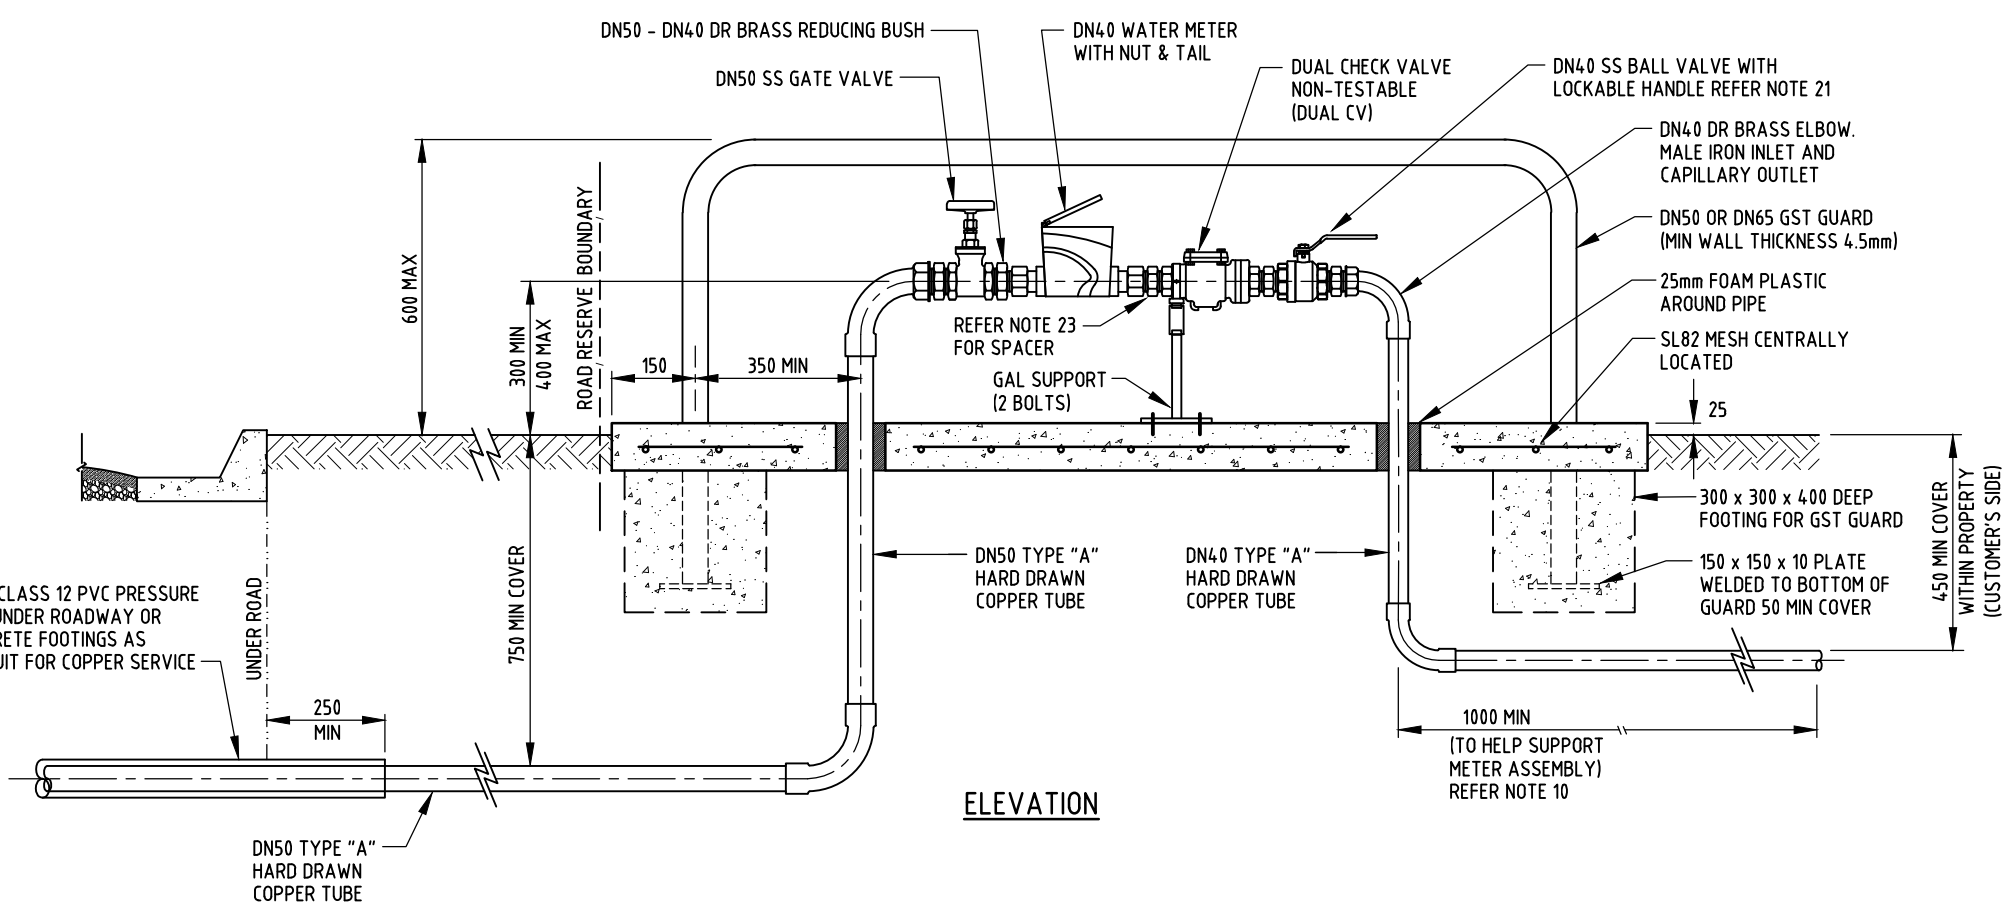

**ELEVATION**

**NOTES:**

- ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE.
- COPPER ALLOY SHALL BE DEZINCIFICATION RESISTANT (DR) TO AS2345.
- USE SILVER BRAZING ALLOY (MIN 2% SILVER TO AS1167.1) FOR ALL CAPILLARY JOINTING OF COPPER PIPES AND FITTINGS OR ALTERNATIVELY, FOR HORIZONTAL JOINTS ABOVE GROUND PRESS FITTINGS MAY BE USED.
- THE METER ASSEMBLY SHALL BE HORIZONTAL.
- ONLY PWC (OR ITS AUTHORISED CONTRACTORS) ARE PERMITTED TO TAP EXISTING, IN-SERVICE (LIVE) MAINS OR MAINS THAT HAVE BEEN HYDROSTATICALLY TESTED. WITHIN LICENSED AREAS AND UPON PAYMENT OF THE NECESSARY FEES, PWC WILL PERFORM TAPPING OF LIVE MAINS, HOWEVER, EXCAVATION, ALL MATERIALS AND INSTALLATION SHALL BE SUPPLIED BY THE CONTRACTOR.
- ALL PIPES, VALVES AND FITTINGS MUST BE WATER MARK APPROVED.
- ON COMPLETION OF WATER SERVICE, PROVIDE BRASS PLUG FITTED TO METER TAP OUTLET.
- NON-METALLIC MATERIALS AND FITTINGS SHALL NOT FORM PART OF WATER METER ASSEMBLY.
- BACKFLOW CERTIFIED PLUMBER IS REQUIRED TO DETERMINE THE RISK OF CONTAMINATION OF THE POTABLE WATER SUPPLY DUE TO CROSS CONNECTIONS, REFER AS/NZS3500.1. A TESTABLE BACKFLOW PREVENTION DEVICE SHALL BE FITTED FOR MEDIUM OR HIGH HAZARD PROPERTIES.
- TO ENSURE INTEGRITY AND STABILITY OF THE WATER METER INSTALLATION ANY CONNECTION TO THE COPPER RISER OF THE CUSTOMER'S SERVICE AND THE FIRST UNDERGROUND 1000mm OF THE CUSTOMER'S SERVICE MUST USE BRAZED JOINTS COMPLYING WITH NOTE 3.
- NO OTHER UTILITY SERVICES (EG. COMMUNICATIONS, POWER, SEWER) TO BE INSTALLED BETWEEN WATER METER AND PROPERTY BOUNDARY.
- MINIMUM CLEARANCE TO OTHER SERVICES SHALL BE 300mm.
- WHERE SIDE BOUNDARY OF PROPERTY ADJACENT TO WATER METER IS NOT PERPENDICULAR TO ROAD RESERVE BOUNDARY, INSTALL WATER METER PARALLEL TO SIDE BOUNDARY.
- NUT AND TAILS FOR METER INSTALLATION SUPPLIED BY PWC.
- PRESSURE TEST WATER SERVICE AT 1000kPa FOR 30 MINUTES (NO PRESSURE LOSS PERMITTED) USING WATER CHLORINATED TO A MINIMUM CHLORINE CONCENTRATION OF 25mg/L (REFER PWC WATER SERVICES GUIDELINE FOR DISINFECTION OF SUBDIVISIONS AND WATER SERVICE CONNECTIONS FROM 20mm AND GREATER). ENSURE PIPEWORK IS FLUSHED OUT AFTER THE TEST FOR A MINIMUM OF FIVE MINUTES.
- IN TRAFFICABLE AREAS, PROVIDE PROTECTIVE GUARD AND CONCRETE SLAB. GUARD IS NOT REQUIRED ON THE FENCED SIDE.
- CONCRETE SHALL BE GRADE N25 MINIMUM (MAXIMUM AGGREGATE SIZE 20mm).
- REFER TO BUILDING CODE OF AUSTRALIA WHERE FIRE HOSE REELS OR OTHER FIRE SYSTEMS ARE CONNECTED.
- NOT TO BE USED WITH FIRE SPRINKLERS OR FIRE HYDRANTS.
- WHERE THE METER ARRANGEMENT IS LOCATED IN A ROAD RESERVE, REFER TABLE BELOW.

ROAD DESIGN SPEED (KPH)						
	50	60	70	80	90	>90
MINIMUM SETBACK FROM KERB OR ROADWAY (m)	3.0	4.0	5.5	7.0	8.5	11.0

- VALVE TO BE ABLE TO BE LOCKED IN OPEN POSITION.
- FOR ABOVE GROUND JOINTS, PRESS FITTING IS ALLOWED ON CUSTOMER'S SIDE OF THE METER.
- APPROX. 200 MIN - 300 MAX. SPACER NEEDED FOR COMMERCIAL OR RETAIL INSTALLATIONS REFER TO STD DRG W1-1-19C.

NO	DESCRIPTION	DRN	DATE	CKD	APPD
2	GENERAL AMENDMENTS 2020.	PW	JULY'20	JR	DC
1	GENERAL UPDATE.	AW	JUNE'18	JR	DC
0	ISSUED FOR INFORMATION.	AW	APRIL'13	RJ	RJ
AMENDMENTS					



DES	-	<b>WATER STANDARD DRAWING</b>	
DRN	AW	<b>SERVICES</b>	
CHK	RJ	<b>DN40 WATER SERVICE - COPPER</b>	
APPD	RJ	<b>LOW HAZARD</b>	
SCALE	N.T.S.	<b>A3</b>	<b>DRAWING NUMBER</b>
ISSUED	APRIL 2013		
ALL DIM. IN mm		<b>CAD PRODUCT - DO NOT AMEND MANUALLY</b>	
DRAFTING STANDARD TO A.S.1100			<b>2</b>
			<b>AMDT</b>