


TYPICAL CLEARANCES A

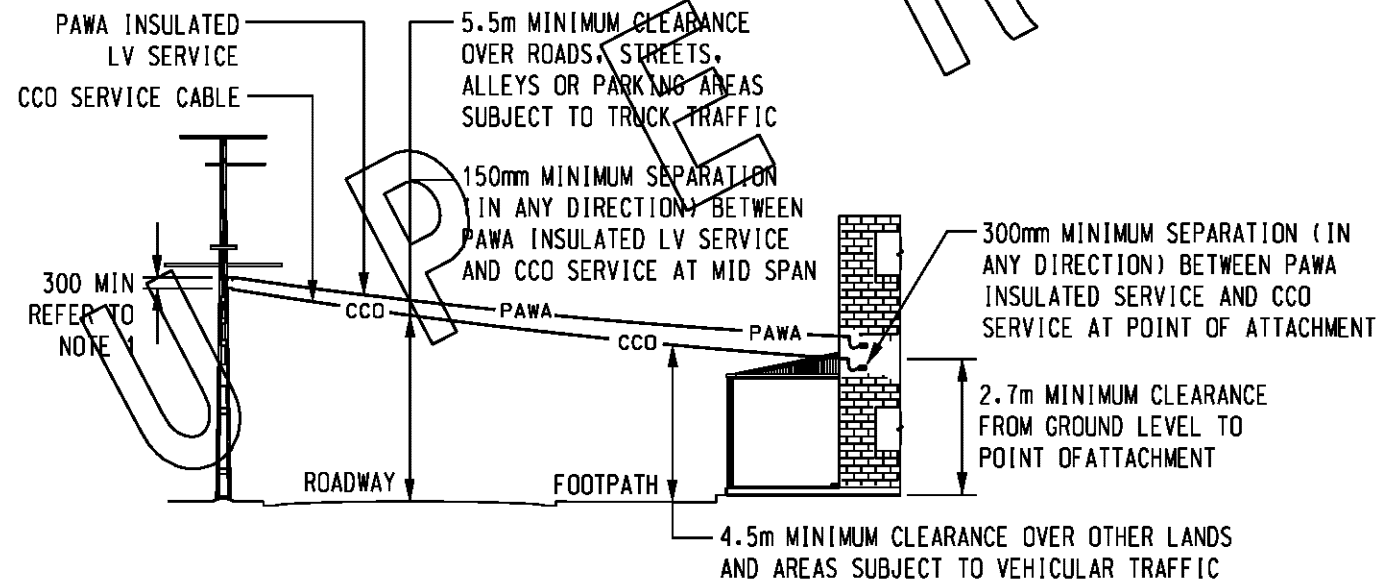

TYPICAL CLEARANCES B

NOTES:

- 300mm MINIMUM CLEARANCE IS REQUIRED BETWEEN THE SERVICE ARM AND THE CCO BOLT AND CLAMP ATTACHMENT POINT. WHEN NON-INSULATED OR BARE CABLES AND FITTINGS ARE ATTACHED TO THE SERVICE CROSSARM OR POLE AND WORK IS TO BE PERFORMED AT OR NEAR THE CCO BOLT/CLAMP ATTACHMENT POINT, PWA IS TO BE CONTACTED TO 'MAT UP' ALL LIVE COMPONENTS WITHIN 600mm OF THE WORK LOCATION.
- * CCO = COMMUNICATIONS CABLE OWNER.
- REFER TO STD DRG S1-02-02-23 FOR DETAILS OF TYPICAL HV AND LV CABLE CLEARANCES.



NO	DESCRIPTION	DRN	DATE	CKD	APPD
1	SUPERSEDED	A.T.	DEC'12	B.C.	B.C.
AMENDMENTS					

DES	M. BOCK	POWER STANDARD DRAWING		
DRN	R. INNES	CCO (COMMUNICATIONS CABLE OWNER) TYPICAL CABLE CLEARANCES LV OVERHEAD - SERVICE LINES		
CKD	M. BOCK			
APPD	F. ROBSON			
SCALE	1:200			
ISSUED	FEB'97	A3	DRAWING NUMBER	S01-02-02-29
ALL DIM.	IN mm			
DRAFTING STANDARD TO A.S.1100			CAD PRODUCT - DO NOT AMEND MANUALLY	

