
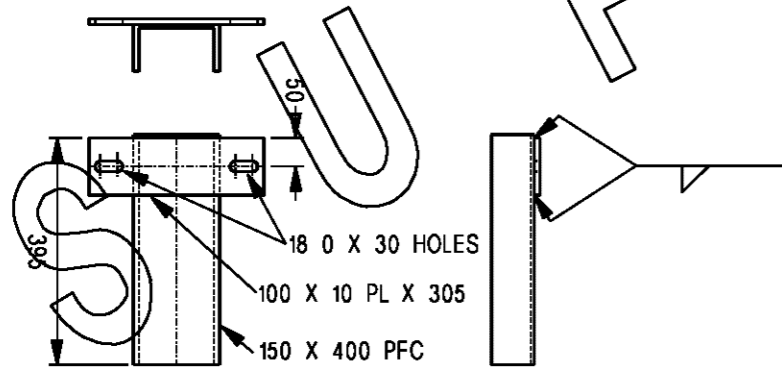


ELEVATION
Scale 1:40

SECTION
Scale 1:40

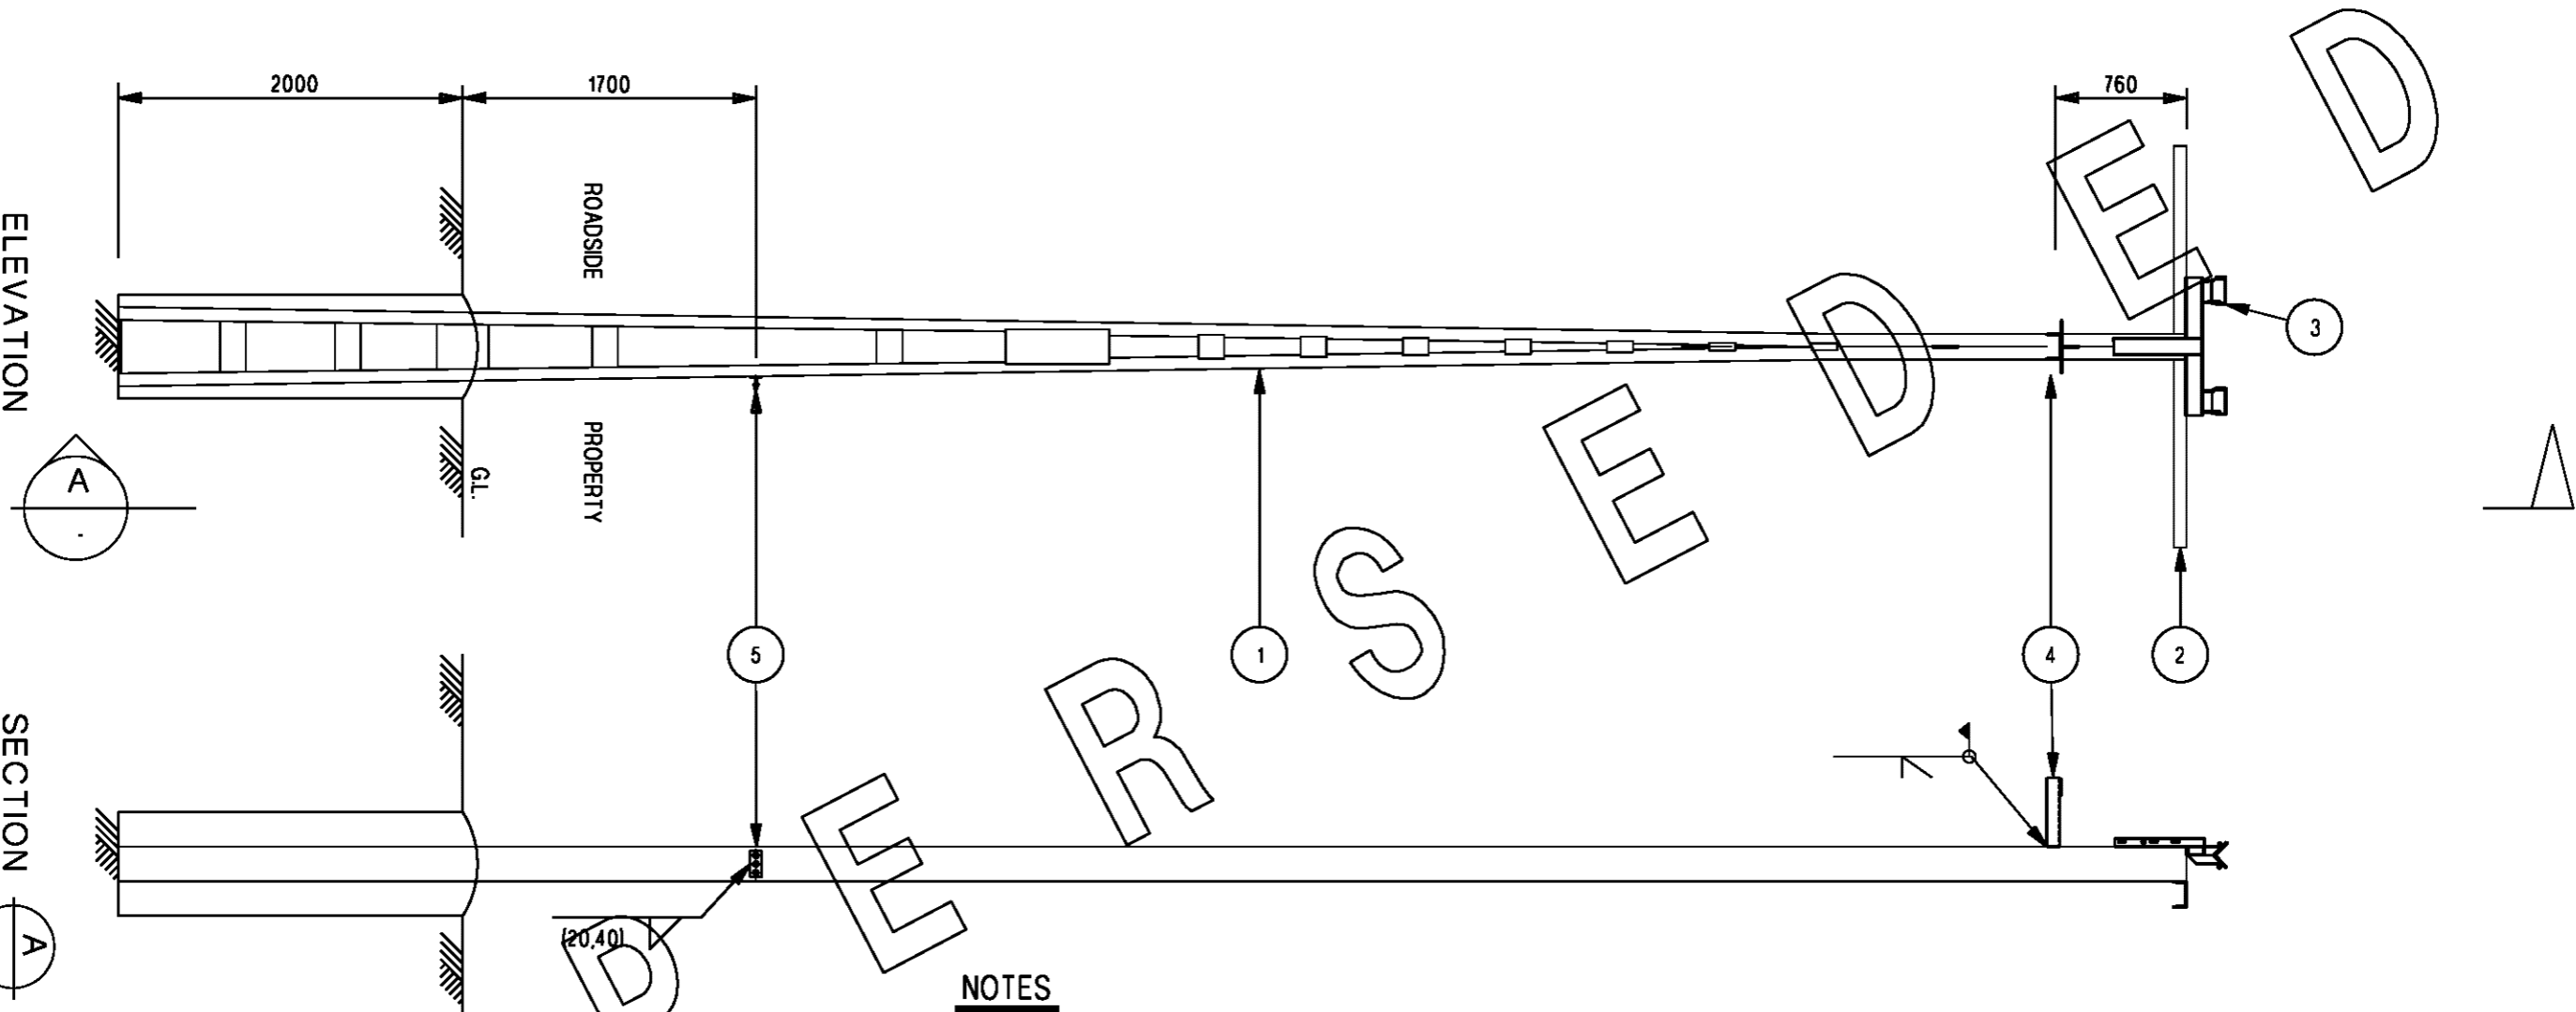

TRI-FUSE STAND-OFF BRACKET
N.T.S.

NOTES

1. ALL CROSSARMS AND LOAD BEARING ATTACHMENTS SHALL BE FIXED TO THE POLE VIA A 6mm FILLET WELD ALL ROUND USING E41XX ELECTRODES UNO.
2. EARTH TEST LINK SHALL BE FIXED TO THE POLE BY INTERMITTENT 6mm FILLET WELDS (WELD 20, MISS 40) USING E316L STAINLESS STEEL ELECTRODES.
3. AIR BREAK SWITCH MOUNTING BRACKET IS SUPPLIED AS PART OF THE AIR BREAK SWITCH (VERTICAL MOUNTING) CONVERSION KIT (STOCK CODE 250696).
4. THE OPERATING HANDLE SHALL BE MOUNTED IN SUCH A WAY THAT THE OPERATOR WILL BE FACING ON-COMING TRAFFIC.
5. ALL WELDING IS TO COMPLY WITH AS 1554

TAGNo	QTY	DESCRIPTION	STOCK CODE	DRG REF
5	1	EARTH TEST LINK	9142	S01-01-05-02
4	1	TRI-FUSE STAND-OFF BRACKET	-	S01-02-05-16
3	1	ABS BRACKET (REFER NOTE 3)	-	-
2	1	CROSSARM - HV	9605	S01-01-02-02
1	1	LINE POLE - 12C	11130	S01-01-02-02

MATERIAL SCHEDULE

NO	DESCRIPTION	DRN	DATE	CKD	APPD
1	OBSOLETE	J.C.	JUN'09	A.T.	S.C.

AMENDMENTS



DES	A.T.	POWER STANDARD DRAWING		
DRN	J.A.L.	POLE STRUCTURES		
CKD	S.C.M.	COMBINED AIR BREAK SWITCH		
APPD	P.J.D.	TRI-FUSE - SECTIONALISER ASSEMBLY		
SCALE	AS SHOWN	A3	DRAWING NUMBER	S01-02-05-18
ISSUED	JUN'95			
ALL DIM. IN mm				
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		

