



NOTES:



1. GALVANISED STEEL TUBE SHALL BE MEDIUM WALL THICKNESS COMPLYING WITH AS 1074.
2. CONCRETE SHALL BE CLASS N20 MIN (20 MPa, 20 mm MAX SIZE AGGREGATE).

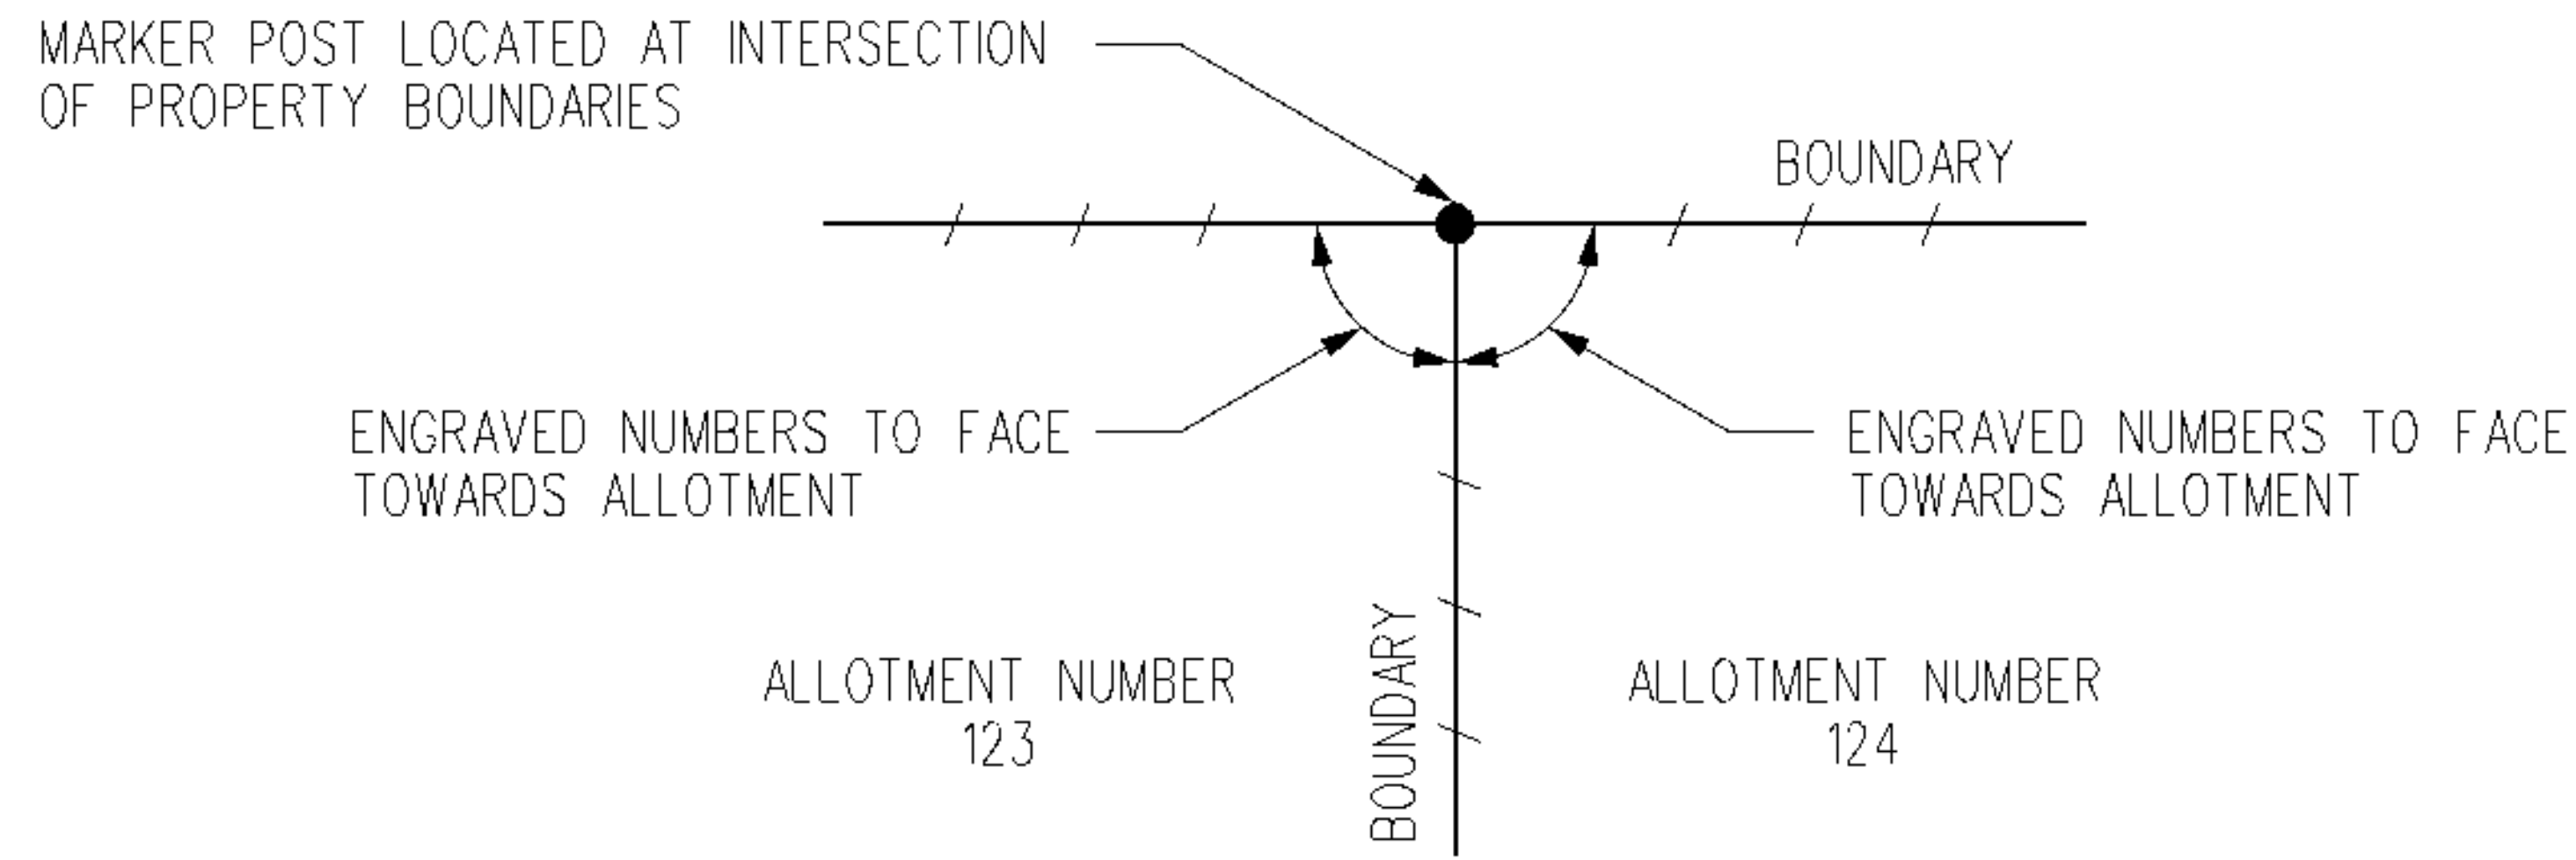

PLAN  
ALLOTMENT MARKER POST LOCATION

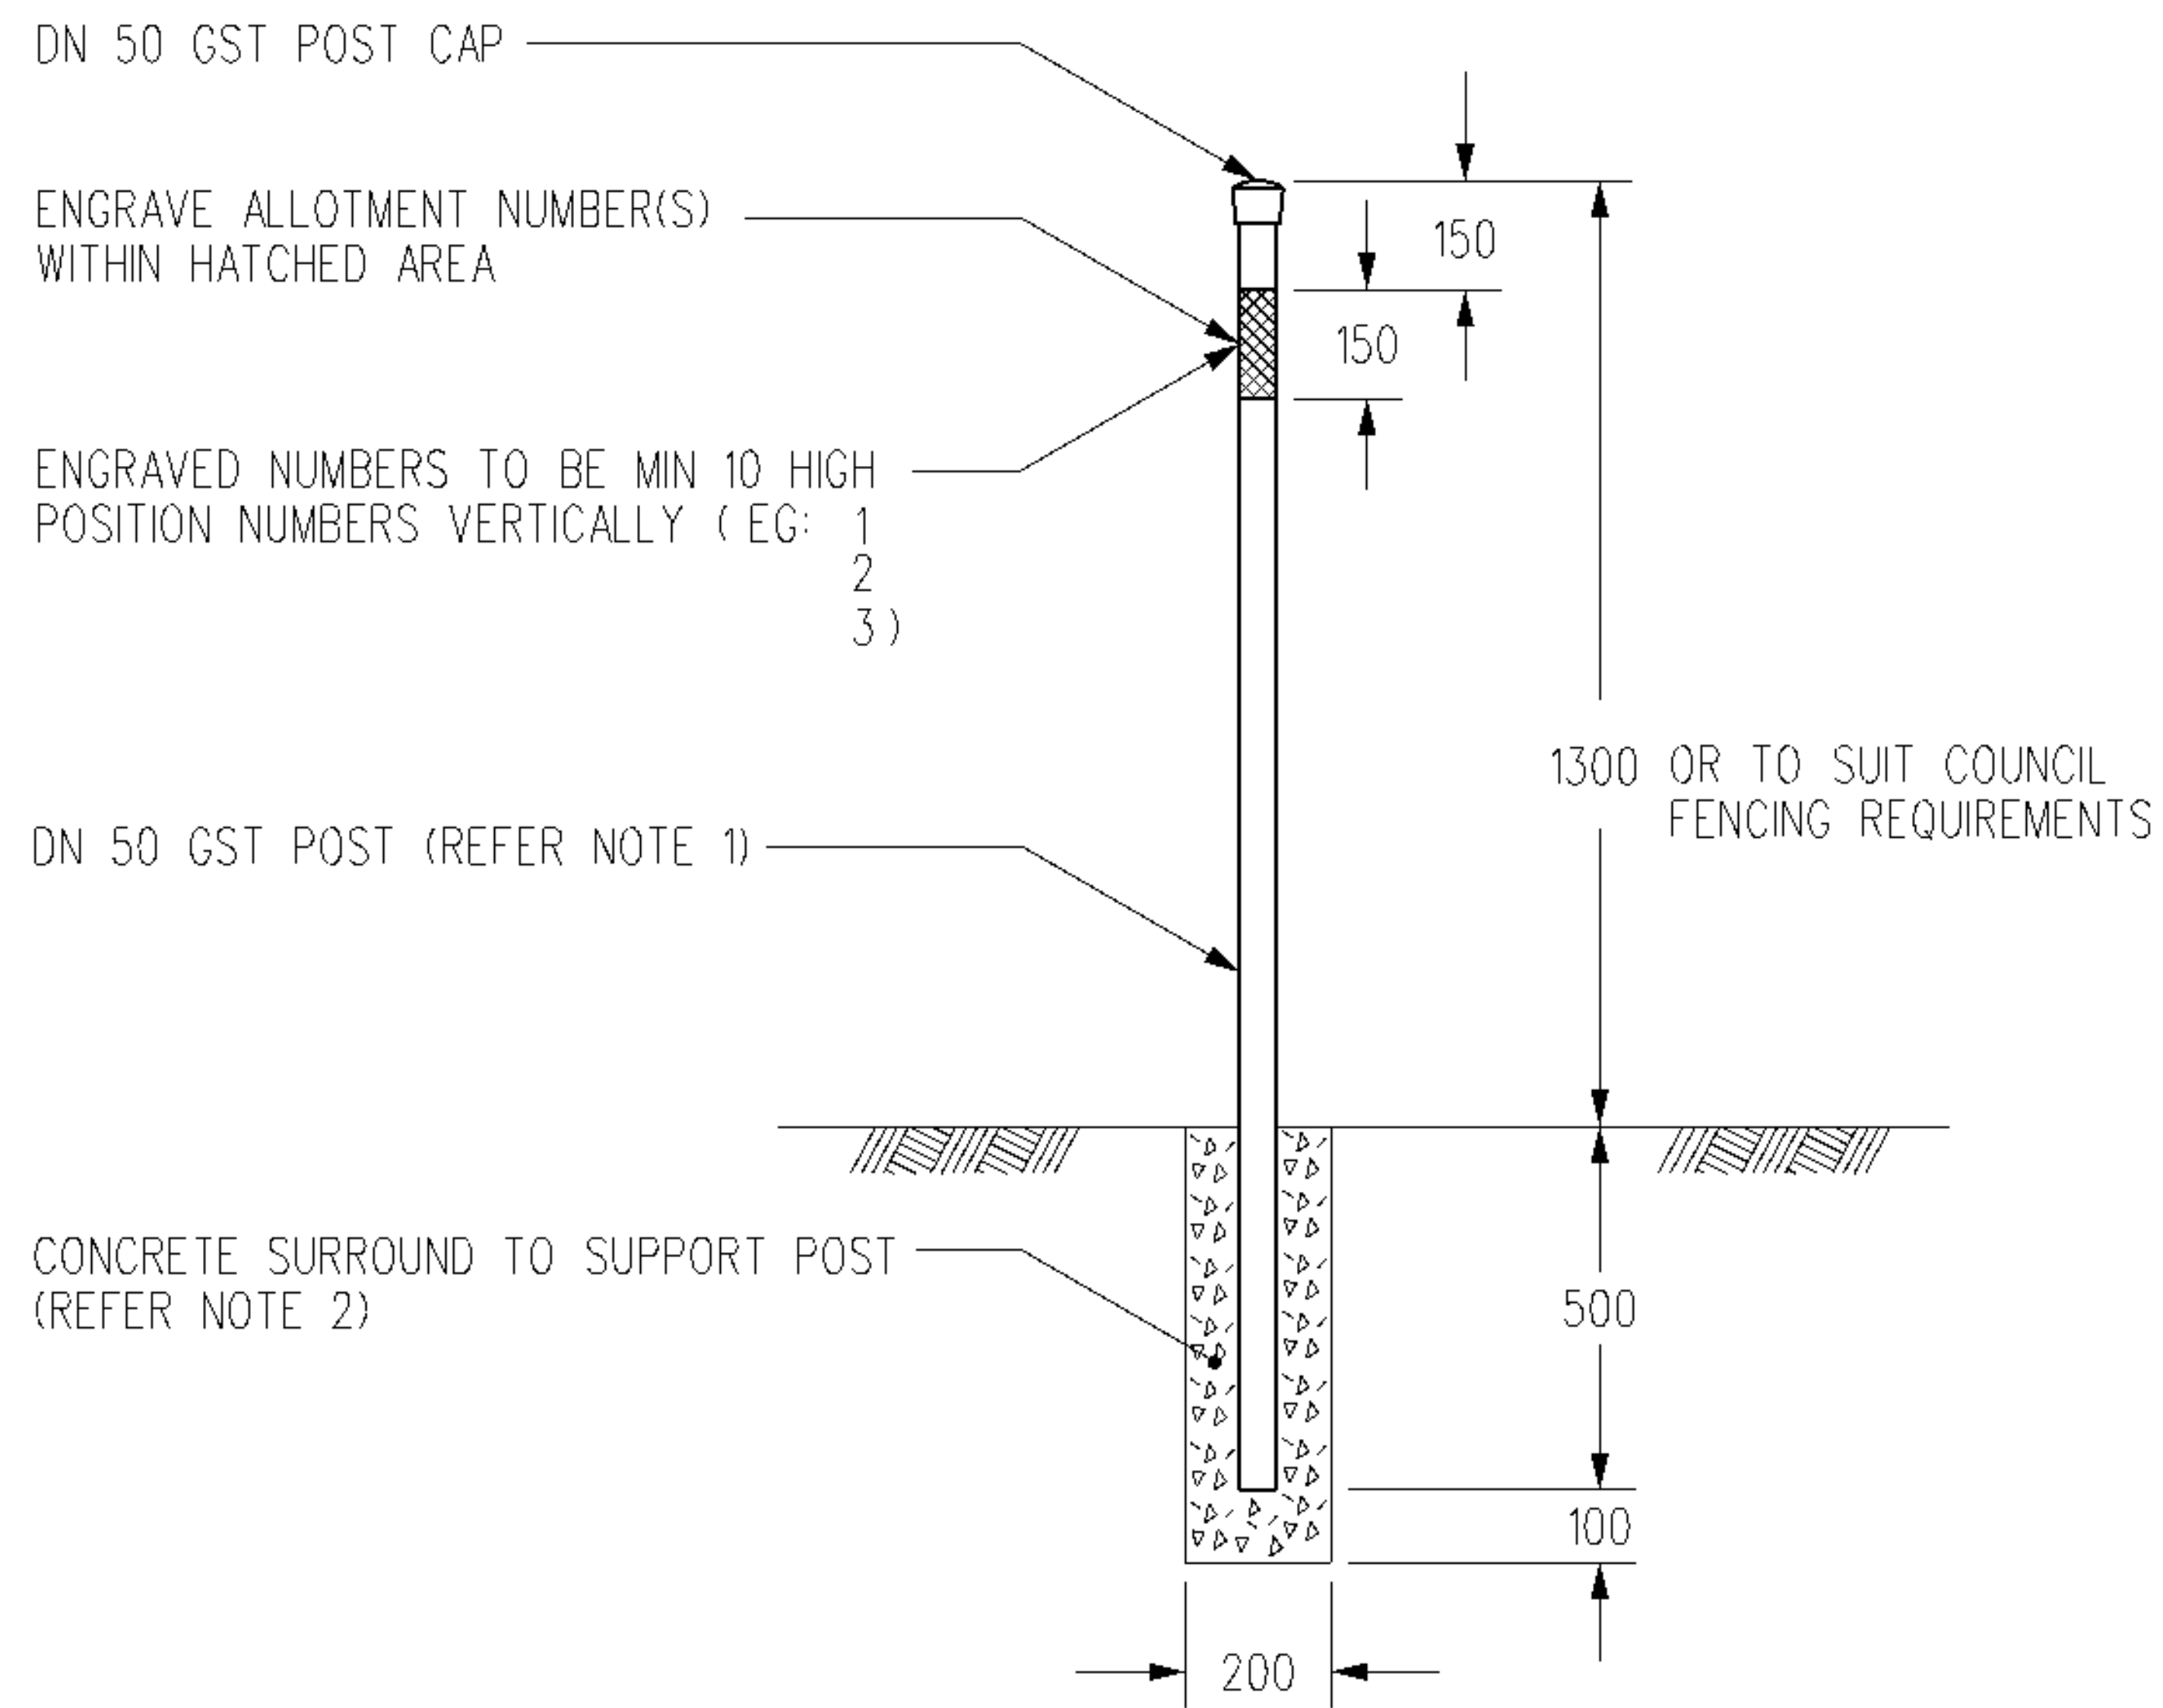

ELEVATION  
ALLOTMENT MARKER POST

						 <p><b>POWER AND WATER AUTHORITY</b></p> <p>NORTHERN TERRITORY</p>	DES	N McC	WATER STANDARD DRAWING		
							DRN	A G	<b>MISCELLANEOUS FIELD MARKERS FOR ALLOTMENTS LOCATED IN ABORIGINAL COMMUNITIES</b>		
						CKD	P S	A3			
						APPD	N McC		DRAFTING STANDARD TO A.S.1100	CAD PRODUCT - DO NOT AMMEND MANUALLY	
						SCALE	NTS				
						ISSUED	FEB/2001				
						ALL DIM. IN	mm				
NO	DESCRIPTION	DRN	DATE	CKD	APPD						
	AMENDMENTS										