



FOR POTABLE WATER ONLY



NOT FOR SUPPLY TO FIRE SPRINKLERS OR FIRE HYDRANTS

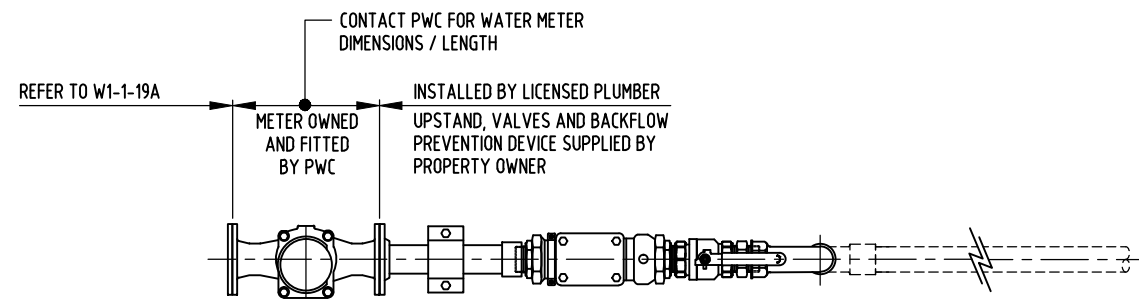

PLAN

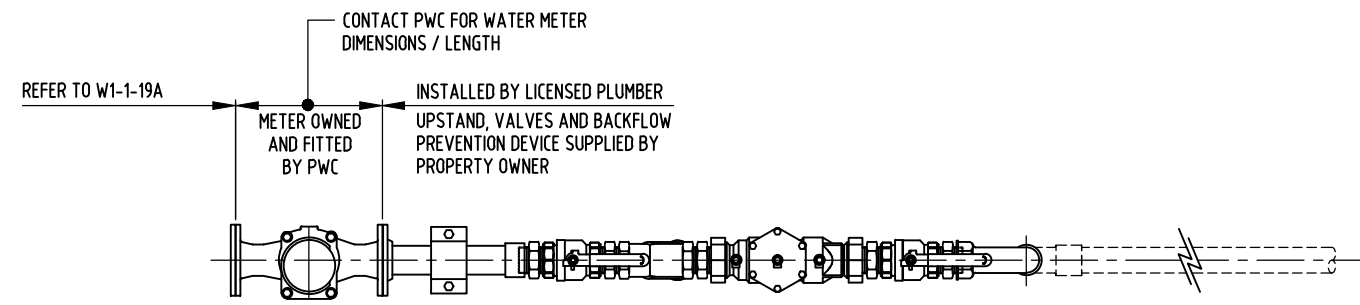

PLAN

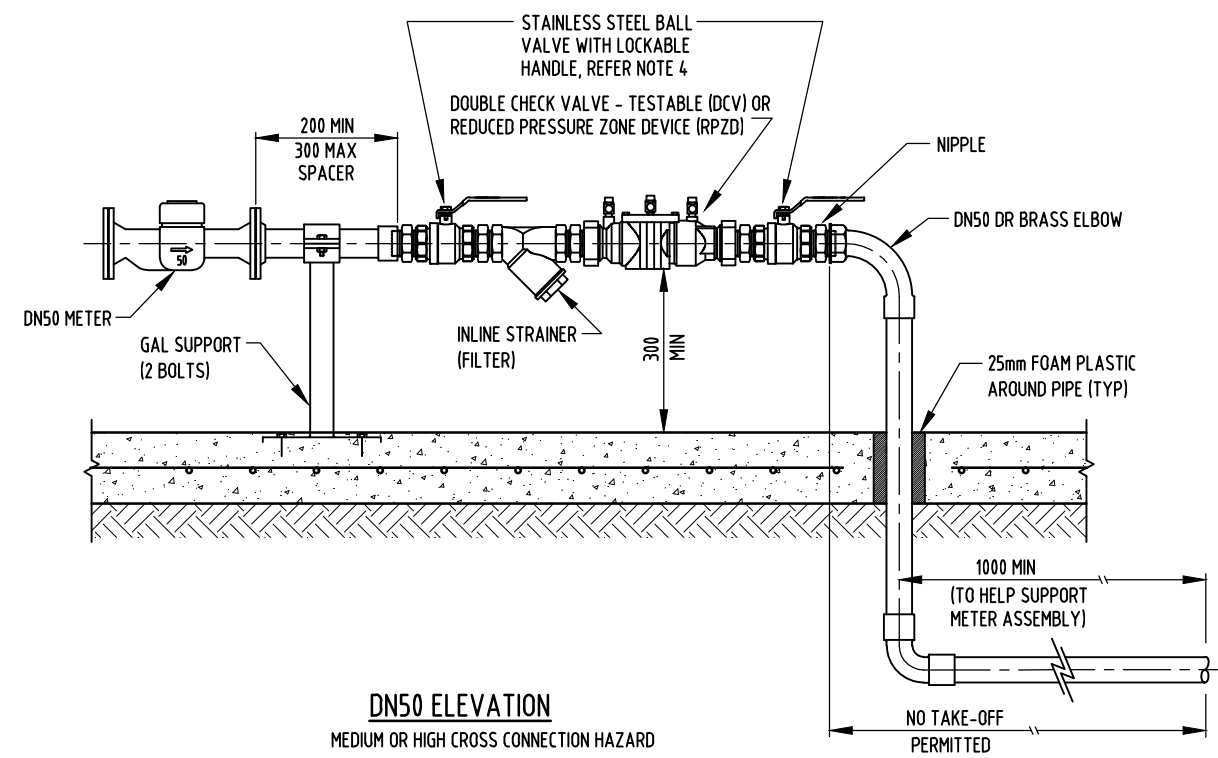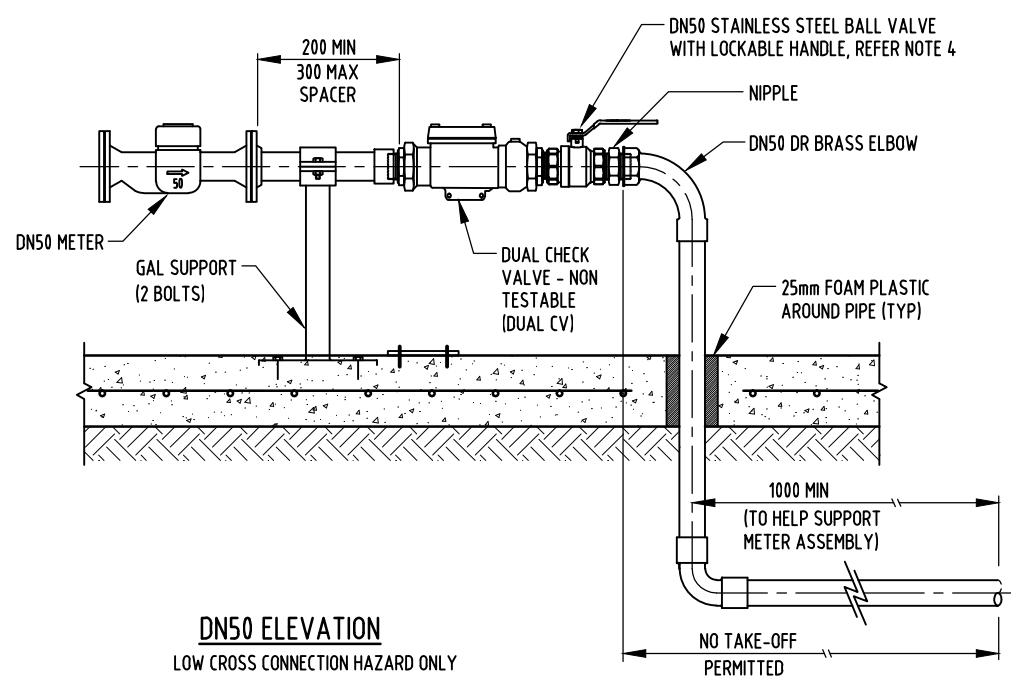

NOTES:

1. A BACKFLOW CERTIFIED PLUMBER IS REQUIRED TO DETERMINE THE RISK OF CONTAMINATION OF THE POTABLE WATER SUPPLY DUE TO CROSS CONNECTIONS - REFER AS/NZS 3500.1.
2. BOLTS, WASHERS, NUTS AND GASKETS FOR WATER METER INSTALLATION SUPPLIED BY PWC.
3. WHERE A REGISTERED AIR GAP (RAG) OR REGISTERED BREAK TANK (RBT) IS PROPOSED IN LIEU OF A TESTABLE BACKFLOW PREVENTION DEVICE, DISCUSS REQUIREMENTS WITH PWC
4. VALVE TO BE ABLE TO BE LOCKED IN OPEN POSITION.

3	GENERAL AMENDMENTS 2020.	PW	JULY'20	JR	DC
2	REDRAWN ON AUTOCAD.	AW	JUN'18	JR	DC
1	NOTES UPDATED.	AW	JAN'16	RJ	RJ
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					



DES	RJ	WATER STANDARD DRAWING	
DRN	RI	SERVICES	
CHK	MS	DUAL DN100/150 (FIRE SERVICE)	
APPD	JP	& DN50 METER CONNECTIONS	
SCALE	N.T.S.	A3	DRAWING NUMBER
ISSUED	NOV'08		
ALL DIM. IN mm			3
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY	
		AMDT	