
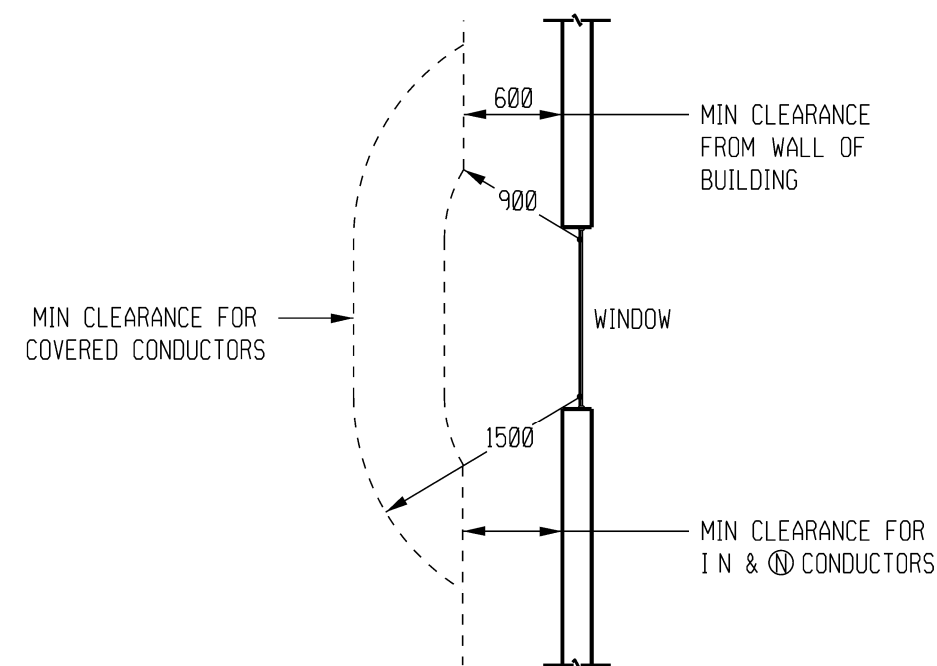


COVER DESIGNATIONS	
C	COVERED CONDUCTOR
I	INSULATED CONDUCTOR (XLPE CABLES)
N	NUETRAL CONDUCTOR
N	NUETRAL SCREENED CABLE

CONDITIONS FOR LINES PASSING WINDOWS





CONDITIONS FOR LINES PASSING UNROOFED BALCONIES

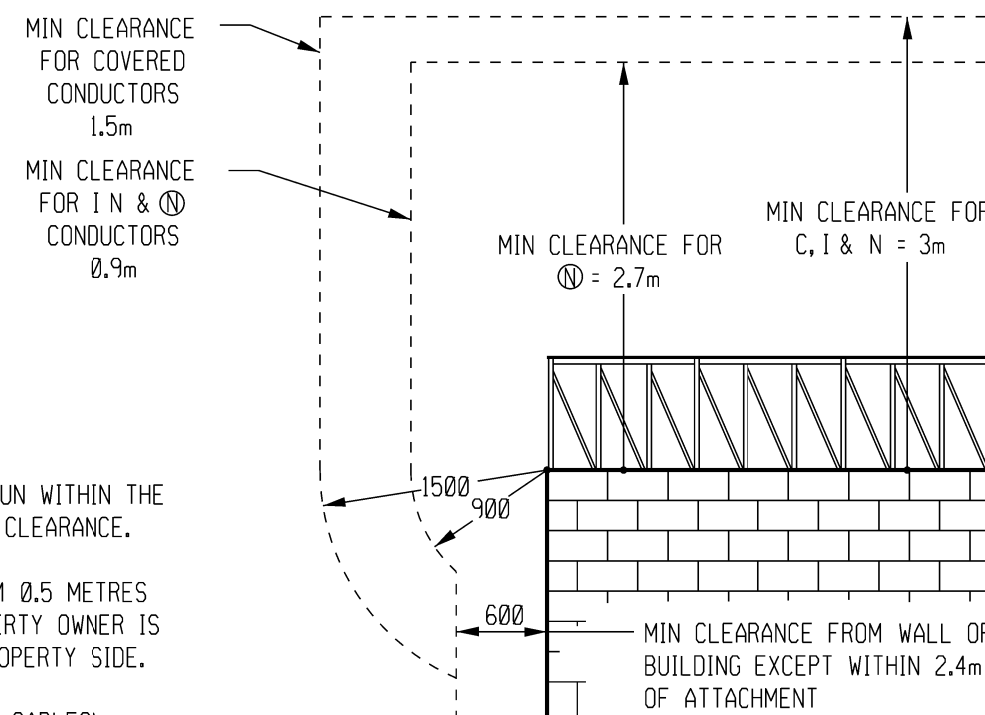

NOTES:

- CLEARANCES SHOWN ARE THE MINIMUM REQUIREMENTS AT THE WORST CONDITIONS OF TEMPERATURE AND CONDUCTOR SWING. SPECIAL CONSIDERATION SHOULD BE GIVEN TO CLEARANCES OVER DRIVEWAYS FOR HEAVY VEHICLES.
- THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH AS 7000, PWC NP 007 SERVICE RULES AND PWC NP 003 INSTALLATION RULES.
- MINIMUM CLEARANCE OVER MINOR HIGHWAYS (ARTERIAL/SECONDARY MAJOR ROADS) IS 6.3 m. MAJOR HIGHWAY (NATIONAL HIGHWAY) CROSSINGS TO BE UNDER GROUND.
- OVERHEAD SERVICE DISTANCE MUST NOT EXCEED 40 METRES, RUN WITHIN THE DESIGN TENSION LIMITS, AND MAINTAIN THE REQUIRED GROUND CLEARANCE.
- SERVICE CABLE ON PRIVATE PROPERTY MUST BE KEPT MINIMUM 0.5 METRES FROM TREES AND OTHER VEGETATION IN ALL DIRECTION. PROPERTY OWNER IS RESPONSIBLE FOR MAINTAINING VEGETATION CLEARANCE ON PROPERTY SIDE.
- CURRENT STANDARD CABLE IS 'I', INSULATED CONDUCTOR (XLPE CABLES). REFER TO DWG S01-01-07-03.

						 N O R T H E R N T E R R I T O R Y		DES -		POWER STANDARD DRAWING			
								DRN R. INNES		DESIGN DATA CLEARANCES LV OVERHEAD - SERVICE LINES			
								CKD M. BOCK					
								APPD F. ROBSON					
								SCALE NO SCALE					
								ISSUED APR'01		A3	DRAWING NUMBER S01-04-01-01		 AMD
								ALL DIM. IN mm					
						DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY					

PowerWater
NORTHERN TERRITORY

6	NOTES 2 & 3 AMENDED. NOTES 4, 5, & 6 ADDED. COVER DESIGNATIONS UPDATED. DRAWING LABELS UPDATED.	P.BH.	JUN'23	B.V.	B.C.
5	TITLEBLOCK & DRAWING NUMBER FORMATTED	K.T.	APR'19	C.C.	C.C.
4	NOTE 3 UPDATED	C.C.	NOV'11	A.T.	S.C.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					