

Water Supply and Sewerage Approved Products Manual - February 2006

Water Supply – PVC Pipeline System

Section WPS 02

SPECIFICATIONS		A
	WPS 02-S1 SPIGOT-SOCKET PVC-U PIPES	A
	WPS 02-S2 SPIGOT-SOCKET PVC-M PIPES	B
	WPS 02-S3 DUCTILE IRON FITTINGS	C
	WPS 02-S4 JOINT SEALS	D
	WPS 02-S5 BACTERICIDAL JOINTING LUBRICANT	E
	WPS 02-S6 SOLVENT CEMENTING	F
	WPS 02-7 SPIGOT-SOCKET PVC-O PIPES	G
PIPES		1
	SPIGOT-SOCKET RRJ PIPES - SERIES 1	1
	CLASS PN 9	1
	CLASS PN 12	1
	CLASS PN 15	1
	CLASS PN 18	1
	SPIGOT-SOCKET RRJ PIPES - SERIES 2	2
	CLASS PN 12	2
	CLASS PN 16	2
	CLASS PN 20	2
	SPIGOT-SOCKET SCJ PIPES - SERIES 1	3
	CLASS PN 9	3
	CLASS PN 12	3
	CLASS PN 15	3
	CLASS PN 18	3
DI BENDS		4
	SOCKET-SOCKET BENDS	4
	HYDRANT BENDS	4
	SOCKET-FLANGE WASHOUT BENDS	5
DI TEES		6
	SOCKET-SOCKET-SOCKET TEES	6
	SOCKET-SOCKET-FLANGE SCOUR TEES	6
	SOCKET-SOCKET-FLANGE TEES	7
DI TAPERS		8
	SOCKET-SOCKET TAPERS	8
	SOCKET-FLANGE TAPERS	9
DI CONNECTORS		9
	FLANGE-SOCKET CONNECTORS	9
	SOCKET-SOCKET CONNECTORS	10
	SOCKET-SOCKET PRE-TAPPED CONNECTORS	10
	SOCKET-SOCKET-FLANGE PRE-TAPPED HYDRANT TEES	11
	SOCKET-SOCKET SLIP COLLARS	11
END SEALS		12
	CAPS	12
RISERS		13
	FLANGE-FLANGE RISERS	13
JOINT SEALS		14
	PVC SPIGOT TO PVC SOCKET ELASTOMERIC SEALS	14

PVC SPIGOT TO DI SOCKET ELASTOMERIC SEALS	14
FLANGE ELASTOMERIC SEALS	14
BACTERICIDAL JOINTING LUBRICANT	14
SOLVENT CEMENTING	15
SOLVENT CEMENT	15
PRIMING FLUID	15
EXTERNAL CORROSION PROTECTION FOR DI FITTINGS	16

WPS 02-S1 SPIGOT-SOCKET PVC-U PIPES

STANDARD	AS/NZS 1477:1999 PVC pipes and fittings for pressure applications
DESIGN	Unplasticised PVC pressure pipes (PVC-U or uPVC) have a plain (solid) wall structure and are manufactured in two standard sizings. Up to and including DN150, Power and Water exclusively uses Series 1 pipe, which conforms to the metric sizing in international piping standards. For DN200 to DN375, Power and Water has changed from Series 1 to Series 2 pipe series (Cast Iron Outside Diameter [CIOD]) sizing. Pipe wall thickness is varied to achieve the desired pipe pressure rating. Pressure ratings are determined at 20°C. Pressure derating is required for higher operating temperatures. Pressure de-rating is required to cater for fatigue issues where fluctuating pressures occur (ie. pumped systems) – refer WSAA Technical Notes TN4 and TN5.
MATERIALS	<p>Pipe: Polyvinyl chloride (83.3 % minimum) Calcium-zinc to prevent PVC degradation from high processing temperatures Lubricants to lower the viscosity of molten PVC during pipe processing Fillers, e.g. calcium carbonate, to aid pipe processing Rutile titanium dioxide to prevent ultraviolet degradation and to provide white colouring pigment for series 1 pipe (1.5 parts minimum per 100 parts PVC).</p> <p>Joint seal: Approved elastomer to AS 1646.1 and 1646.2 or 1646.3</p>
JOINTING	Rubber ring joints are to be used unless otherwise permitted. Sockets are to have grooves to capture elastomeric seals. Seal profiles are to manufacturers' proprietary designs. Spigots are to have witness marks to identify socket insertion depth.
EFFECTIVE LENGTH	6 m (+0.05, -0 m)
PRESSURE CLASSES	PN9, PN12, PN15, PN16, PN18 and PN20 correspond to 0.9, 1.2, 1.5, 1.6, 1.8 and 2.0 MPa working pressure
COLOUR	Series 1 pipe shall be white. Series 2 pipe shall be blue
MARKINGS	<p>Manufacturer's name and registered trademark The pipe series number '1' for metric pipe series or '2' for CIOD pipe series The letters 'PVC-U' Nominal size in the form '100', as appropriate Classification in the form 'PN 12', as appropriate For pipes designed with deflection joints, the maximum allowable angular deflection in degrees Date of manufacture, using the ISO system in the form YYMMDD Identification of place of manufacture. The manufacturer's code is acceptable The Australian Standard number, i.e. AS/NZS 1477 Product certification mark, e.g. StandardsMark</p>
MARKING METHOD	Legible and durable marking along the pipe barrel, minimum lettering height of 3 mm for DN 100 and 5 mm for greater than DN 100. Unmarked pipe length not to exceed 1 m.
USE LIMITS	<p>Do not use PVC-U for new works in sizes greater than DN 225 Do not use solvent cement jointing except for unusual requirements Do use solvent cement jointing with pipes larger than DN150 and do not use with Series 2 pipe Do not use in ground subject to extreme movement where joint pull-out could occur Do not use above ground or in ground contaminated with chemicals deleterious to PVC Do not use pipe stored unshaded for 6 months or more from date of manufacture Do not use pipe older than 12 months from the date of manufacture Do not use pipe scratched to a depth greater than 0.5 mm (or 10% of wall thickness for sizes smaller than DN80)</p>

WPS 02-S2 SPIGOT-SOCKET PVC-M PIPES

STANDARD	AS/NZS 4765 (Int):2000 Modified PVC (PVC-M) pipes for pressure applications
DESIGN	Modified PVC (PVC-M) differs from traditional unplasticised PVC (PVC-U or uPVC) by way of an elastomer additive of quantity sufficient to improve toughness without excessive yield strength reduction. Improved toughness and performance predictability allows the pressure rating design factor for PVC-M pipe to be less than that for PVC-U pipe. PVC-M pipe of the same pressure rating as PVC-U pipe thus has a thinner wall (and lower stiffness). PVC-M pipes have a plain (solid) wall structure. Up to and including DN150, Power and Water exclusively uses Series 1 pipe, which conforms to the metric sizing in international piping standards. For DN200 to DN375, Power and Water has changed from Series 1 to Series 2 pipe series (Cast Iron Outside Diameter [CIOD]) sizing. Pipe wall thickness is varied to achieve the desired pipe pressure rating. Pressure ratings are determined at 20°C. Pressure derating is required for higher operating temperatures. Pressure de-rating is required to cater for fatigue issues where fluctuating pressures occur (ie. pumped systems) – refer WSAA Technical Notes TN4 and TN5.
MATERIALS	<p>Pipe: Polyvinyl chloride (83.3 % minimum) Elastomer to improve ductility (fracture toughness) Rutile titanium dioxide to prevent ultraviolet degradation (minimum of 1.5 parts per 100 parts PVC mass) Calcium-zinc to prevent PVC degradation from high processing temperatures Lubricants to lower the viscosity of molten PVC during pipe processing Fillers, e.g. calcium carbonate, to aid pipe processing</p> <p>Joint seal: Approved elastomer to: AS 1646.1 and 1646.2 or 1646.3</p>
JOINTING	Only rubber ring joints are permitted. Sockets are to have grooves to capture seals. Spigots are to have witness marks to identify socket insertion depth.
EFFECTIVE LENGTH	6 m (+0.05, -0 m)
PRESSURE CLASSES	PN9, PN12, PN15, PN16, PN18 and PN20 correspond to 0.9, 1.2, 1.5, 1.6, 1.8 and 2.0 MPa working pressure
COLOUR	Series 1 pipe shall be white. Series 2 pipe shall be blue
MARKINGS	<p><i>Product code (e.g. PPRW 12225)</i> Manufacturer's name and registered trademark <i>Trade name (e.g. White Rhino) - OPTIONAL</i> The pipe series number '1' for metric pipe series or '2' for CIOD pipe series The letters 'PVC-M' Nominal size in the form '100', as appropriate Classification in the form 'PN 12', as appropriate For pipes designed with deflection joints, the maximum allowable angular deflection in degrees Date of manufacture, using the ISO system in the form YYMMDD <i>Time of manufacture - OPTIONAL</i> Identification of place of manufacture. The manufacturer's code is acceptable The Australian Standard number, i.e. AS/NZS 4765(Int)</p>
MARKING METHOD	Legible and durable marking along the pipe barrel, minimum lettering height of 5 mm. Unmarked pipe length not to exceed 1 m.
USE LIMITS	<p>Solvent cement joint PVC-M pipes not permitted Do not use in ground subject to extreme movement where joint pull-out could occur Do not use above ground or in ground contaminated with chemicals deleterious to PVC Do not use pipe stored unshaded for 6 months or more from date of manufacture Do not use pipe older than 12 months from the date of manufacture Do not use pipe scratched to a depth greater than 0.25 mm Do not use PVC-M pipes for new works in sizes greater than DN225 unless specific project approval has been granted by the Water Engineering section of Power and Water</p>

WPS 02-S3 DUCTILE IRON FITTINGS

STANDARD	AS/NZS 2280:2004 Ductile iron pressure pipes and fittings AS/NZS 4087:2004 Metallic Flanges for waterworks purposes
DESIGN	Ductile iron fittings to the Australian Standard have dimensions based on imperial sizing.
MATERIALS	<p>Fitting: Spheroidal graphite cast iron to AS 1831 (commonly known as ductile iron) – manufactured from scrap ductile iron, steel, ferrosilicon, coke, limestone and magnesium</p> <p>Internal lining: Thermal bonded polymer to AS/NZS 4158</p> <p>External coating: Thermal bonded polymer to AS/NZS 4158 Other coatings may be considered</p> <p>Joint seal: Elastomer to AS 1646</p>
JOINTING	<p>Socket: Sockets with grooves to capture elastomeric seals. Sockets and seals of proprietary designs (e.g. Tyton/Plastyt, Nortite) to connect with metric series PVC pipe. Allowable minimum joint deflections of 3.5° for DN 100-250 and 2.5° for DN 300-375. Jointing lugs on 90° and 45° bends for sizes DN 200 and greater.</p> <p>Spigot: End to be chamfered over 10 to 20 mm at approximately 20° to pipe barrel. Jointing lugs on 90° and 45° bends for sizes DN 200 and greater.</p> <p>Flange: Integral flanges to AS 4087 figure B5 for PN16 and figure B6 for PN35. 1.5mm and 3mm flat elastomeric full face gasket to AS 4087 for PN16 and PN35 - Appendix C, Table C1</p>
ALLOWABLE OPERATING PRESSURE	<p>PN16: 1.6 MPa</p> <p>PN35: 3.5 MPa</p>
MARKINGS	<p>Manufacturer's name or mark cast on</p> <p>Nominal size</p> <p>Ductile or DI moulded in raised form</p> <p>Where applicable, the angle of the bend cast on</p> <p>The standard designation AS/NZS 2280</p> <p>Product certification mark, e.g. StandardsMark</p> <p>Traceability code</p>
MARKING METHOD	Clearly & indelibly marked on the fitting. Lettering size & cast height not specified in AS/NZS 2280.

WPS 02-S4 JOINT SEALS

STANDARD	AS 1646: 2000 Elastomeric seals for waterworks purposes AS 4087: 2004 Metallic flanges for waterworks purposes
SEALING DESIGN	Joint seals are to be of elastomeric compounds comprising suitable polymers. The elastomers have performance properties which deteriorate with time and as such the design of the seal's profile and the compounding of the elastomer needs to ensure long term sealing of the joint. The elastomer properties affecting long term sealing performance are hardness, rate of compression stress relaxation, water absorption, resistance to ageing, resistance to chemicals and resistance to microbiological deterioration.
COMPOUND MATERIALS	<p>Polymer for spigot-socket rings: Ethylene propylene diene monomer (EPDM), 40% minimum volume of compound for IRHD of $\geq 55 < 85$ Natural rubber (NR), 60% min volume of compound for IRHD of $\geq 55 < 85$ Styrene Butadiene Rubber (SBR), 50% min volume of compound for IRHD of $\geq 55 < 85$</p> <p>Polymer for flange gaskets: Ethylene propylene diene monomer (EPDM), 30% min volume of compound for IRHD of $\geq 35 < 55$ or 40% min volume of compound for IRHD $\geq 55 \leq 65$ Natural rubber (NR), 70% minimum volume of compound for IRHD $\geq 35 < 55$ or 60% minimum volume of compound for IRHD $\geq 55 \leq 65$</p> <p>Antidegradant: For EPDM: Not required For NR/SBR: Based on the combined antioxidant-antiozonant N-(1,3-dimethyl-butyl)-N'-phenyl-p-phenylene diamine with a concentration (m/m) of not less than 1.5 parts per hundred of polymer.</p> <p>Protective wax: For EPDM: Not required For NR/SBR: Wax with a melting point of not less than 57°C and concentration (m/m) not greater than 3.0 parts per hundred of polymer.</p> <p>Filler: Carbon black</p> <p>Copper & manganese: For EPDM: Not applicable For NR/SBR: Not greater than 0.0008% copper and 0.0005% manganese</p>
MARKINGS	Rings: Manufacturer's identification mark Cavity number, if applicable Nominal size or nominal internal and cord diameters as appropriate Year of manufacture, e.g. 01 to represent year 2001 Standard designation where the elastomeric ring is certified to AS 1646.
MARKING METHODS	Embossing with lettering 3 ± 1 mm high and 0.3 ± 0.1 mm proud of the surface; or Vulcanised transfer or permanent ink with lettering 3.5 ± 1.5 mm.
ELASTOMER TYPE IDENTIFICATION	Marking colour: EPDM: Green, NR: Plain or white, SBR: Blue Marking method: Continuous durable stripe of width 3.5 ± 1.5 mm; or Durable flash or dot of 6 mm minimum dimension
STORAGE	<ul style="list-style-type: none"> • Do not store seals in a room with any equipment capable of generating ozone (e.g. mercury vapour lamps, electric motors, high voltage equipment) • Store in a relaxed condition free from tension, compression or other deformation • Storage temperature not to exceed 35°C and preferably not above 15°C or less than 5°C • Natural rubber seals not to be continuously exposed to direct sunlight • For prolonged storage (in excess of 3 months), enclose or wrap seals in an opaque material so as to prevent free access of air and to prevent UV damage (refer ISO2230)
USE LIMITS	Do not use elastomeric seals removed from packaging for more than 3 months Do not use elastomeric seals older than 18 months from date of manufacture unless supplier can demonstrate that seals have been stored in a cool, controlled environment Do not use NR or SBR elastomeric seals older than 3 years from date of manufacture Do not use EPDM elastomeric seals older than 6 years from date of manufacture Do not use NR/SBR seals that have been stored unprotected from sunlight for more than 7 days Do not use elastomeric seals that have been in contact with chemicals, e.g. solvents (petrol).

WPS 02-S5 BACTERICIDAL JOINTING LUBRICANT

STANDARD	AS/NZS 4020: 2005 Testing of products for use in contact with drinking water (in part)
DESIGN	Jointing lubricant is required to achieve the following: <ul style="list-style-type: none">• Provide sufficient lubrication to prevent damage to joint seals or surfaces on jointing.• Enable correctly configured jointing when using jointing methods recommended by the pipe or fitting manufacturer.• Not affect the elastomer or pipe or fitting materials.• Not cause unacceptable effects on quality of potable water.• Kill bacteria introduced into the system during the jointing operation.• Remain an effective lubricant under wet conditions.• Not be hazardous to handle and be able to be applied by hand.• Be completely soluble in water.• Be able to be removed under standard flushing arrangements for commissioning.
MATERIALS	Lubricant: Water based emulsion Bactericide: As approved (proprietary information)
CONTAINER MARKINGS	Manufacturer's name or trademark Proprietary name of joint seal with which the lubricant can be used. The words 'Jointing Lubricant' or 'Joint Lubricant'. Date of manufacture. Date of expiry for use. The specification to which it complies. The WaterMark or other mark to certify compliance with the specification. Instructions for use of lubricant.
USE LIMITS	Do not use where past expiry date.

WPS 02-S6 SOLVENT CEMENTING

STANDARD	AS: 3879: 1995	Solvent cements and priming fluids for use with unplasticized PVC (PVC-U) pipes and fittings
DESIGN	Solvent cement:	The solvent in the cement softens and swells a layer of the PVC on the spigot and socket mating surfaces and these layers combine with the PVC already in the solvent cement to create a bond on drying of the solvent.
	Priming fluid:	The priming fluid cleans the joint mating surfaces of dirt, oil and other contamination prior to application of the solvent cement and removes the surface sheen on the PVC to aid action of the solvent cement.
MATERIALS	Solvent cement:	Consists of one or more solvents and a sufficient quantity of base PVC material dissolved in the solvent/s to give the cement the body and consistency required for proper application. Small amounts of inert fillers are sometimes added to control shrinkage during drying. The principal solvent used is tetrahydrofuran (THF).
	Priming fluid:	
CONTAINER MARKINGS	Manufacturer's name Marking 'Type P' to indicate solvent cement for pressure applications. Net mass or volume Date of manufacture Recommended storage life Instructions for storage and use The statement 'Priming fluids shall be used to prepare the jointing surface prior to solvent cement application.' A statement of any toxic vapour or flammability hazards associated with the solvent cement or priming fluid. The statement ' No additives of any kind shall be mixed with this solvent cement/priming fluid.' (as applicable) The number of the Australian Standard, i.e. AS/NZS 3879	
COLOUR	Solvent cement:	Green for pressure applications.
	Priming fluid:	Pink or red
USE LIMITS	Clear solvent cement is not permitted Solvent cement jointing is permitted only for unusual requirements. Do not use solvent cement where 12 months past the date on the container.	

WPS 02-7 SPIGOT-SOCKET PVC-O PIPES

STANDARD

AS/NZS 4441 (Int):2003 Oriented PVC (PVC-O) pipes for pressure applications

**UNDER
DEVELOPMENT**

SPIGOT-SOCKET RRJ PIPES - SERIES 1



CLASS PN 9

Nominal size DN	Iplex (PVC-U)	Iplex (PVC-M)	Iplex (PVC-M) Rieber Joint	Tyco (PVC-U) Plas-flo	Tyco (PVC-M) Tuf-flo	Vinidex (PVC-M)
80	✓			✓		
100		✓			✓	✓
150			✓		✓	✓
200			✓		✓	
225			✓		✓	
250			✓		✓ 1	
300			✓ 1		✓ 1	
375			✓ 1		✓ 1	

CLASS PN 12

Nominal size DN	Iplex (PVC-U)	Iplex (PVC-M)	Iplex (PVC-M) Rieber Joint	Tyco (PVC-U) Plas-flo	Tyco (PVC-M) Tuf-flo	Vinidex (PVC-M)
80	✓			✓		
100		✓			✓	✓
150			✓		✓	✓
200			✓		✓	
225			✓		✓	
250			✓		✓ 1	
300			✓ 1		✓ 1	
375			✓ 1		✓ 1,2	

CLASS PN 15

Nominal size DN	Iplex (PVC-U)	Iplex (PVC-M)	Iplex (PVC-M) Rieber Joint
80	✓		
100		✓	
150			✓
200			
225			
250			
300			
375			

CLASS PN 18

Nominal size DN	Iplex (PVC-U)	Iplex (PVC-M)	Iplex (PVC-M) Rieber Joint
80	✓		
100		✓	
150			✓
200			
225			
250			
300			
375			

NOTES:

1. Project approval necessary (refer to Water Engineering section of Power and Water)
2. Not readily available

SPIGOT-SOCKET RRJ PIPES - SERIES 2



CLASS PN 12

Nominal size DN	Iplex (PVC-M) Rieber Joint	Tyco (PVC-M)	Vinidex (PVC-M)
200	✓	✓	✓
225	✓	✓	✓
250	✓ 1		✓ 1
300	✓ 1		✓ 1
375	✓ 1		✓ 1

CLASS PN 16

Nominal size DN	Iplex (PVC-M) Rieber Joint	Tyco (PVC-M)	Vinidex (PVC-M)
200	✓	✓	✓
225	✓	✓	✓
250	✓ 1		✓ 1
300	✓ 1		✓ 1
375	✓ 1		✓ 1

CLASS PN 20

Nominal size DN	Iplex (PVC-M) Rieber Joint
200	✓
225	✓
250	✓ 1
300	✓ 1
375	✓ 1

NOTES:

1. Project approval necessary (refer to Water Engineering section of Power and Water)

SPIGOT-SOCKET SCJ PIPES - SERIES 1
 (Only permitted for unusual requirements)



CLASS PN 9

Nominal size DN	Iplex (PVC-U)	Tyco (PVC-U)
80	✓	✓
100	✓	✓
150	✓	✓

CLASS PN 12

Nominal size DN	Iplex (PVC-U)	Tyco (PVC-U)
80	✓	✓
100	✓	✓
150	✓	✓


CLASS PN 15

Nominal size DN
80
100
150

CLASS PN 18

Nominal size DN	Iplex (PVC-U)
80	✓
100	✓
150	✓

SOCKET-SOCKET BENDS




Nominal Size DN x Degrees	Mallet	Tyco Water	Tyco Water Auslite ¹	Derwent	Dobbie Dico
100 x 11.25	✓	✓	✓	✓	✓
100 x 22.5	✓	✓	✓	✓	✓
100 x 45	✓	✓	✓	✓	✓
100 x 90	✓	✓	✓	✓	✓
150 x 11.25	✓	✓	✓	✓	✓
150 x 22.5	✓	✓	✓	✓	✓
150 x 45	✓	✓	✓	✓	✓
150 x 90	✓	✓	✓	✓	✓
200 x 11.25	✓	✓		✓	✓
200 x 22.5	✓	✓		✓	✓
200 x 45	✓	✓		✓	✓
200 x 90	✓	✓		✓	✓
225 x 11.25	✓	✓		✓	
225 x 22.5	✓	✓		✓	
225 x 45	✓	✓		✓	
225 x 90	✓	✓		✓	
250 x 11.25	✓	✓		✓	✓
250 x 22.5	✓	✓		✓	✓
250 x 45	✓	✓		✓	✓
250 x 90	✓	✓		✓	✓
300 x 11.25	✓	✓		✓	
300 x 22.5	✓	✓		✓	
300 x 45	✓	✓		✓	
300 x 90	✓	✓		✓	
375 x 11.25	✓	✓		✓	
375 x 22.5	✓	✓		✓	
375 x 45	✓	✓		✓	
375 x 90	✓	✓		✓	

NOTES

1. Auslite fittings available in PN16 rating only

HYDRANT BENDS




Nominal Size DN	Tyco Water	Dobbie Dico ¹
100 x 80	I	✓
150 x 80	I	

I = Interim approval

NOTES

1. Dobbie Dico fittings available in PN16 rating only

SOCKET-FLANGE WASHOUT BENDS




Nominal Size DN x Degrees	Tyco Water	Tyco Water Auslite ¹	Dobbie Dico ¹
100 x 90	I	✓	✓
150 x 90	I		

I = Interim approval

NOTES

1. Auslite and Dobbie Dico fittings available in PN16 rating only

SOCKET-SOCKET-SOCKET TEES



Nominal Sizes DN x DN x dn	Mallet	Tyco Water	Tyco Water Auslite ¹	Derwent	Dobbie Dico
100 x 100 x 100	✓	✓	✓	✓	✓
150 x 150 x 100	✓	✓	✓	✓	✓
150 x 150 x 150	✓	✓	✓	✓	✓
200 x 200 x 100	✓	✓		✓	✓
200 x 200 x 150	✓	✓		✓	✓
200 x 200 x 200	✓	✓		✓	✓
225 x 225 x 100	✓	✓		✓	
225 x 225 x 150	✓	✓		✓	
225 x 225 x 200	✓	✓		✓	
225 x 225 x 225	✓	✓		✓	
250 x 250 x 100	✓	✓		✓	✓
250 x 250 x 150	✓	✓		✓	✓
250 x 250 x 200	✓	✓		✓	✓
250 x 250 x 225	✓	✓		✓	✓
250 x 250 x 250	✓	✓		✓	
300 x 300 x 100	✓	✓		✓	
300 x 300 x 150	✓	✓		✓	
300 x 300 x 200	✓	✓		✓	
300 x 300 x 225	✓	✓		✓	
300 x 300 x 250	✓	✓		✓	
300 x 300 x 300	✓	✓		✓	
375 x 375 x 100	✓				
375 x 375 x 150	✓				
375 x 375 x 200	✓	✓		✓	
375 x 375 x 225	✓	✓		✓	
375 x 375 x 250	✓	✓		✓	
375 x 375 x 300	✓	✓		✓	
375 x 375 x 375	✓	✓		✓	

NOTES

1. Auslite fittings available in PN16 rating only

SOCKET-SOCKET-FLANGE SCOUR TEES




Nominal Size DN x DN x dn	Mallet ¹	Tyco Water	Derwent
150 x 150 x 80	✓	✓	✓
200 x 200 x 80	✓	✓	✓
225 x 225 x 100	✓	✓	✓
250 x 250 x 100	✓	✓	✓
300 x 300 x 100	✓	✓	✓
375 x 375 x 150	✓	✓	✓

NOTES

1. Mallet fittings available in PN16 rating only

SOCKET-SOCKET-FLANGE TEES




Nominal Size DN x DN x dn	Mallet ¹	Tyco Water	Tyco Water Auslite ¹	Derwent	Dobbie Dico ¹
100 x 100 x 80	✓	✓	✓	✓	✓
100 x 100 x 100	✓	✓	✓	✓	✓
150 x 150 x 80	✓	✓	✓	✓	✓
150 x 150 x 100	✓	✓	✓	✓	✓
150 x 150 x 150	✓	✓	✓	✓	
200 x 200 x 80	✓	✓		✓	✓
200 x 200 x 100	✓	✓		✓	✓
200 x 200 x 150	✓	✓		✓	✓
200 x 200 x 200	✓	✓		✓	
225 x 225 x 80	✓	✓		✓	
225 x 225 x 100	✓	✓		✓	
225 x 225 x 150	✓	✓		✓	
225 x 225 x 200	✓	✓		✓	
225 x 225 x 225	✓	✓		✓	
250 x 250 x 80	✓	✓		✓	✓
250 x 250 x 100	✓	✓		✓	✓
250 x 250 x 150	✓	✓		✓	✓
250 x 250 x 200	✓	✓		✓	
250 x 250 x 225	✓	✓		✓	
250 x 250 x 250	✓	✓		✓	
300 x 300 x 80	✓	✓		✓	
300 x 300 x 100	✓	✓		✓	
300 x 300 x 150	✓	✓		✓	
300 x 300 x 200	✓	✓		✓	
300 x 300 x 225	✓	✓		✓	
300 x 300 x 250	✓	✓		✓	
300 x 300 x 300	✓	✓		✓	
375 x 375 x 80	✓	✓		✓	
375 x 375 x 100	✓	✓		✓	
375 x 375 x 150	✓				
375 x 375 x 200	✓	✓		✓	
375 x 375 x 225	✓	✓		✓	
375 x 375 x 250	✓	✓		✓	
375 x 375 x 300	✓	✓		✓	
375 x 375 x 375	✓	✓		✓	

NOTES


1. Auslite, Dobbie Dico and Mallet fittings available in PN16 rating only

SOCKET-SOCKET TAPERS



Nominal Size DN x dn	Mallet	Tyco Water	Derwent	Dobbie Dico
100 x 80	✓	✓	✓	
150 x 80	✓	✓	✓	
150 x 100	✓	✓	✓	✓
200 x 100	✓	✓	✓	✓
200 x 150	✓	✓	✓	✓
225 x 100	✓	✓	✓	
225 x 150	✓	✓	✓	
225 x 200	✓	✓	✓	
250 x 100	✓	✓	✓	✓
250 x 150	✓	✓	✓	✓
250 x 200	✓	✓	✓	✓
250 x 225	✓	✓	✓	
300 x 100	✓	✓	✓	
300 x 150	✓	✓	✓	
300 x 200	✓	✓	✓	
300 x 225	✓	✓	✓	
300 x 250	✓	✓	✓	
375 x 200	✓	✓	✓	
375 x 225	✓	✓	✓	
375 x 250	✓	✓	✓	
375 X 300	✓	✓	✓	

SOCKET-FLANGE TAPERS




Nominal Size DN x dn	Mallet ¹	Tyco Water	Derwent
100 x 80	✓	✓	✓
150 x 80	✓	✓	✓
150 x 100	✓	✓	✓
200 x 100	✓	✓	✓
200 x 150	✓	✓	✓
225 x 100	✓	✓	✓
225 x 150	✓	✓	✓
225 x 200	✓	✓	✓
250 x 100	✓	✓	✓
250 x 150	✓	✓	✓
250 x 200	✓	✓	✓
250 x 225	✓	✓	✓
300 x 100	✓	✓	✓
300 x 150	✓	✓	✓
300 x 200	✓	✓	✓
300 x 225	✓	✓	✓
300 x 250	✓	✓	✓
375 x 200	✓	✓	✓
375 x 225	✓	✓	✓
375 x 250	✓	✓	✓
375 X 300	✓	✓	✓

NOTES

- Mallet fittings available in PN16 rating only


FLANGE-SOCKET CONNECTORS



Nominal Size DN	Mallet ¹	Tyco Water	Derwent	Tyco Water Auslite ¹	Dobbie Dico ¹
100	✓	✓	✓	✓	✓
150	✓	✓	✓	✓	✓
200	✓	✓	✓		✓
225	✓	✓	✓		
250	✓	✓	✓		✓
300	✓	✓	✓		
375	✓	✓	✓		


- NOTES
- Auslite, Dobbie Dico and Mallet fittings available in PN16 rating only

SOCKET-SOCKET CONNECTORS



Nominal Size DN	Mallet	Tyco Water	Derwent
100	✓	✓	✓
150	✓	✓	✓
200	✓	✓	✓
225	✓	✓	✓
250	✓	✓	✓
300	✓	✓	✓
375	✓	✓	✓


SOCKET-SOCKET PRE-TAPPED CONNECTORS

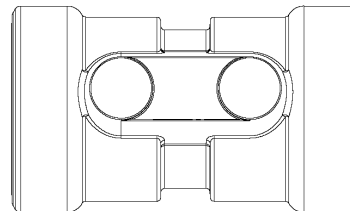

Nominal Size x Tapping Size x No of Tappings	Tyco Water	Tyco Water Auslite ¹	Derwent
100 x 20 x2			✓
100 x 20 x 4	✓	✓	✓
100 x 25 x 2			
100 x 25 x 4			
100 x 50 x 1	✓		
100 x 50 x 2			✓
150 x 20 x2			✓
150 x 20 x 4	✓	✓	✓
150 x 25 x 2			
150 x 25 x 4			
150 x 50 x 1	✓		
150 x 50 x 2			✓
200 x 20 x2			✓
200 x 50 x1	✓		
200 x 50 x2			✓
225 x 20 x2			✓
225 x 50 x1	✓		
225 x 50 x2			✓
250 x 20 x2			✓
250 x 50 x1	✓		
250 x 50 x2			✓
300 x 20 x2			✓
300 x 50 x1	✓		
300 x 50 x2			✓

NOTES 1. Auslite fittings available in PN16 rating only

**SOCKET-SOCKET-FLANGE
PRE-TAPPED HYDRANT TEES**

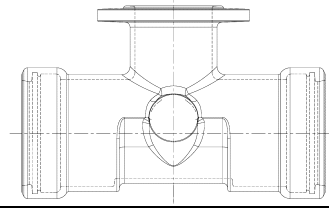


Nominal Size x Tapping Size x No of Tappings	Tyco Water Auslite ¹ (Hydratap)
1. 100 x 20 x2	✓
2. 150 x 20 x2	✓

NOTES

1. Auslite fittings available in PN16 rating only

SOCKET-SOCKET SLIP COLLARS



Nominal Size DN	Tyco Water (Sliptyt)
100	✓
150	✓

NOTES


1. Sliptyt offered only with thermal bonded polymeric encapsulation utilising polyamide(nylon) being Rilsan T Blue 7411 MAC

CAPS



Nominal Size DN	Mallet	Tyco Water	Derwent	Dobbie Dico
100	✓	✓	✓	✓
150	✓	✓	✓	✓
200	✓	✓	✓	✓
225	✓	✓	✓	
250	✓	✓	✓	✓
300	✓	✓	✓	
375	✓	✓	✓	

FLANGE-FLANGE RISERS



Nominal Size DN x Length	Mallet ¹	Tyco Water	Derwent	Tyco Water Auslite ¹	Dobbie Dico
80 x 100		✓	✓		✓
80 x 150	✓	✓	✓	✓	✓
80 x 225	✓	✓	✓	✓	✓
80 x 300	✓	✓	✓	✓	✓
80 x 375	✓	✓	✓		✓
80 x 450	✓	✓	✓		✓
80 x 525		✓	✓		
80 x 600	✓	✓	✓		
100 x 100		✓	✓		✓
100 x 150	✓	✓	✓		✓
100 x 225	✓	✓	✓		✓
100 x 300	✓	✓	✓	✓	✓
100 x 375	✓	✓	✓		
100 x 450	✓	✓	✓		✓
100 x 525		✓	✓		
100 x 600	✓	✓	✓		

NOTES 1. Auslite, Dobbie Dico and Mallet fittings available in PN16 rating only

**PVC SPIGOT TO PVC SOCKET
ELASTOMERIC SEALS**



Nominal Size DN	Iplex (Gulf & Hultec)	Vinidex (Gulf & Hultec)	Derwent (Gulf)	Dobbie Dico (Gulf)
100	✓	✓		
150	✓	✓		
200	✓	✓		
225	✓	✓		
250	✓	✓		
300	✓	✓		
375	✓	✓		

**PVC SPIGOT TO DI SOCKET
ELASTOMERIC SEALS**



Nominal Size DN	Mallet (Ludowici)	Tyco Water (Hultec)
80	✓	✓
100	✓	✓
150	✓	✓
200	✓	✓
225	✓	✓
250	✓	✓
300	✓	✓
375		✓

**FLANGE
ELASTOMERIC SEALS**




Nominal Size DN	Mallet	Tyco Water (SDQ)
80	✓	✓
100	✓	✓
150	✓	✓
200	✓	✓
225	✓	✓
250	✓	✓
300	✓	✓
375		

BACTERICIDAL JOINTING LUBRICANT




Lubricants Size	Iplex (Thomas Grozier)	Vinidex (IDL Chemicals)
10ml	✓	
500ml	✓	
1L	✓	✓
2L		✓
5L		✓

SOLVENT CEMENT
(type P – colour green)



Sizes	Iplex (Bostik)
125ml	✓
250ml	✓
500ml	✓
1L	✓
4L	

PRIMING FLUID
(colour pink or red)



Sizes	Iplex
250ml	✓
500ml	✓
1L	✓
4L	

**EXTERNAL CORROSION PROTECTION FOR DI FITTINGS
POLYETHYLENE SLEEVING & PETROLATUM SYSTEM
REFER TO SECTION WO 05 CORROSION PROTECTION**