


ELEVATION
Scale 1:40

SECTION
Scale 1:40

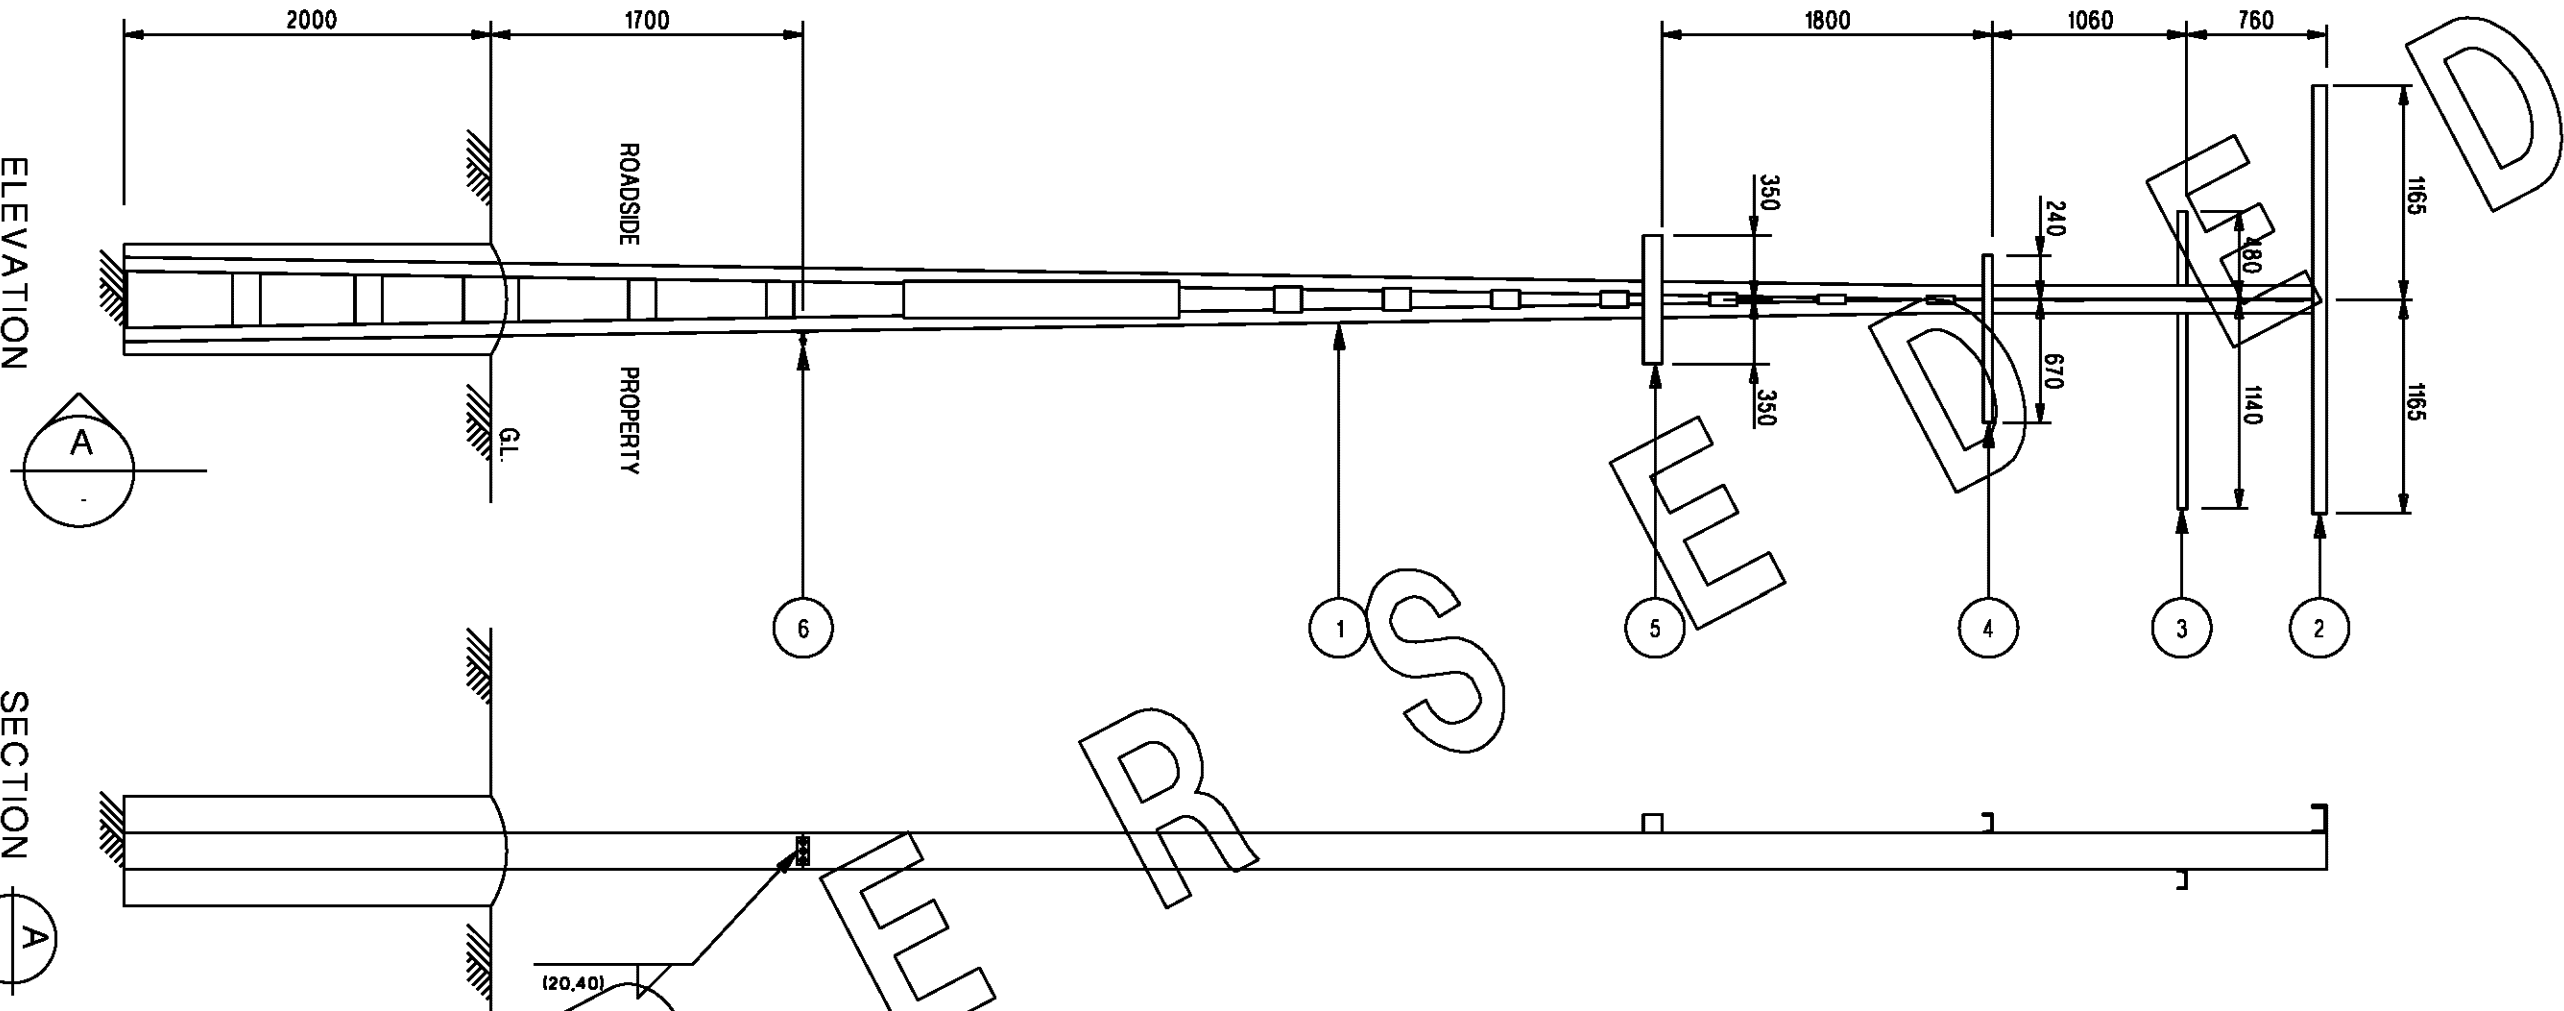

NOTES

1. ALL WELDING AND WELD PREPARATION SHALL BE IN ACCORDANCE WITH AS1554.
2. ALL CROSSARMS AND LOAD BEARING ATTACHMENTS SHALL BE FIXED TO THE POLE VIA A 6mm FILLET WELD ALL ROUND USING E41XX ELECTRODES UNO.
3. EARTH TEST LINK SHALL BE FIXED TO THE POLE BY INTERMITTENT 6mm FILLET WELDS (WELD 20, MISS 40) USING E316L STAINLESS STEEL ELECTRODES.

TAGNo	QTY	DESCRIPTION	STOCK CODE	DRG REF
6	1	EARTH TEST LINK	9142	S01-01-05-02
5	1	CROSSARM - TRANSFORMER MOUNTING	9290	S01-01-04-06
4	1	CROSSARM - HV METAL OXIDE SURGE DIVERTER	9365	S01-01-02-03
3	1	CROSSARM - HV EDO MOUNTING	250829	S01-01-02-03
2	1	CROSSARM - HV	-	S01-01-02-02
1	1	LINE POLE - 12C	11130	S01-01-01-02

MATERIAL SCHEDULE

NO	DESCRIPTION	DRN	DATE	CKD	APPD
6	SUPERSEDED	A.T.	DEC'12	B.C.	B.C.
5	EDO CROSSARM REPOSITIONED TO OTHER SIDE OF POLE	pmc	MAR'94	A.B.	C.H.Y.
4	REDRAWN. CROSSARM ARRANGEMENT MODIFIED.	gmck	OCT'92	N.S.	B.T.K.

AMENDMENTS



DES -	POWER STANDARD DRAWING		
DRN gmck	POLE STRUCTURES CAPACITOR BANK		
CKD N.Stubbs			
APPD B.T.Kent			
SCALE as shown			
ISSUED OCT'92	A3	DRAWING NUMBER	S01-02-05-10
ALL DIM. IN mm	DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY

