


FOR POTABLE WATER ONLY

NOT FOR USE WITH FIRE HOSE REELS

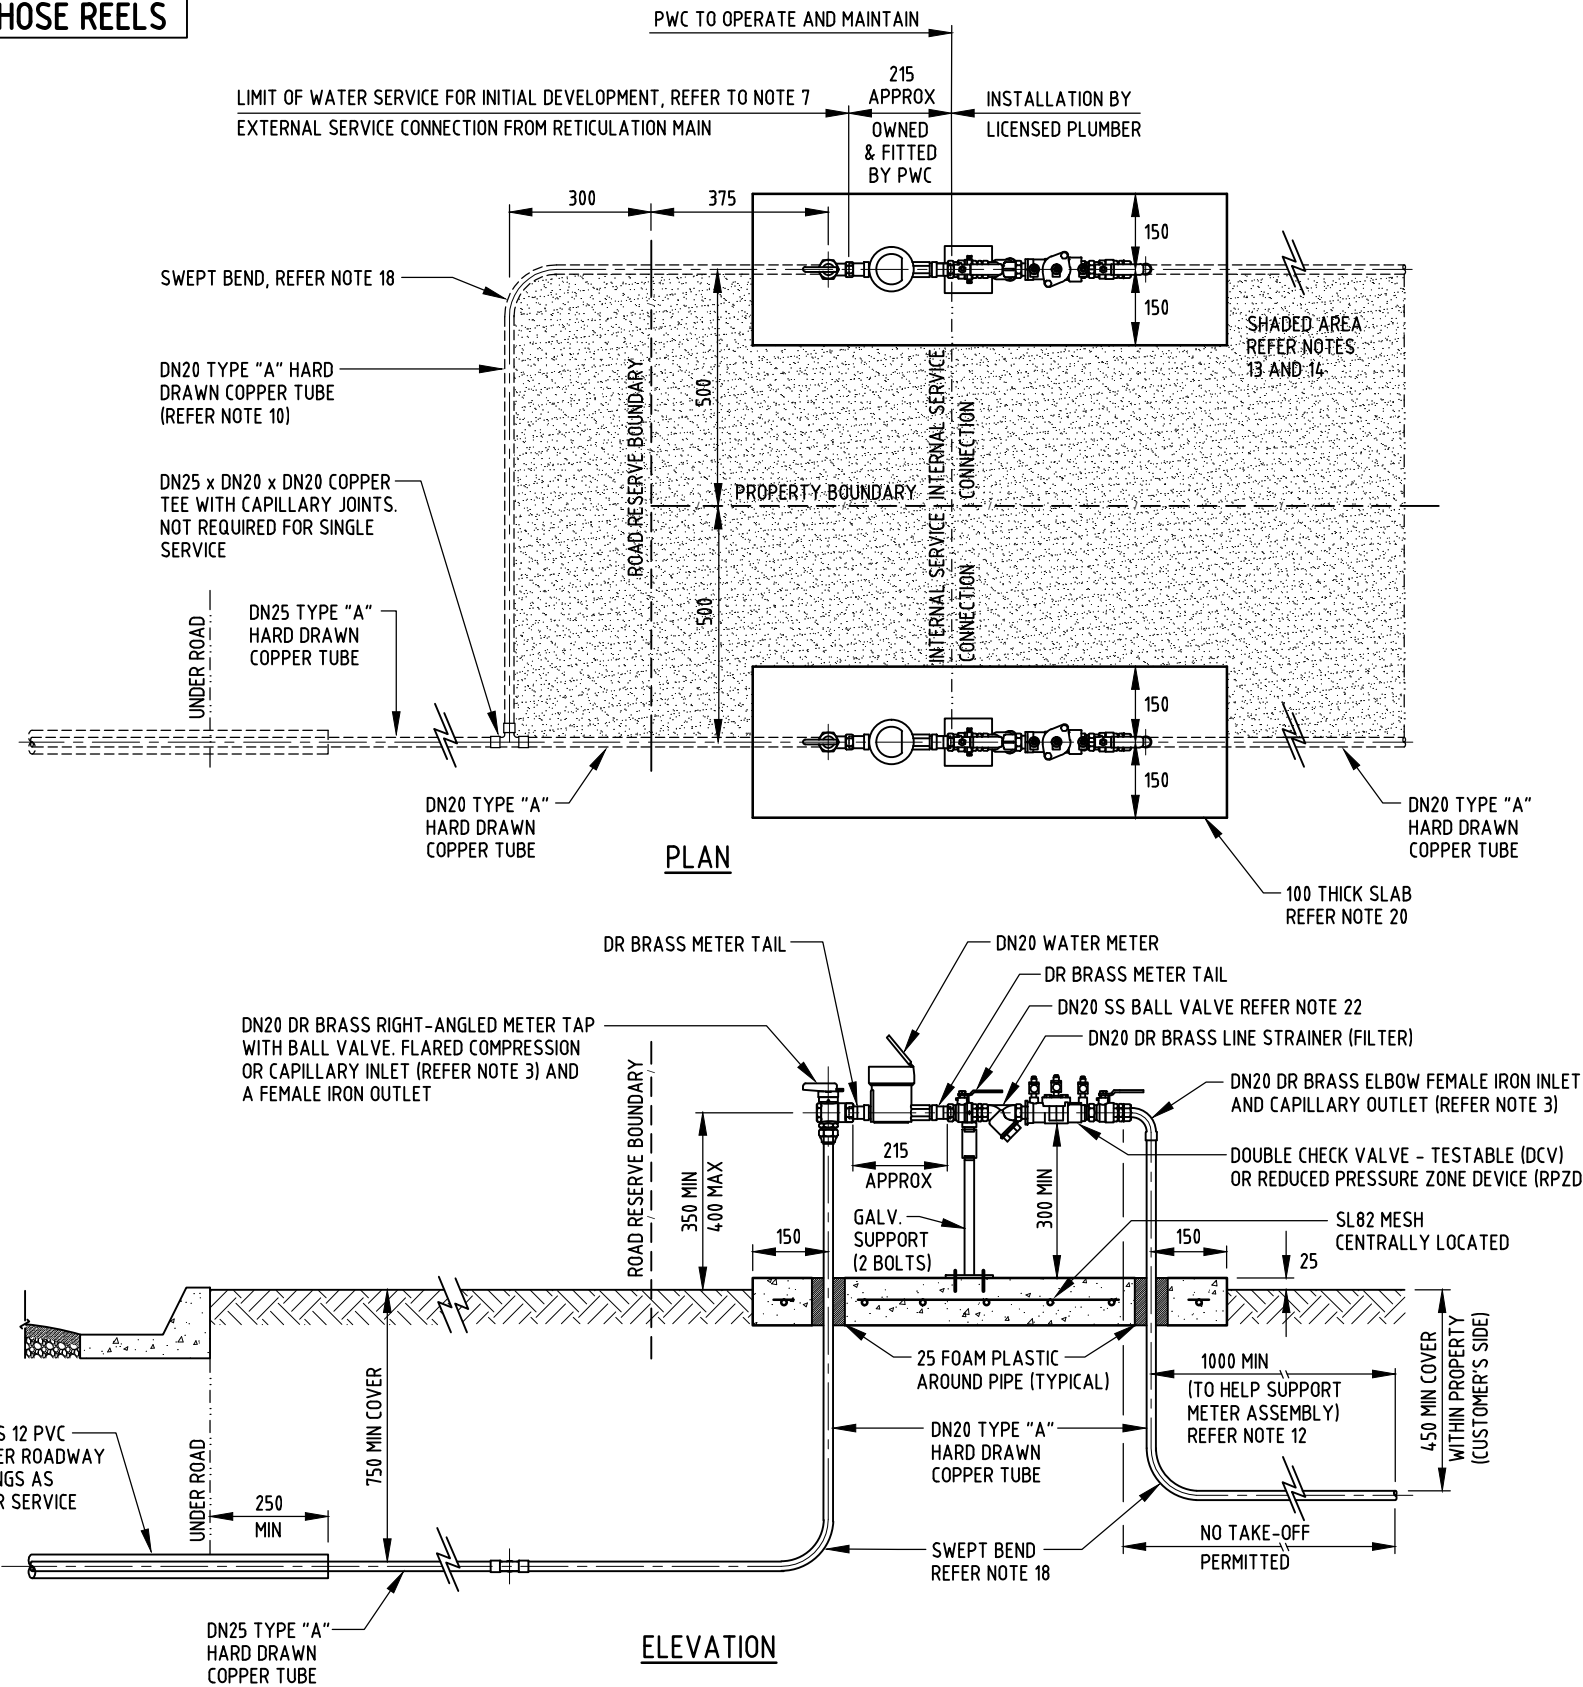

NOTES:

1. ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. COPPER ALLOY SHALL BE DEZINCIFICATION RESISTANT (DR) TO AS2345.
3. USE SILVER BRAZING ALLOY (MIN 2% SILVER TO AS1167.1) FOR ALL CAPILLARY JOINTING OF COPPER PIPES AND FITTINGS OR ALTERNATIVELY, FOR HORIZONTAL JOINTS ABOVE GROUND PRESS FITTINGS MAY BE USED.
4. THE METER ASSEMBLY SHALL BE HORIZONTAL.
5. ONLY PWC (OR ITS AUTHORISED CONTRACTORS) ARE PERMITTED TO TAP EXISTING, IN-SERVICE (LIVE) MAINS OR MAINS THAT HAVE BEEN HYDROSTATICALLY TESTED. WITHIN LICENSED AREAS AND UPON PAYMENT OF THE NECESSARY FEES, PWC WILL PERFORM TAPPING OF LIVE MAINS, HOWEVER, EXCAVATION, ALL MATERIALS AND INSTALLATION SHALL BE SUPPLIED BY THE CONTRACTOR.
6. ALL PIPES, VALVES AND FITTINGS MUST BE WATER MARK APPROVED.
7. ON COMPLETION OF WATER SERVICE, PROVIDE BRASS PLUG FITTED TO METER TAP OUTLET.
8. NON-METALLIC MATERIALS AND FITTINGS SHALL NOT FORM PART OF WATER METER ASSEMBLY.
9. FOR DUAL SERVICE, BRANCH PIPE SHALL ALWAYS BE ON THE LEFT OF THE MAIN SERVICE PIPE WHEN FACING BOUNDARY AS SHOWN ON THE DRAWING. FOR LOTS MORE THAN 1500 sq.m IN AREA, IDENTIFY EACH PROPERTY OFFTAKE WITH A 50 x 50 x 2 ALUMINIUM PLATE IDENTIFICATION TAG WITH PROPERTY NUMBER STAMPED IN 10mm HIGH LETTERS. WIRE TAG TO METER TAP WITH 3mm GALVANISED WIRE.
10. WHERE A SINGLE PROPERTY IS CONNECTED TO THE WATER SERVICE (EG. NO BRANCH PIPE TO SECOND PROPERTY), DN20 PIPEWORK MAY BE USED FROM MAIN TO PROPERTY BOUNDARY IF THE PROPERTY IS LESS THAN 900 sq.m IN AREA AND NO ROAD CROSSING IS REQUIRED, OTHERWISE USE DN25 PIPEWORK AND REDUCE TO DN20 COPPER TUBE APPROXIMATELY 675mm BEFORE SWEEP BEND TO UPSTAND AND METER TAP - USE BRAZED CAPILLARY REDUCER.
11. BACKFLOW CERTIFIED PLUMBER IS REQUIRED TO DETERMINE THE RISK OF CONTAMINATION OF THE POTABLE WATER SUPPLY DUE TO CROSS CONNECTIONS, REFER AS/NZS3500.1. A TESTABLE BACKFLOW PREVENTION DEVICE SHALL BE FITTED FOR MEDIUM OR HIGH HAZARD PROPERTIES.
12. TO ENSURE INTEGRITY AND STABILITY OF THE WATER METER INSTALLATION ANY CONNECTION TO THE COPPER RISER OF THE CUSTOMER'S SERVICE AND THE FIRST UNDERGROUND 1000mm OF THE CUSTOMER'S SERVICE MUST USE A BRAZED JOINTS COMPLYING WITH NOTE 3.
13. NO OTHER UTILITY SERVICES (EG. COMMUNICATIONS, POWER, SEWER) TO BE INSTALLED BETWEEN WATER SERVICE, METER AND PROPERTY BOUNDARY.
14. MINIMUM CLEARANCE TO OTHER SERVICES SHALL BE 300mm.
15. WHERE SIDE BOUNDARY OF PROPERTY ADJACENT TO WATER METER IS NOT PERPENDICULAR TO ROAD RESERVE BOUNDARY, INSTALL WATER METER PARALLEL TO SIDE BOUNDARY.
16. NUT AND TAILS FOR METER INSTALLATION SUPPLIED BY POWER AND WATER.
17. PRESSURE TEST WATER SERVICE AT 1000kPa FOR 30 MINUTES (NO PRESSURE LOSS PERMITTED) USING WATER CHLORINATED TO A MINIMUM CHLORINE CONCENTRATION OF 25mg/L (REFER PWC WATER SERVICES GUIDELINE FOR DISINFECTION OF SUBDIVISIONS AND WATER SERVICE CONNECTIONS FROM 20mm AND GREATER). ENSURE PIPEWORK IS FLUSHED OUT AFTER THE TEST FOR A MINIMUM OF FIVE MINUTES.
18. SWEEP BEND TO BE FORMED USING PIPE BENDER OR BENDING SPRING WITH A BEND RADIUS GREATER THAN FIVE TIMES THE OUTSIDE DIAMETER OF THE COPPER TUBE.
19. WHERE A REGISTERED AIR GAP (RAG) OR REGISTERED BREAK TANK (RBT) IS PROPOSED IN LIEU OF TESTABLE BACKFLOW PREVENTION DEVICE, DISCUSS REQUIREMENTS WITH PWC.
20. PROVIDE SLAB UNDER ANY METER ARRANGEMENT FITTED WITH A BACKFLOW PREVENTION DEVICE.
21. WHERE A CONCRETE PATH OR LARGE SLAB IS CAST UNDER THE METER, PROVIDE A BREAK-OUT SECTION BETWEEN 600x300 AND 1500x600 FOR FUTURE ACCESS TO BURIED PIPEWORK.
22. VALVE TO BE ABLE TO BE LOCKED IN OPEN POSITION.

2	GENERAL AMENDMENTS 2020.	PW	JULY'20	JR	DC
1	GENERAL UPDATE.	AW	JUNE'18	JR	DC
0	ISSUED FOR INFORMATION.	AW	APRIL'13	RJ	RJ
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					



DES	-	WATER STANDARD DRAWING	
DRN	AW	SERVICES	
CHK	RJ	DN20 WATER SERVICE - COPPER	
APPD	RJ	MEDIUM & HIGH HAZARD	
SCALE	N.T.S.	A3	DRAWING NUMBER
ISSUED	APRIL 2013		W1-1-01B
ALL DIM. IN mm			
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY	
			2
			AMDT