


3RD ANGLE -DO NOT SCALE - REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

DESIGN TENSION 18% UTS
AT 15°C NO WIND

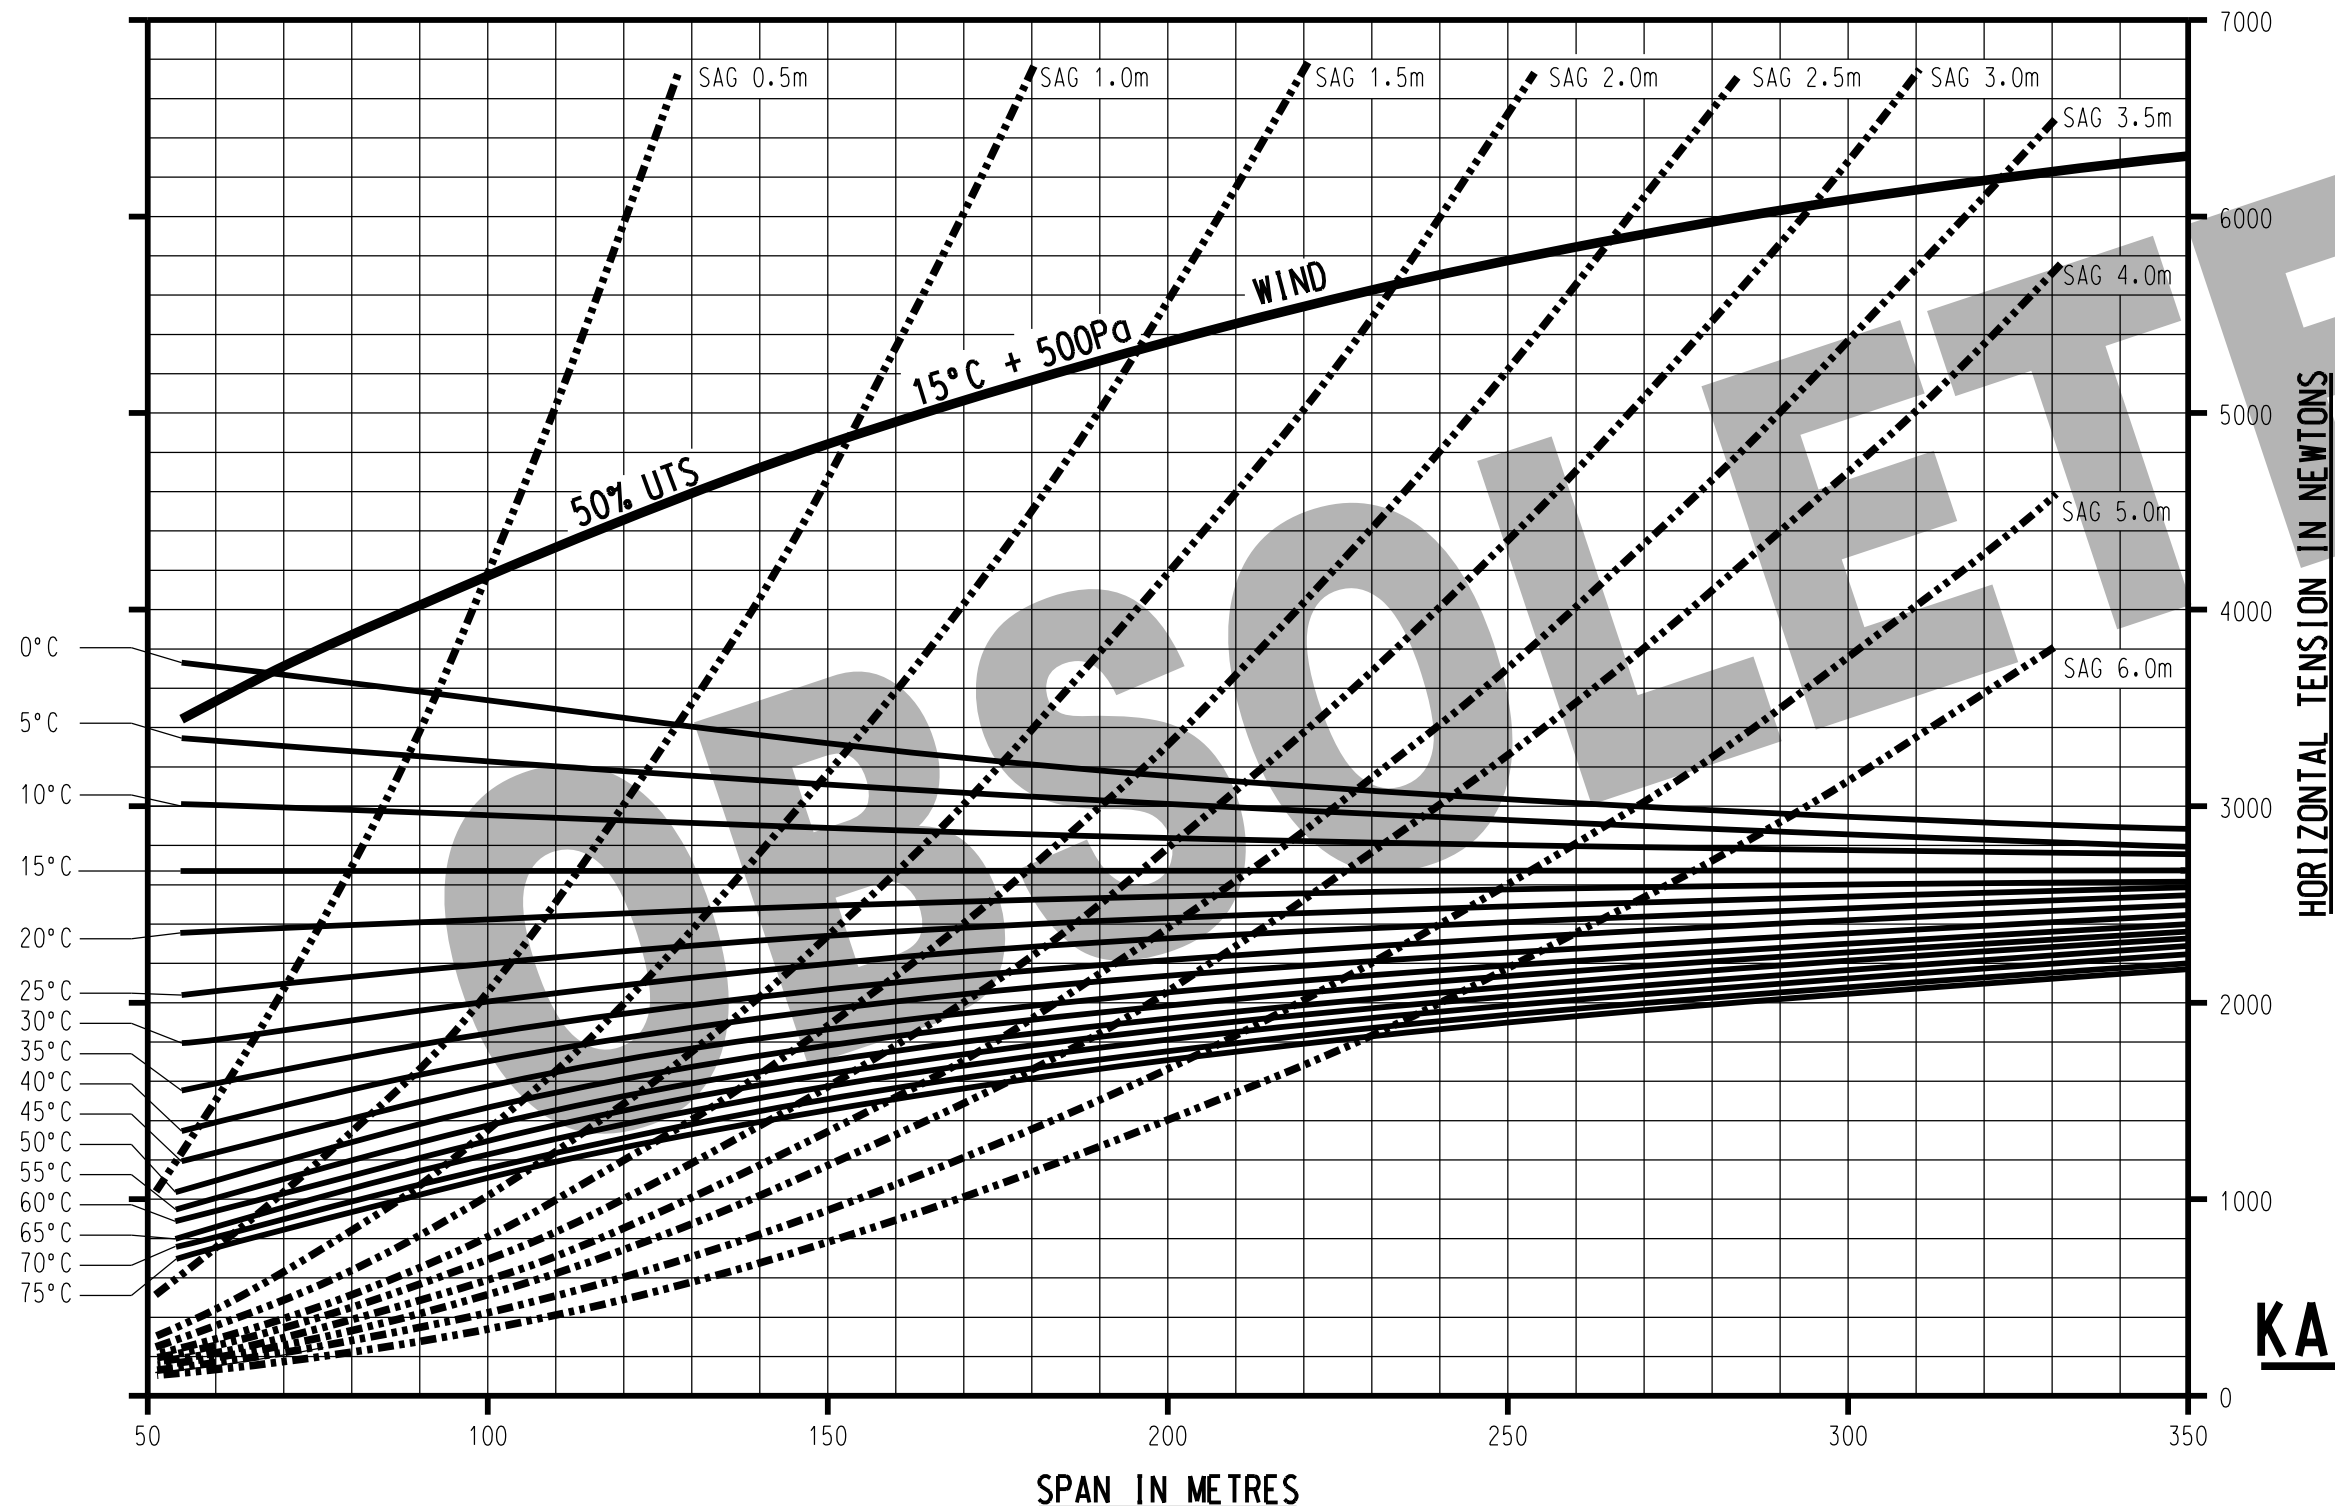

'APPLE'

KATHERINE & CENTRAL
AREAS ONLY

- 4 OBSOLETE
- 3 TITLEBLOCK & DRAWING NUMBER FORMATTED
- 2 REDRAWN ON CAD
- 1 NUMBER CHANGED

NO	DESCRIPTION	DRN	DATE	CKD	APPD
	AMENDMENTS				

B.B.
K.T.
AD
OCT'25
APR'19
12/97
8/87
B.B.
C.C.
MB
B.V.
C.C.

PowerWater
NORTHERN TERRITORY

DES	R.REYNOLDS
DRN	RPP MAY'85
CKD	
APPD	R.REYNOLDS
SCALE	NTS
ISSUED	MAY'85
ALL DIM. IN mm	
DRAFTING STANDARD TO A.S.1100	

POWER STANDARD DRAWING

SAG TENSION CHART
6/1/3.0 A.C.S.R.
'APPLE' CONDUCTOR
CENTRAL REGION

A3
DRAWING NUMBER S01-03-01-09

CAD PRODUCT - DO NOT AMEND MANUALLY

4
AMDT