


390x190x90mm CONCRETE BESSER
BLOCK (SEE NOTE 8)
ITEM NO. 504476

NOTES:

- ALL WELDS AND BLACK METAL SURFACES TO BE CLEANED AND COATED WITH COLD GALVANIZING COMPOUND.
- COLUMN TO BE HOT DIPPED GALVANIZED ACCORDING TO AS 1650 - NO PAINTING REQUIRED.
- ALL ROUGH OR BURRED EDGES ARE TO BE DRESSED CLEAN.
- ALL WELDING AND WELD PREPARATION TO BE IN ACCORDANCE WITH AS 1554.
- CIRCULAR HOLLOW SECTION TO BE TO AS 1163 GR250.
- POLES SHALL BE SINGLE PIECE WITH NO WELDED EXTRUSIONS.
- ITEMS 1 AND 2 HAVE BEEN SUPERSEDED TO ITEMS 3 AND 4.
- REFER TO S01-04-04-01 PN PROCEDURE 'POLE INSTALLATION PROCEDURE (CIVIL WORKS)' FOR THE REQUIREMENT AND INSTALLATION OF POLE CONCRETE FOUNDATIONS.
- AS A SERVICE POLE, CABLE SIZE IS LIMITED TO 16 SQMM ABC.
- FOR THE USE OF CLEARANCE, 95-150 SQMM ABC ARE LIMITED TO SUSPENSION ONLY. TERMINATIONS ARE NOT PERMITTED.

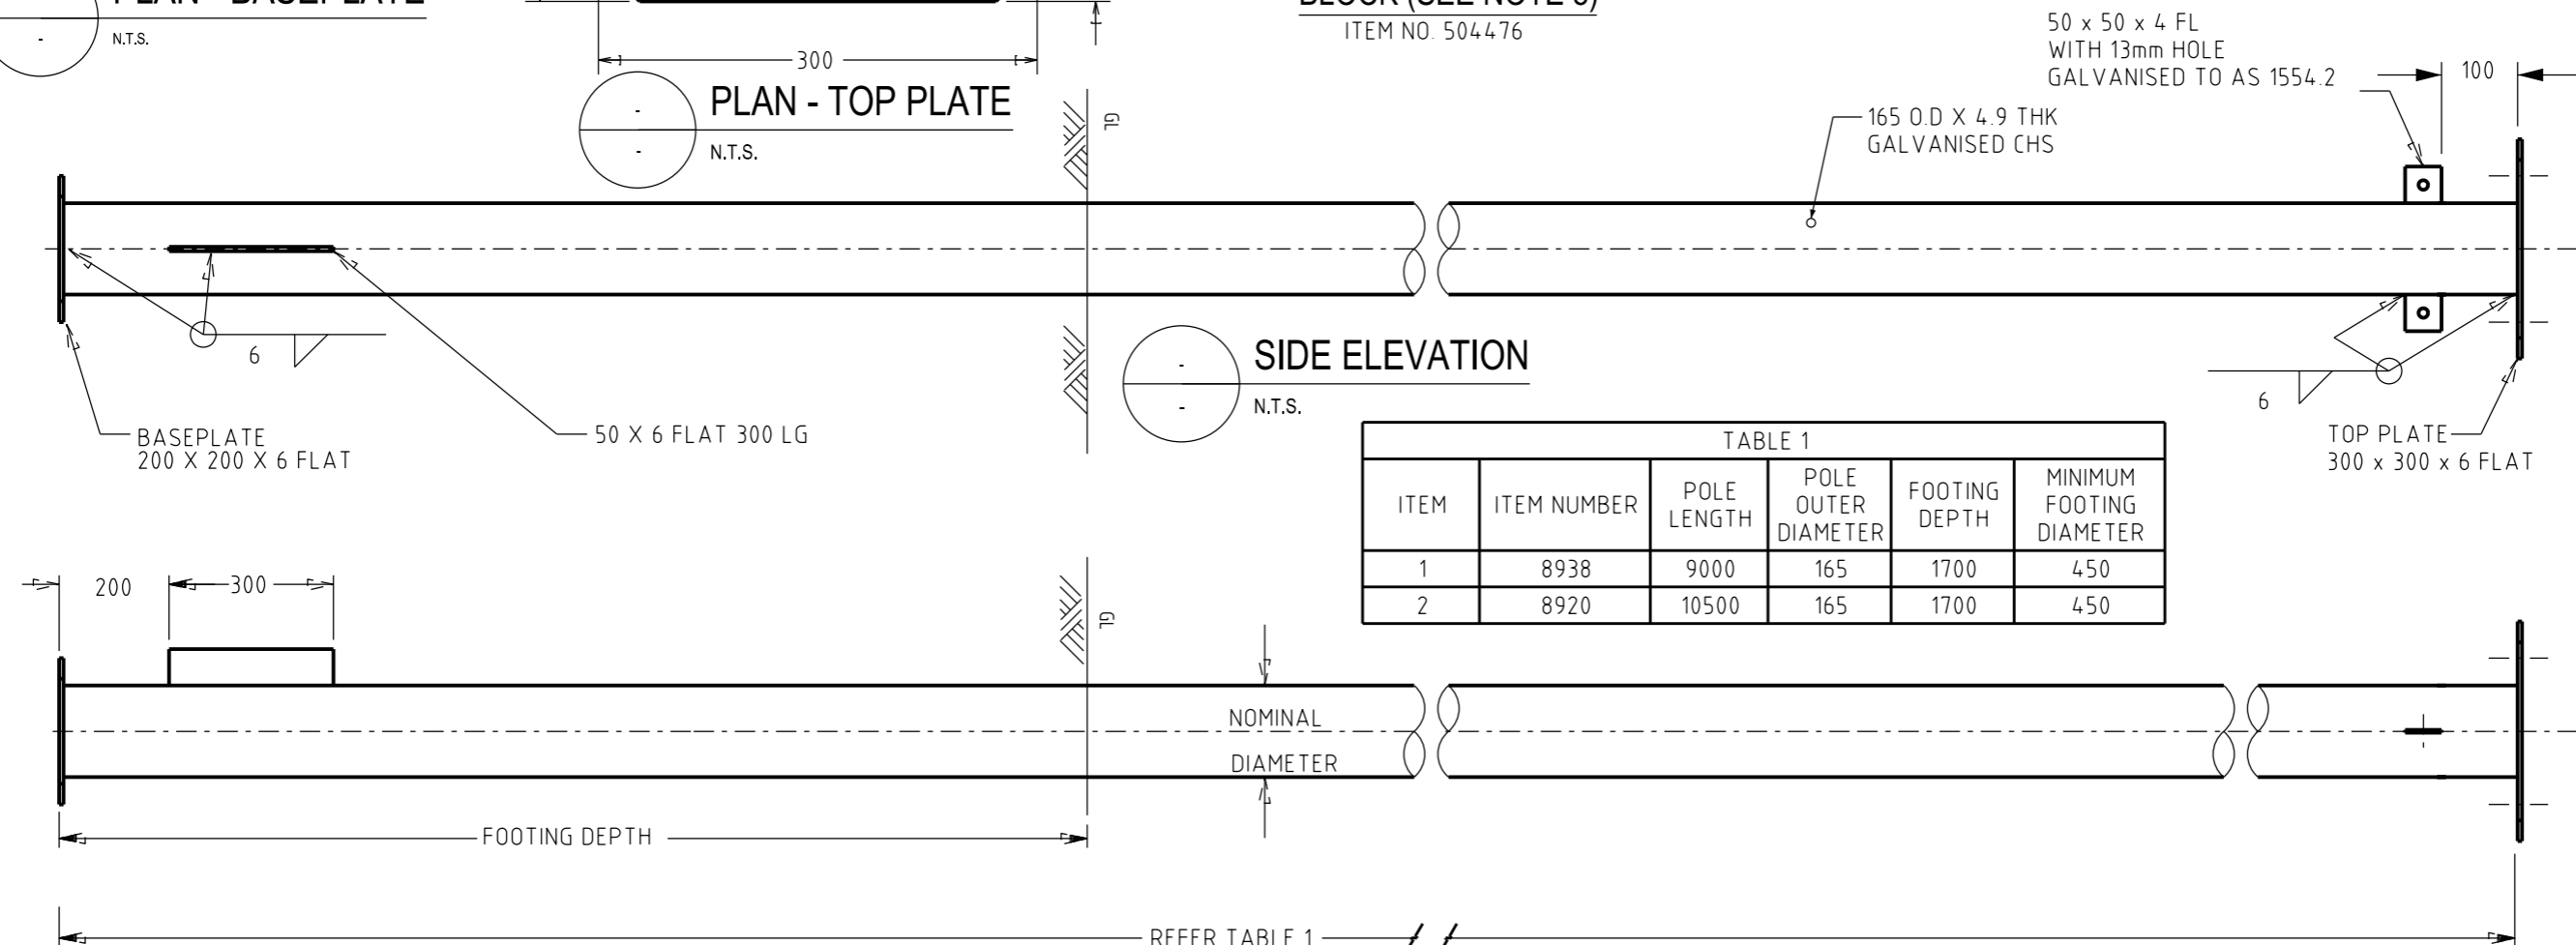

SIDE ELEVATION
N.T.S.

FRONT ELEVATION
N.T.S.

8	NOTES 9 & 10 ADDED	P.B.H.	NOV'22	B.V.	B.C.
7	AMEND MINIMUM FOOTING DIAMETER	C.C.	JUN'20	B.V.	B.V.
6	AMEND TO USE CONCRETE BESSER BLOCK AND INCLUDE MINIMUM FOOTING DIAMETER AND REMOVE SUPERSEDED ITEMS	C.C.	MAY'20	B.V.	B.V.
5	TITLEBLOCK & DRAWING NUMBER FORMATTED	K.T.	DEC'18	C.C.	C.C.
4	DRAWING TITLE AMENDED	C.C.	MAY'18	B.C.	I.B.
3	ADD CONCRETE PAVER	I.B.	AUG'16	I.B.	A.T.
2	SPLIT SLEEVE DETAIL REMOVED, NOTES 6, 7 AND 8 AMENDED	A.T.	MAY'16	I.B.	B.C.
1	LENGTH, FOOTING & NOMINAL DIAMETER AMENDED	A.S.	NOV'06	B.C.	S.C.
0	ISSUED FOR CONSTRUCTION	A.S.	JAN'06	C.C.	C.C.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					

PowerWater
NORTHERN TERRITORY

DES	C. CAMILLERI	POWER STANDARD DRAWING			
DRN	A. SCHMID	POLES 9.0 AND 10.5m SERVICE/CLEARANCE			
CKD	C. CAMILLERI				
APPD	C. CAMILLERI				
SCALE	N.T.S.				
ISSUED	JANUARY 2006	A3	DRAWING NUMBER	S01-01-01-39	<div><div></div><div>8</div></div>
ALL DIM. IN mm					
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY			AMDT