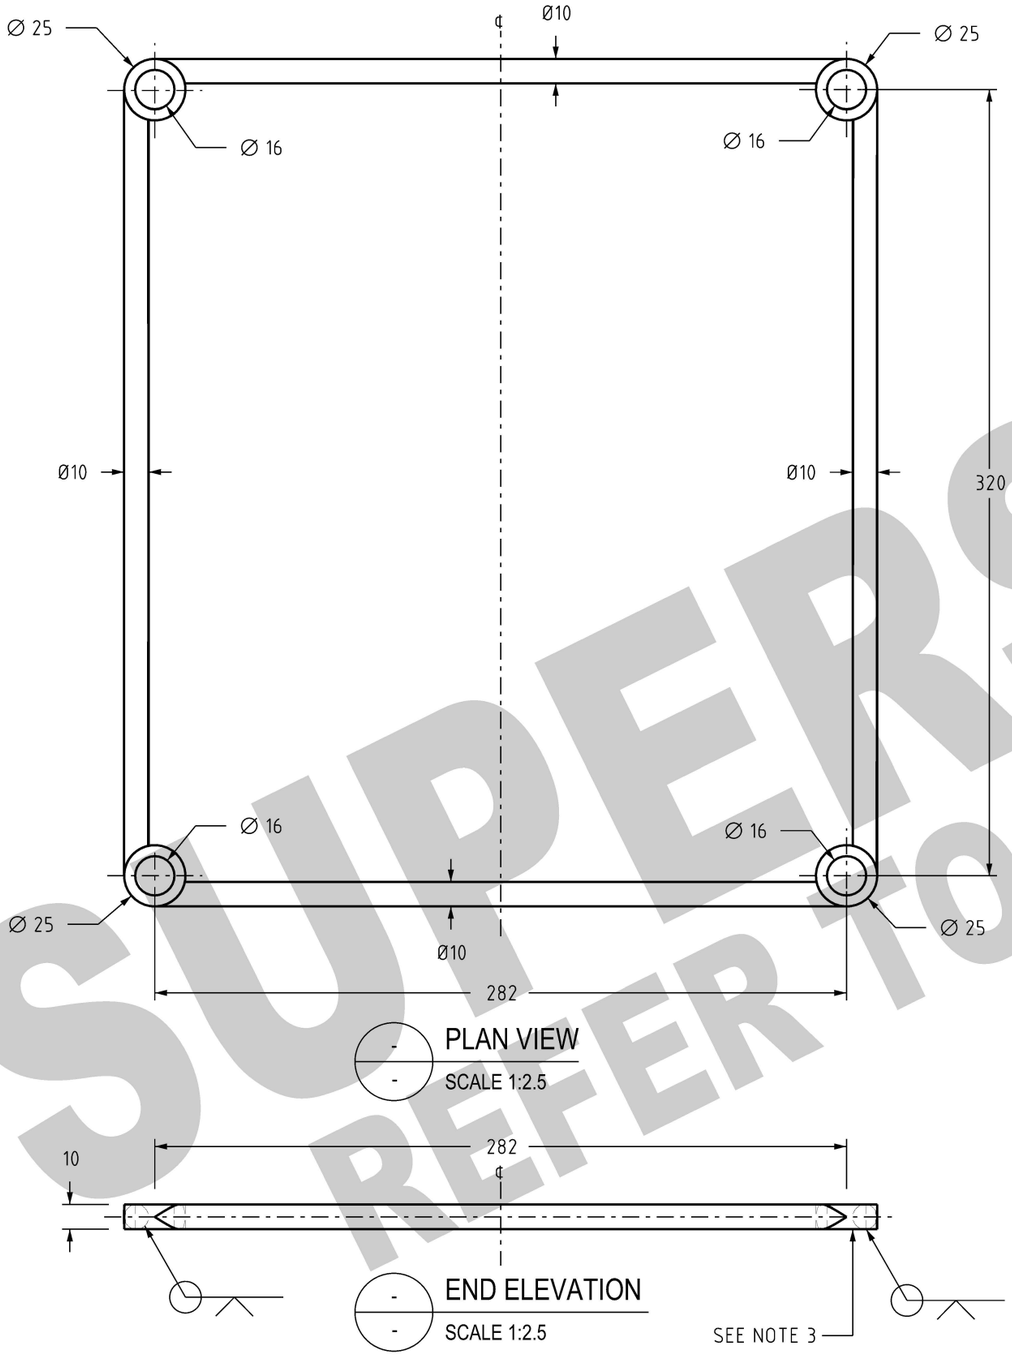

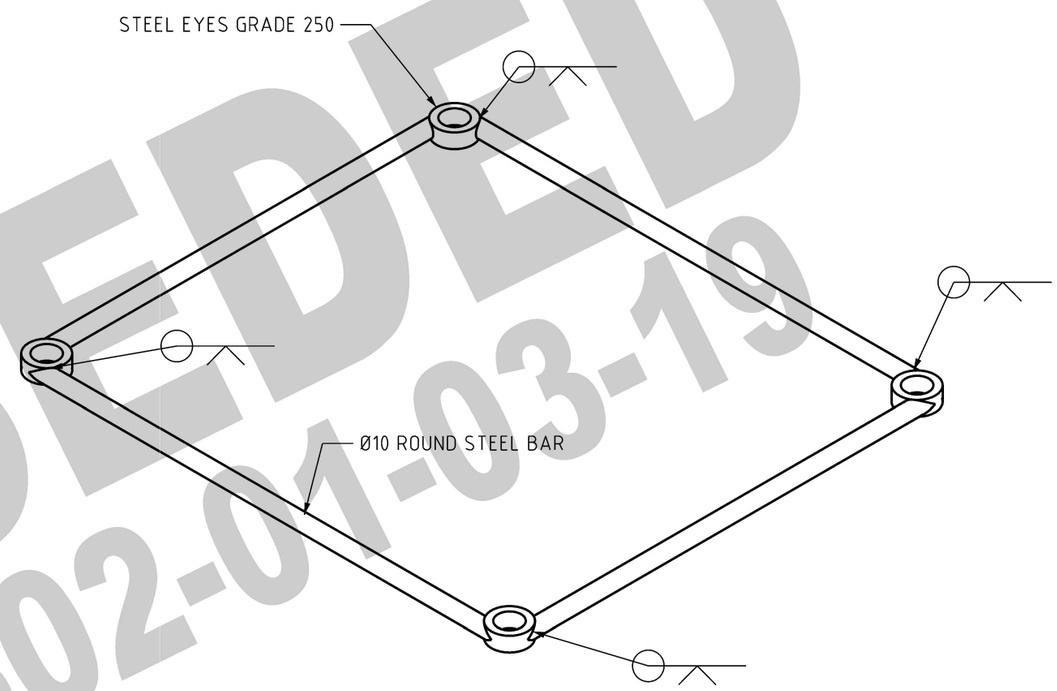

ISOMETRIC VIEW
SCALE N.T.S.

ITEM NUMBER: 413423

NOTES:

1. ALL JOINTS TO BE 'V' BUTT WELDED ALL AROUND
2. ALL EDGES TO BE DEBURRED AND WELDS GROUND FLUSH
3. COMPLETE ASSEMBLY TO BE HOT DIP GALVANISED IN ACCORDANCE WITH AS 4680 WITH AN AVERAGE COATING THICKNESS NO LESS THAN 85 MICRON, WITH A LOCAL COATING THICKNESS NO LESS THAN 70 MICRON.
4. FABRICATION TO COMPLY WITH PWC SPECIFICATION STSP 01-002.
5. STEEL TO BE GRADE 250

SUPERSEDED
REFER TO S02-01-03-19

NO	DESCRIPTION	DRN	DATE	CKD	APPD
2	SUPERSEDED TO S02-01-03-19	P.BH.	OCT'22	B.V.	B.C.
1	REVERT TO STEEL FABRICATED VERSION.	H.E.	NOV'20	B.V.	B.C.
0	ISSUED FOR CONSTRUCTION	C.C.	JUL'20	B.V.	B.C.

AMENDMENTS

PowerWater
NORTHERN TERRITORY

DES	B.VANDERSTELT
DRN	C.COPPINS
CKD	B.VANDERSTELT
APPD	B.CHEUNG
SCALE	AS SHOWN
ISSUED	MAY 2020
ALL DIM. IN mm	
DRAFTING STANDARD TO A.S.1100	

POWER STANDARD DRAWING

DISTRIBUTION PILLAR RESIDENTIAL
REINFORCING COLLAR

A3

DRAWING NUMBER S02-01-09-07

2 AMDT

CAD PRODUCT - DO NOT AMEND MANUALLY