


**NOTES**

1. CABLE COVER TO FULLY COMPLY WITH AS4702
2. MIN WIDTH OF COVER STRIP TO BE 150mm AND THICKNESS OF 5mm IN ACCORDANCE WITH AS4702
3. TO BE PLACED AT A MAXIMUM HEIGHT OF 150mm ABOVE CABLES
4. COVER STRIPS TO OVERLAP 40mm MIN
5. REFER S02-02-06-01, 02, 03 FOR TRENCHING DETAILS

ITEM	ITEM NUMBER	DIM 'B'
1	413386	150mm
2	413387	200mm
3	500716	300mm

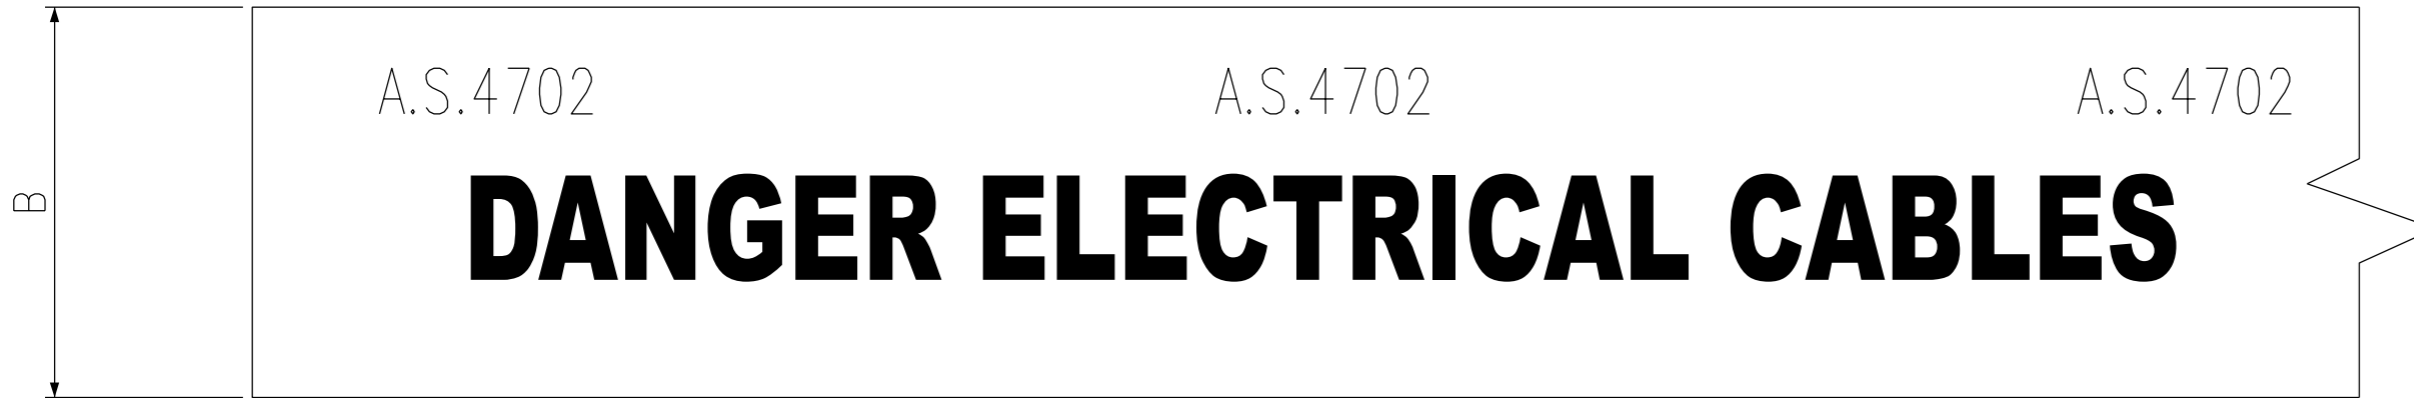

13	TITLEBLOCK & DRAWING NUMBER FORMATTED	K.T.	FEB'19	C.C.	C.C.
12	ITEM 3 STOCK CODE & NOTE 5 ADDED	K.T.	APR'16	I.B.	B.C.
11	STOCK CODES ADDED	A.T.	JUL'11	B.N.	S.C.
10	NOTES UPDATED, PVC COVER REPLACED WITH POLYMERIC	C.C.	APR'11	A.T.	S.C.
9	REDRAWN IN CAD	C.C.	NOV'10	A.T.	S.C.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					



DES	A. TAYLOR
DRN	C. COPPINS
CKD	A. TAYLOR
APPD	A. TAYLOR
SCALE	1:5
ISSUED	NOV'10
ALL DIM. IN mm	
DRAFTING STANDARD TO A.S.1100	

POWER STANDARD DRAWING	
<b>SIGNS COVER CABLE PROTECTION</b>	
<b>A3</b>	<b>DRAWING NUMBER S02-01-08-06</b>
CAD PRODUCT - DO NOT AMEND MANUALLY	