



3RD ANGLE — DO NOT SCALE — REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

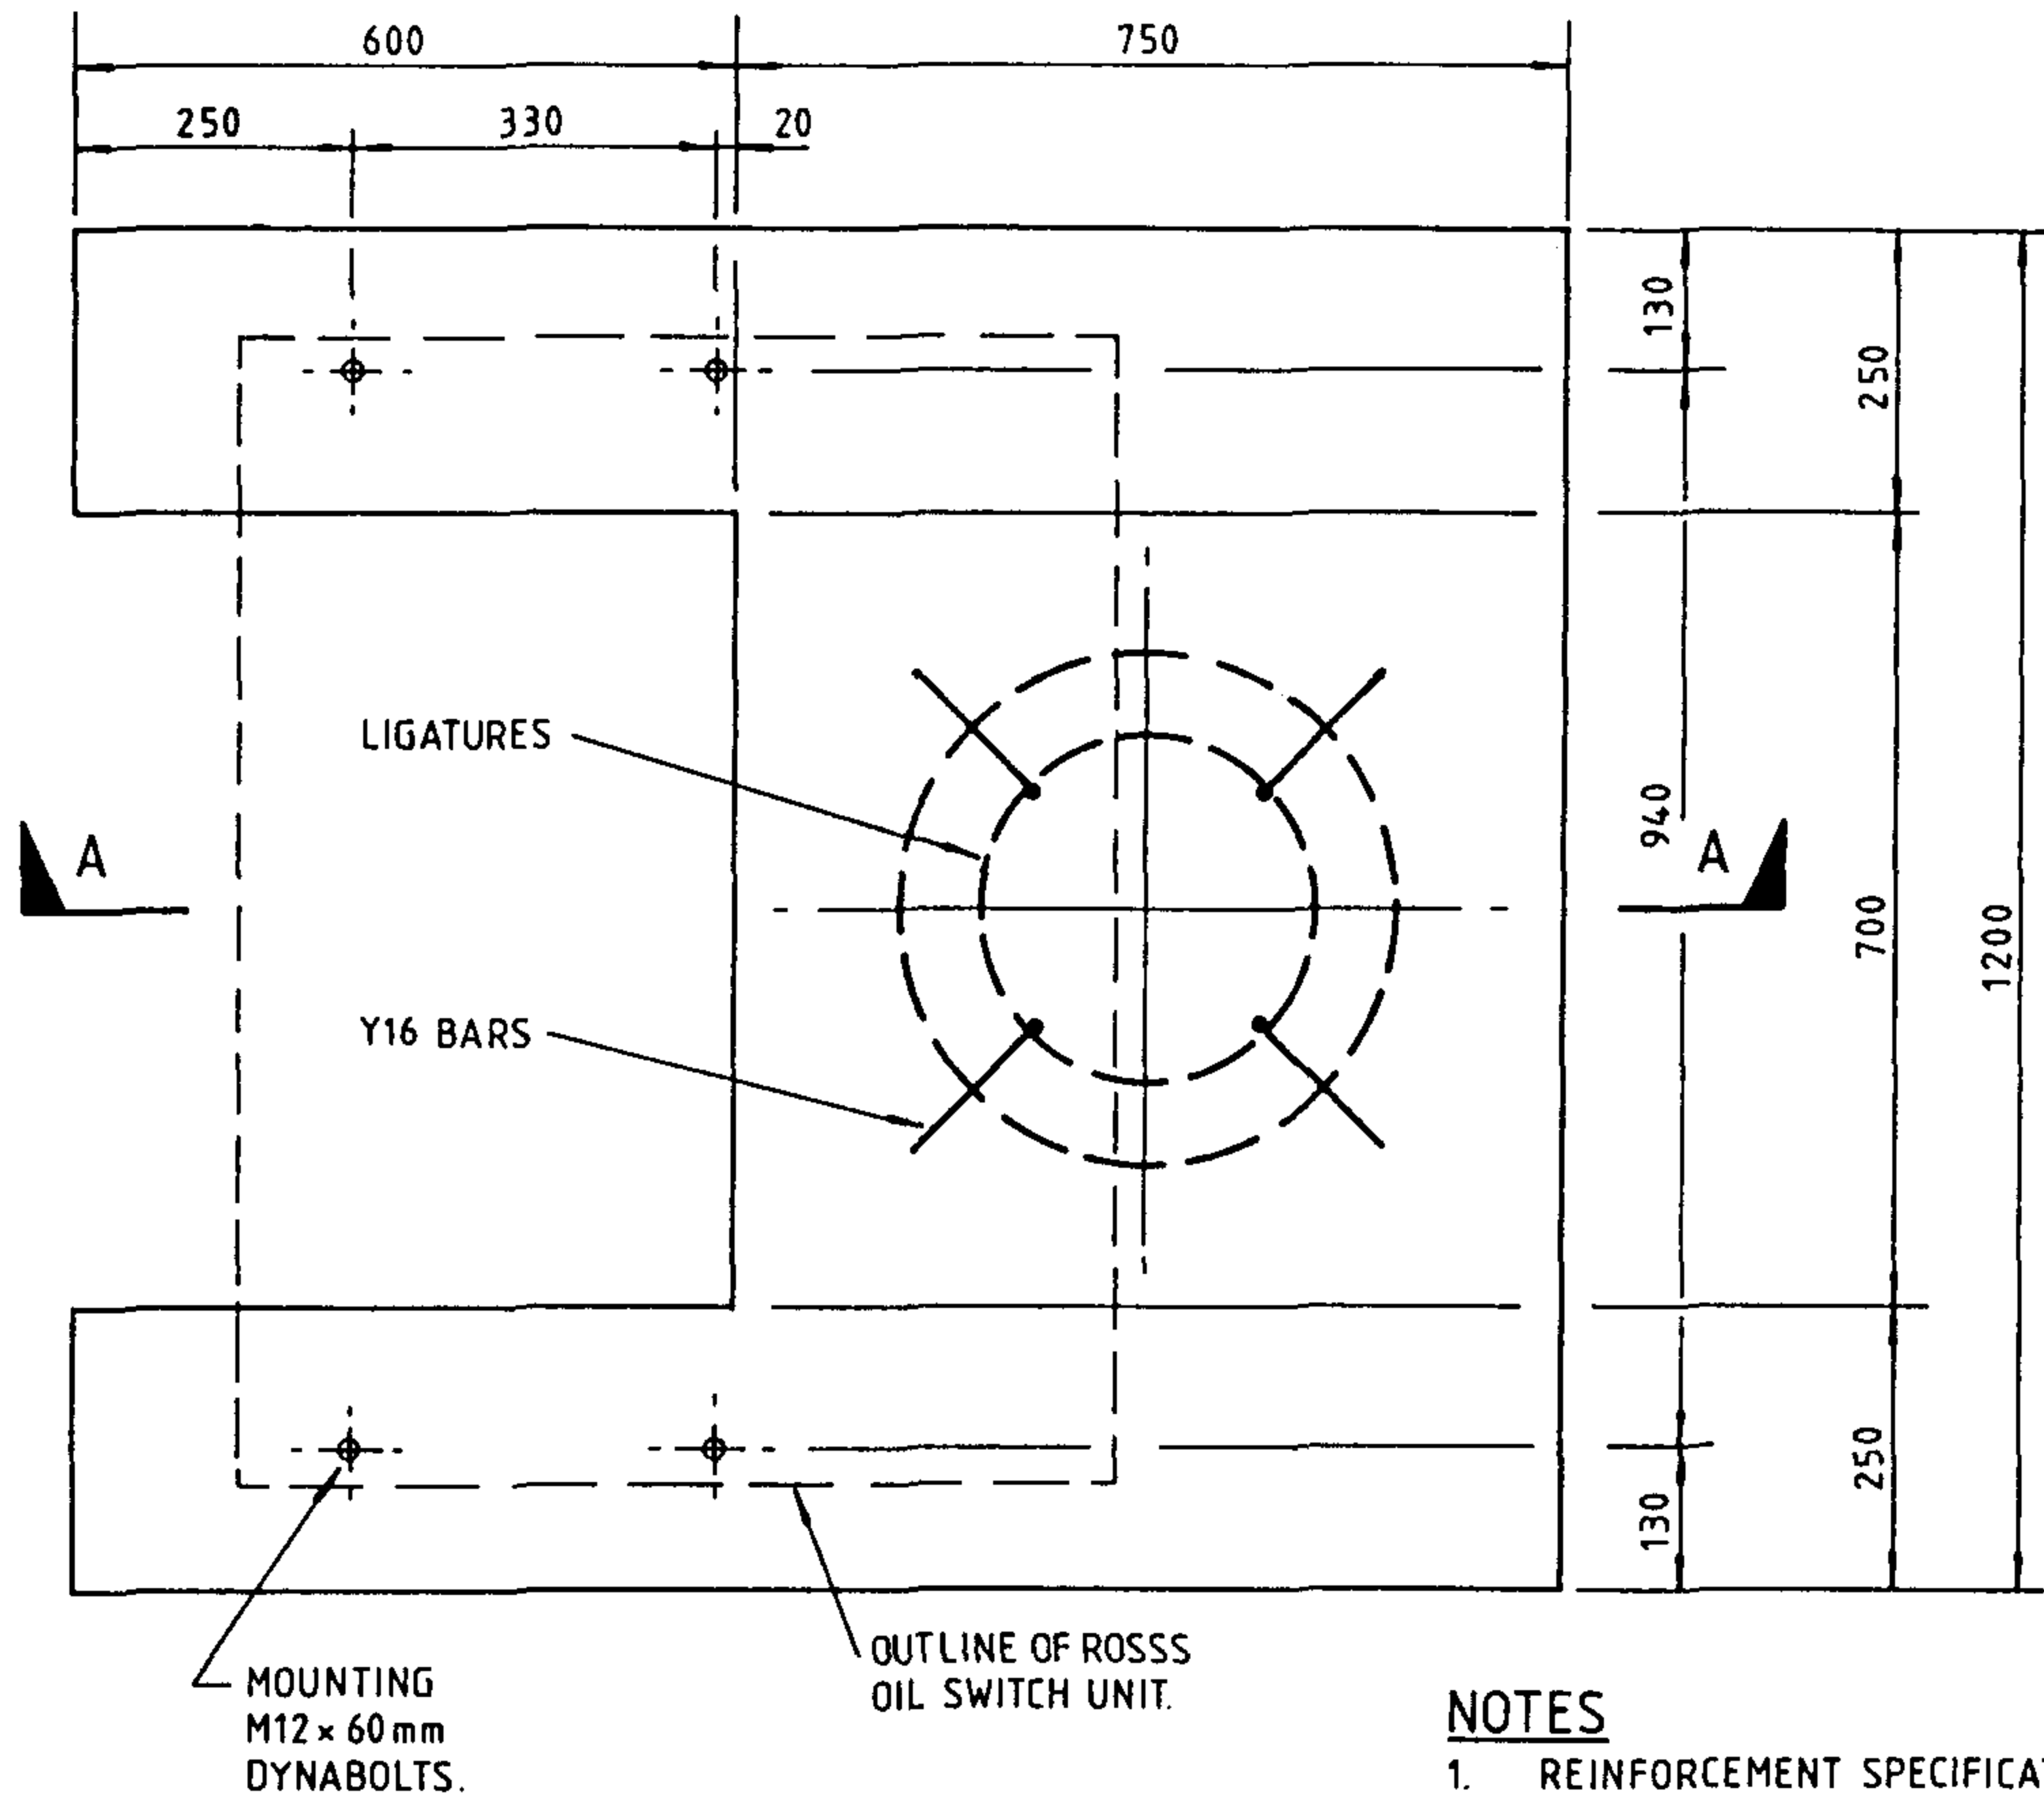

PLAN VIEW
(MESH NOT SHOWN)

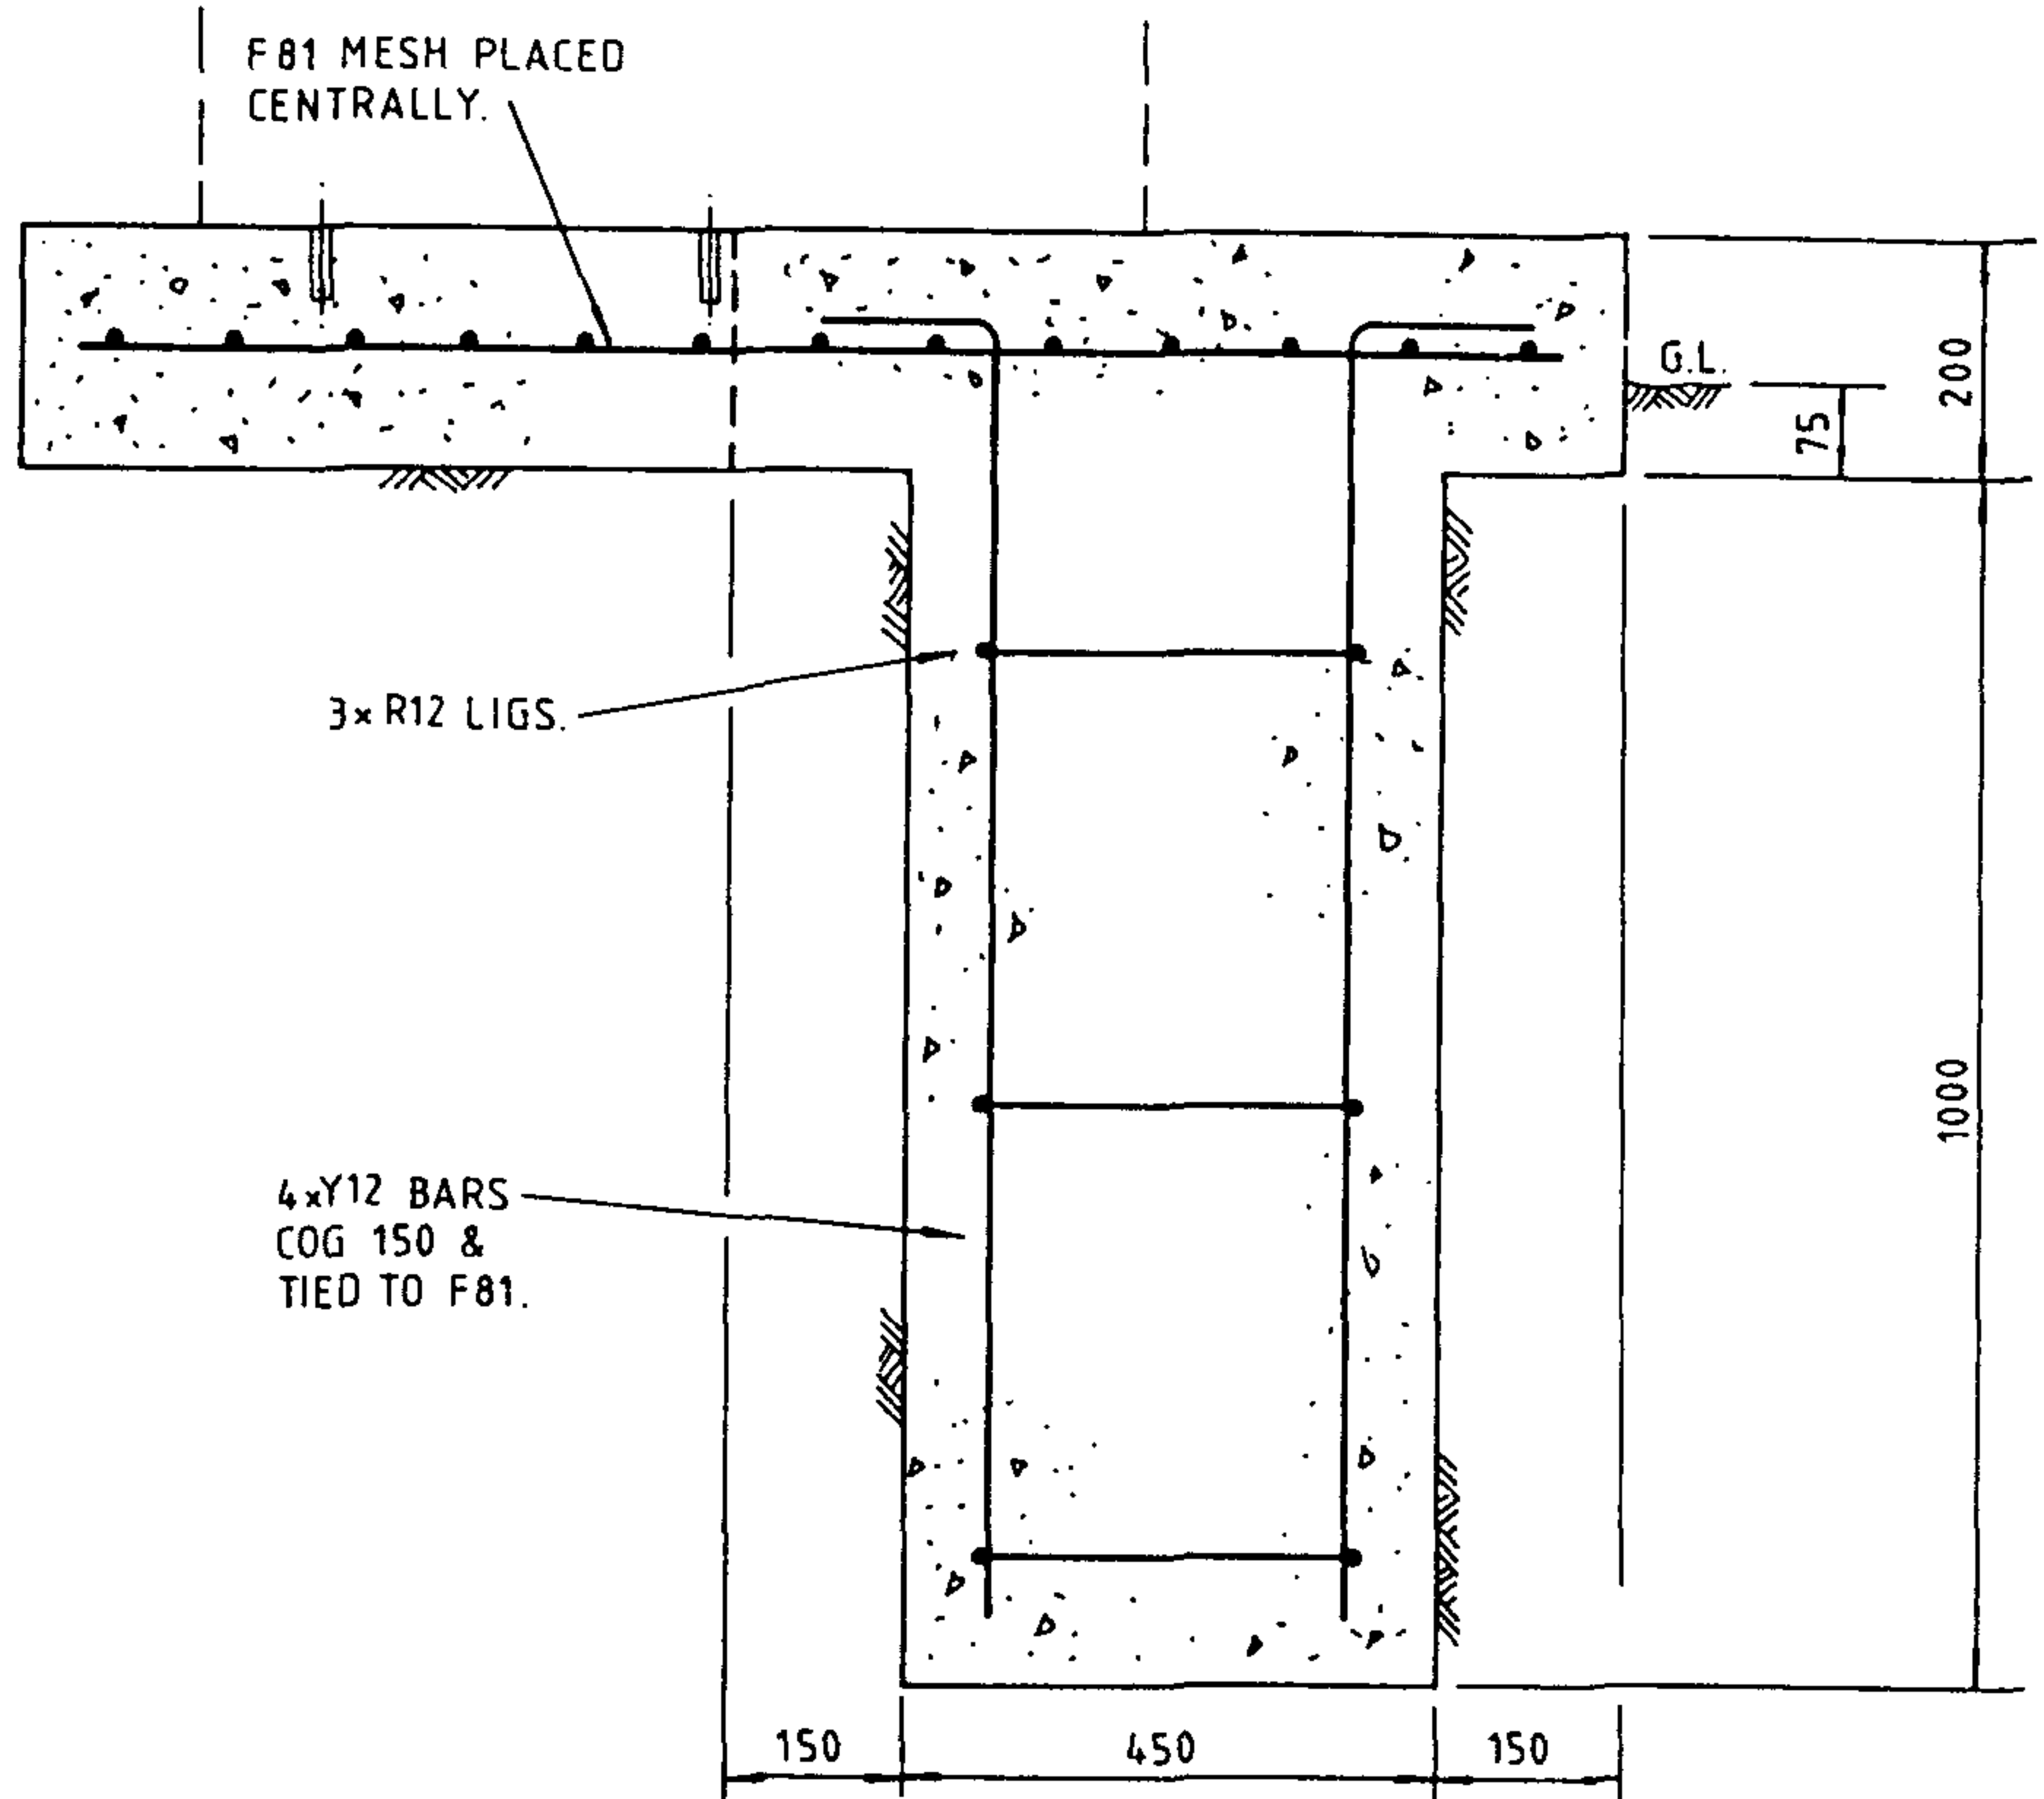

SECTION A - A

- NOTES**
1. REINFORCEMENT SPECIFICATION: MESH - F81 TO A.S.1304
BARS - TO A.S.1302.
 2. CONCRETE TO BE 20 MP_a AT 28 DAYS.
 3. MIN. CONCRETE COVER TO BE 75 mm.
 4. UNIT TO BE FIXED TO FOUNDATION WITH SUITABLE CONCRETE ANCHORING BOLTS. DRILL HOLES ON SITE.
 5. ROSSS OIL SWITCH TO BE POSITIONED AS SHOWN ON PLAN VIEW.

				<p>POWER AND WATER AUTHORITY POWER DIRECTORATE</p>	DES R. HAIGH.	N T STANDARD DRAWING	
					DRN J. RICARDO.	TITLE CIVIL	
				CKD <i>21/25/05</i>	APPD <i>25/9/05</i>	RING MAIN UNIT REYROLLE ROSSS FOUNDATION DETAILS	
				ISSUED 25/9/05	DRAFTING STANDARD TO A.S. 1100	A3	DRAWING NUMBER S2-2-6-8
1	TITLE & Drg NUMBER CHANGED	6/88	<i>QK</i>		ALL DIM. IN mm.	SCALE	SHEET
No.	AMENDMENT	DATE	INIT				AMDT