
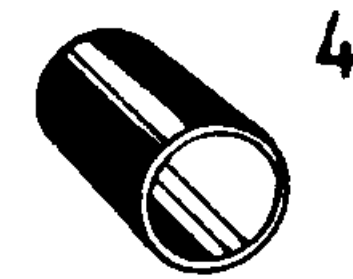
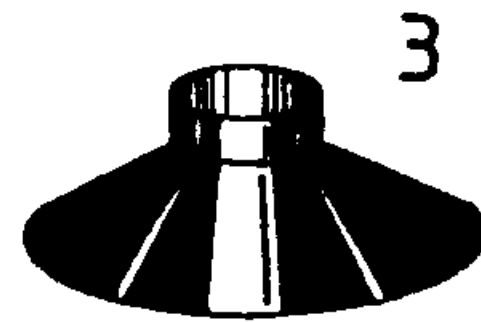
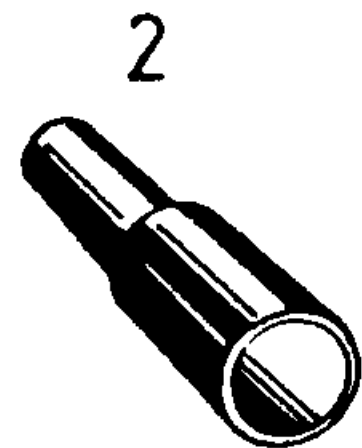


3RD ANGLE — DO NOT SCALE — REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

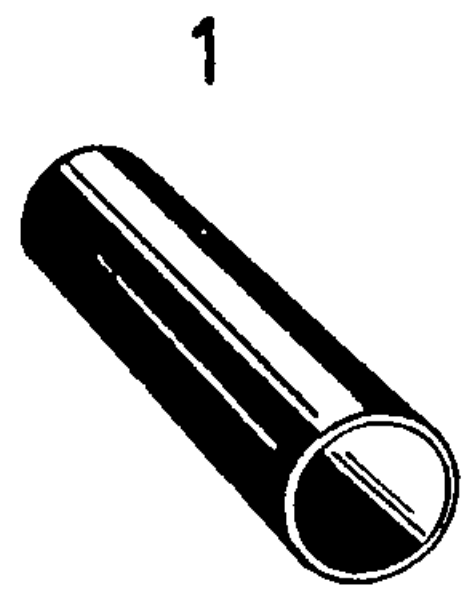

• OUTDOOR KITS ONLY

NOTE:

1. All termination kits to contain installation instructions, discharge control compound and can of cleaning compound.
2. Material: Heatshrinkable, non-tracking, erosion resistant, electrical insulation - polymeric.
3. LUGS NOT SUPPLIED WITH KIT
4. ALL KITS TO SUIT 3 PHASE TERMINATION.

QTY	DESCRIPTION	STOCK NO	CABLE SIZE	TYPE	RAYCHEM CAT NO	TAIL Len	ITEM
6	3 x 450mm HV TUBING (RED)	3699	400mm ²	OUTDOOR	EPKT-17D1X0H1	450	1
• 5	9 METRES S 1085 HV MASTIC (INCL. IN KIT)	4044	35mm ²	OUTDOOR	EPKT-17B1X0H1	450	2
• 4	150mm H.V. SHED PACKING	4028	35mm ²	INDOOR	EPKT-17B1X1H1	450	3
• 3	9 WEATHER SHEDS	36E1	400mm ²	INDOOR	EPKT-17D1X1H1	450	4
2	3 H.V. LUG SEALING SLEEVE	3673	240mm ²	OUTDOOR	EPKT-17D1X0H1	450	5
1	600mm S.C. TUBING (BLACK)	3657	240mm ²	INDOOR	EPKT-17D1X1H1	450	6

Nº	DESCRIPTION	INT	DATE
10	ITEMS 5, 6 & 8 AMENDED	FEB 93	gmck
9	TABLES ALTERED. NOTE 4 ADDED. TITLE & Drg NUMBER CHANGED	5/88	AN
8	ITEM Nos ADDED	8/87	0387
7	STOCK CODE ADDED. LUG REMOVED	8/87	0387
6	TINNED COPPER BRAID REMOVED	1.0	10/86
5	INDEX NO. ADDED	1.0	8/85
4	STRAIGHT TUBING BOX CHANGE	1.0	8/85
3	REDRAWN & REVISED	7/85	185



DES R. HAIGH.	N.T. STANDARD DRAWING	
DRN S. JACKSON	TITLE CABLE JOINTING & TERMINATIONS	
CKD <i>[Signature]</i> 27/6/85	TERMINATION-HEATSHRINK KIT	
APPD <i>[Signature]</i>	11KV-SINGLE CORE	
ISSUED 7/11/85	XLPE	
DRAFTING STANDARD TO A.S. 1100	A3	DRAWING NUMBER S2-1-2-14
ALL DIM. IN mm	SCALE NOT TO SCALE	SHEET ———
		AMDT