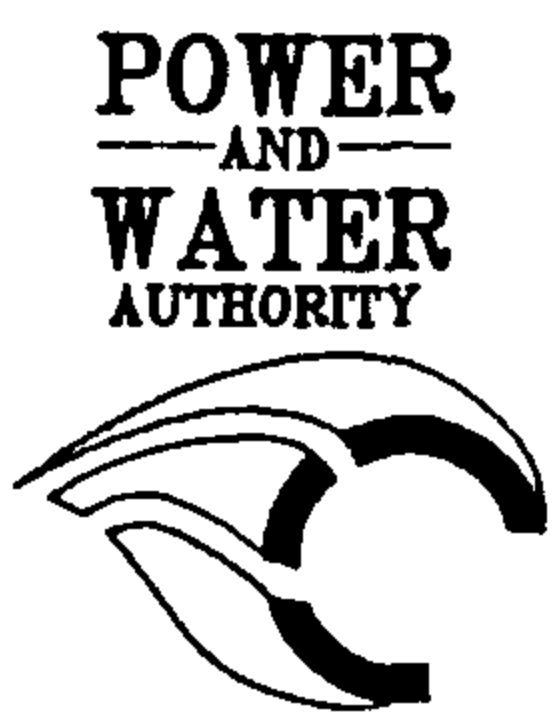



### JOINT COMPONENTS

- 1 COPPER COMPRESSION LINK 25 sq mm 19/1.35mm (STOCK CODE 156422)
- 2 KIT, CABLE JOINT, LV, 25 sq mm RAYCHEM PART No CJK25-PAWA 1 (STOCK CODE 8979) CONSISTING OF
  - a: 175mm LENGTH OF WCSM 19/6 SHRINK RATIO
  - b: 300mm LENGTH OF OBT 19/7 SHRINK RATIO
  - c: 400mm LENGTH OF MWTM 25/8 SHRINK RATIO

### INSTRUCTIONS

- A BARE THE CONDUCTOR TO SUIT THE COMPRESSION LINK USED
- B UNCOVER 45 mm OF THE INSULATION
- C UNCOVER 80 mm OF THE ANTI-TERMITE JACKET
- D SLIDE THE TUBING 2a, 2b AND 2c ALONG THE CABLE
- E CRIMP THE LINK ONTO THE CONDUCTOR
- F POSITION THE 175 mm LENGTH CENTRALLY OVER THE JOINT AND SHRINK
- G SLIDE THE 300 mm LENGTH CENTRALLY OVER THE JOINT AND SHRINK. MAKE SURE THIS TUBING IS FULLY RECOVERED ONTO THE ANTI-TERMITE JACKET OF THE CABLE AT BOTH ENDS
- H SLIDE THE 400 mm LENGTH CENTRALLY OVER THE JOINT AND SHRINK

5	REVISED AND REDRAWN	AMENDMENT	R.T.F	APR '90	N.S	 <b>POWER AND WATER AUTHORITY</b> NORTHERN TERRITORY	DES A.T	N.T. STANDARD - POWER			
							DRN R.T.F	CABLE JOINTING & TERMINATIONS			
							CKD N.S	JOINT CABLE LV			
							APPD B.T.K	25 sq mm COPPER SINGLE CORE XLPE			
							SCALE 1:2	A3	DRAWING NUMBER	S2-2-2-13	
						ISSUED APR '90	DRAFTING STANDARD TO AS 1100				
No.			DRAWN	DATE	APPD						