

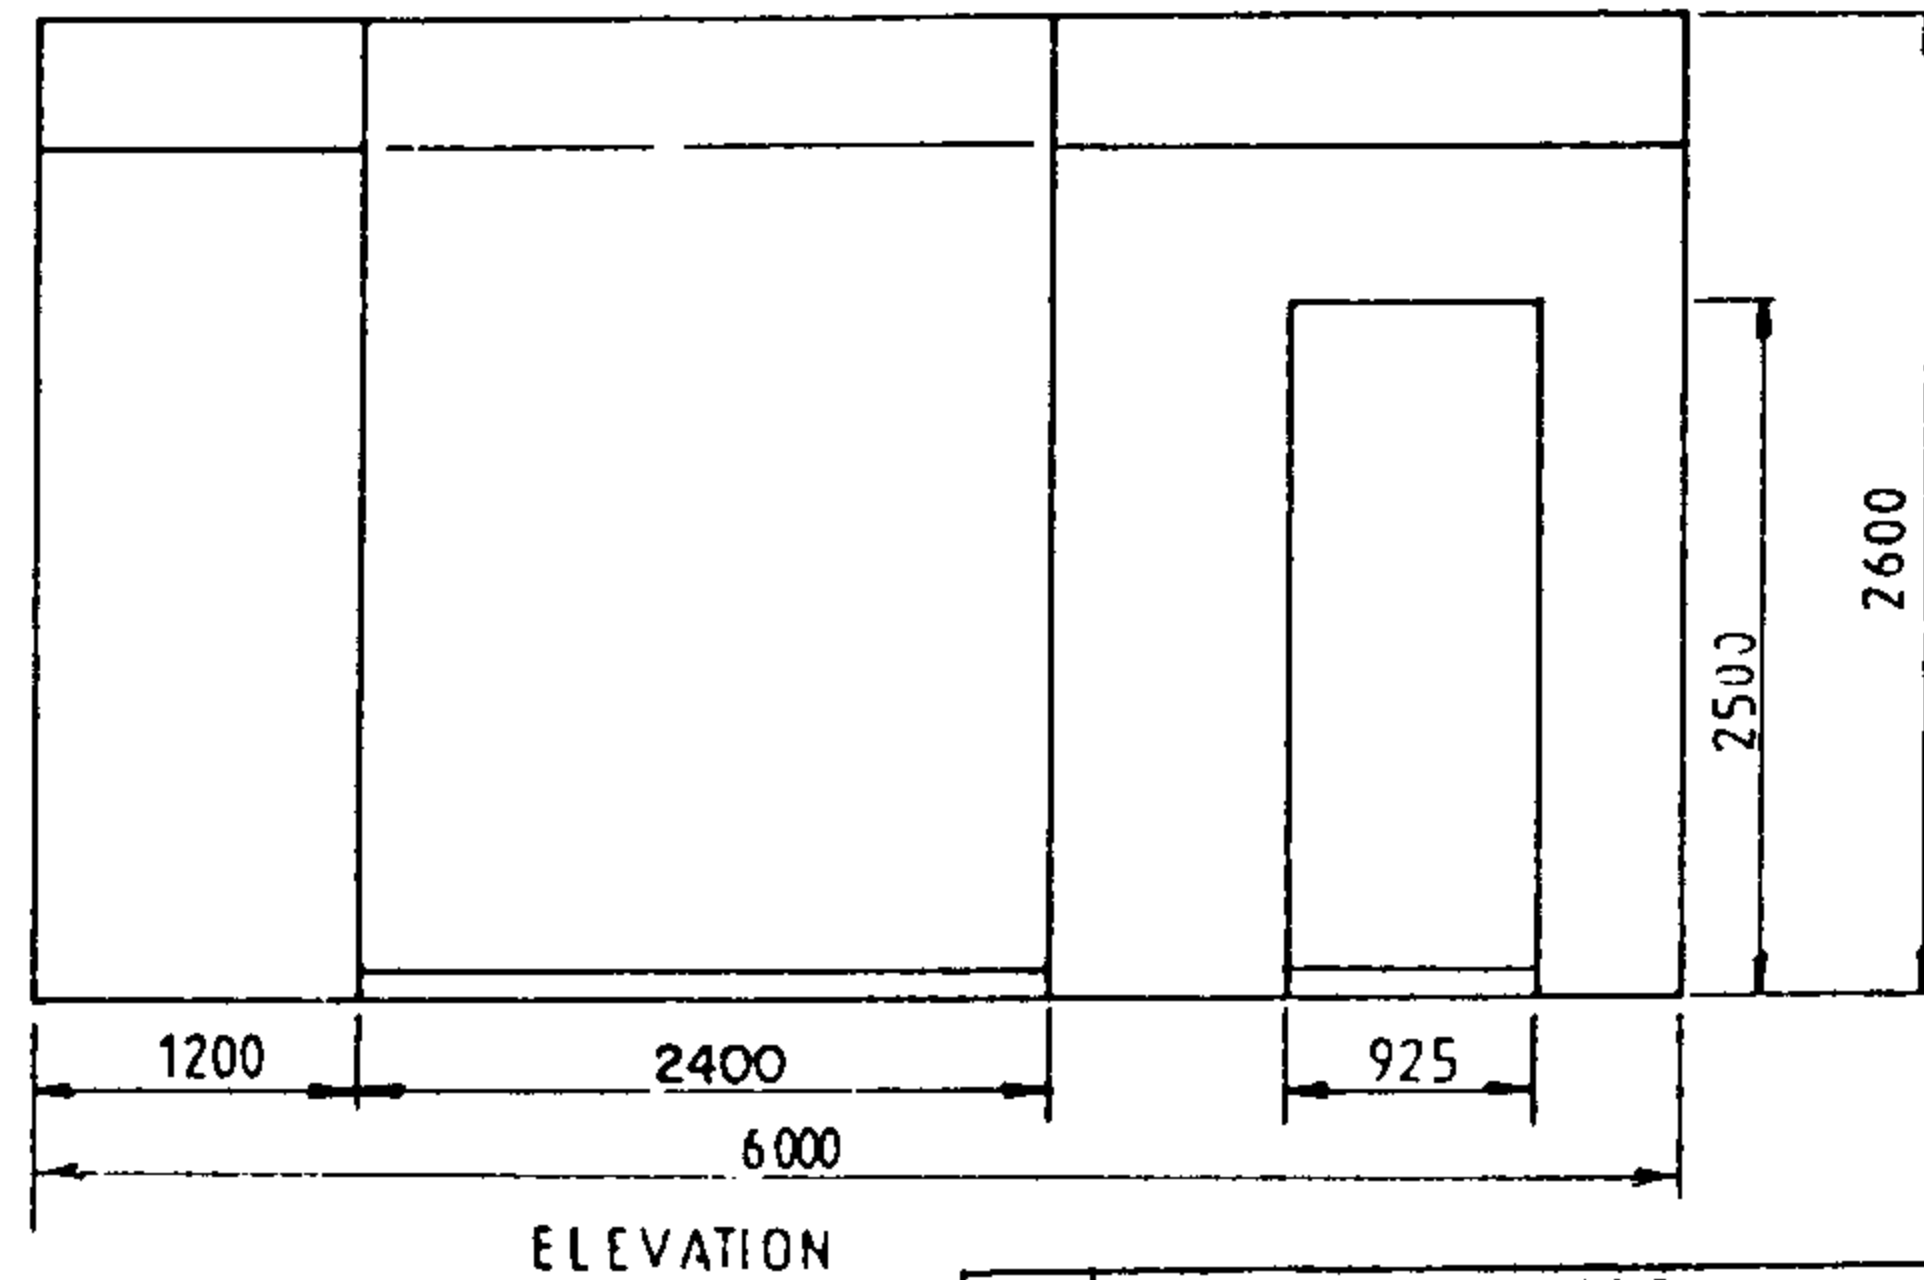
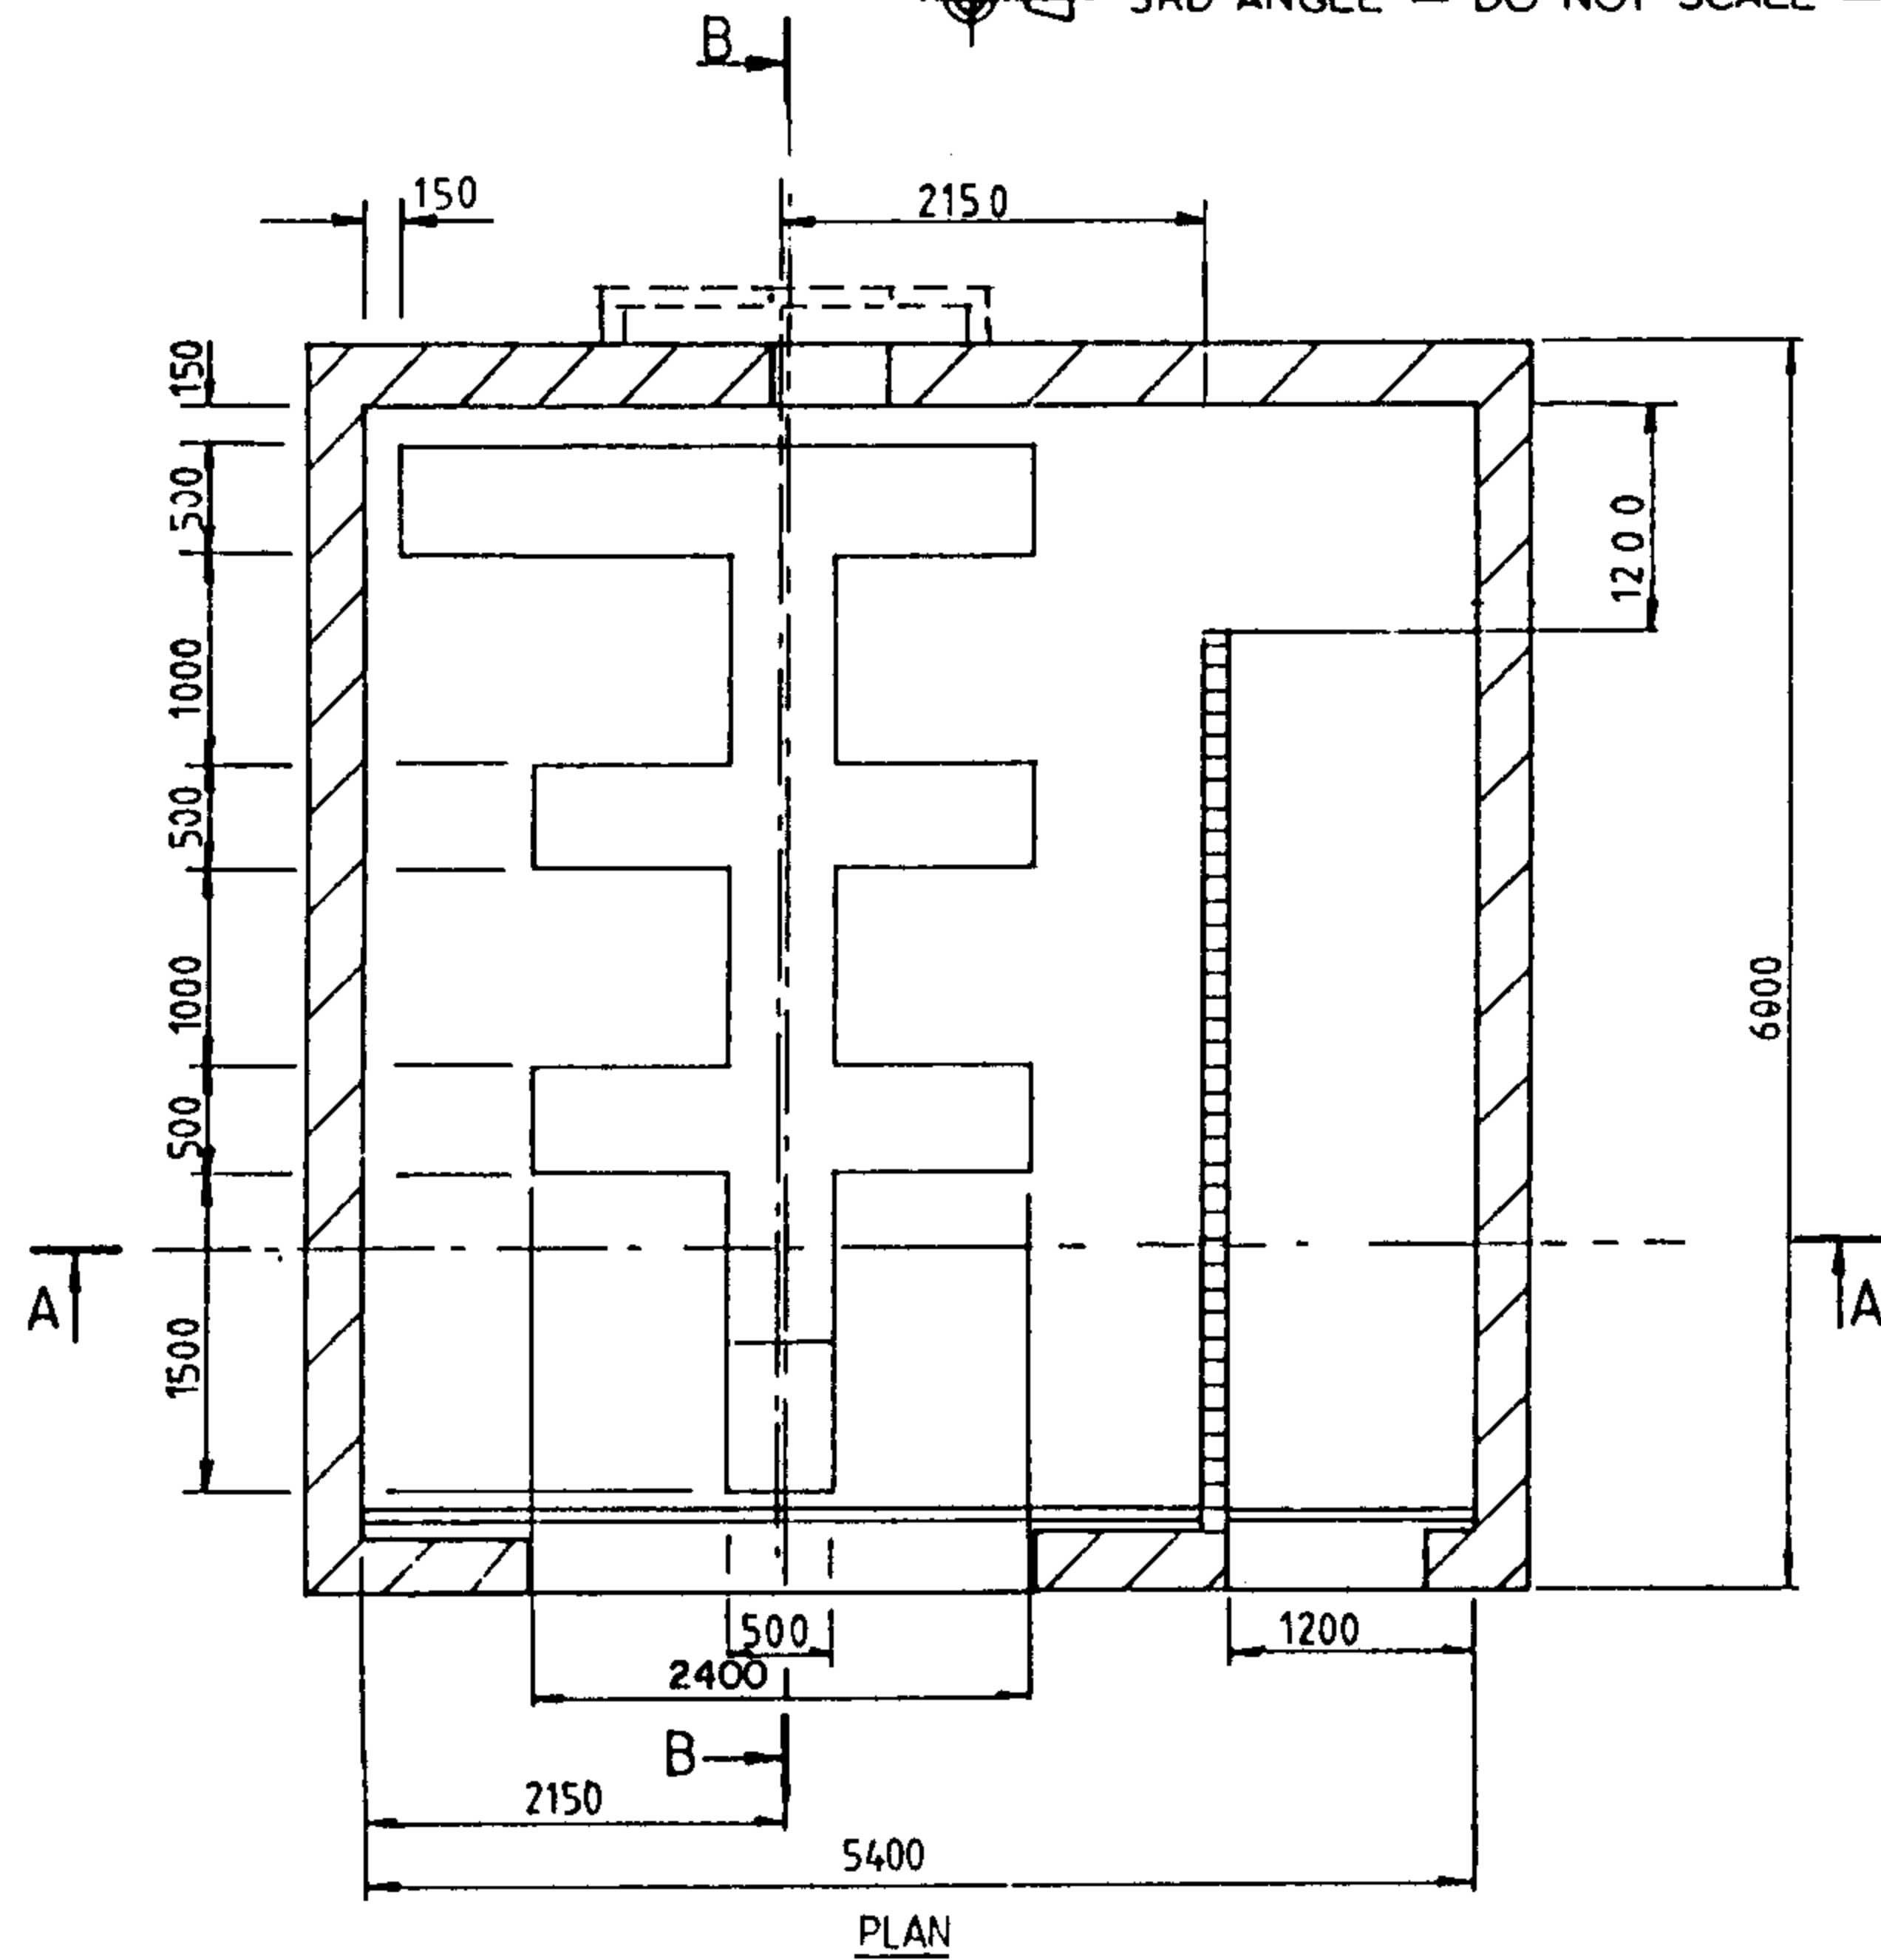


3RD ANGLE — DO NOT SCALE — REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

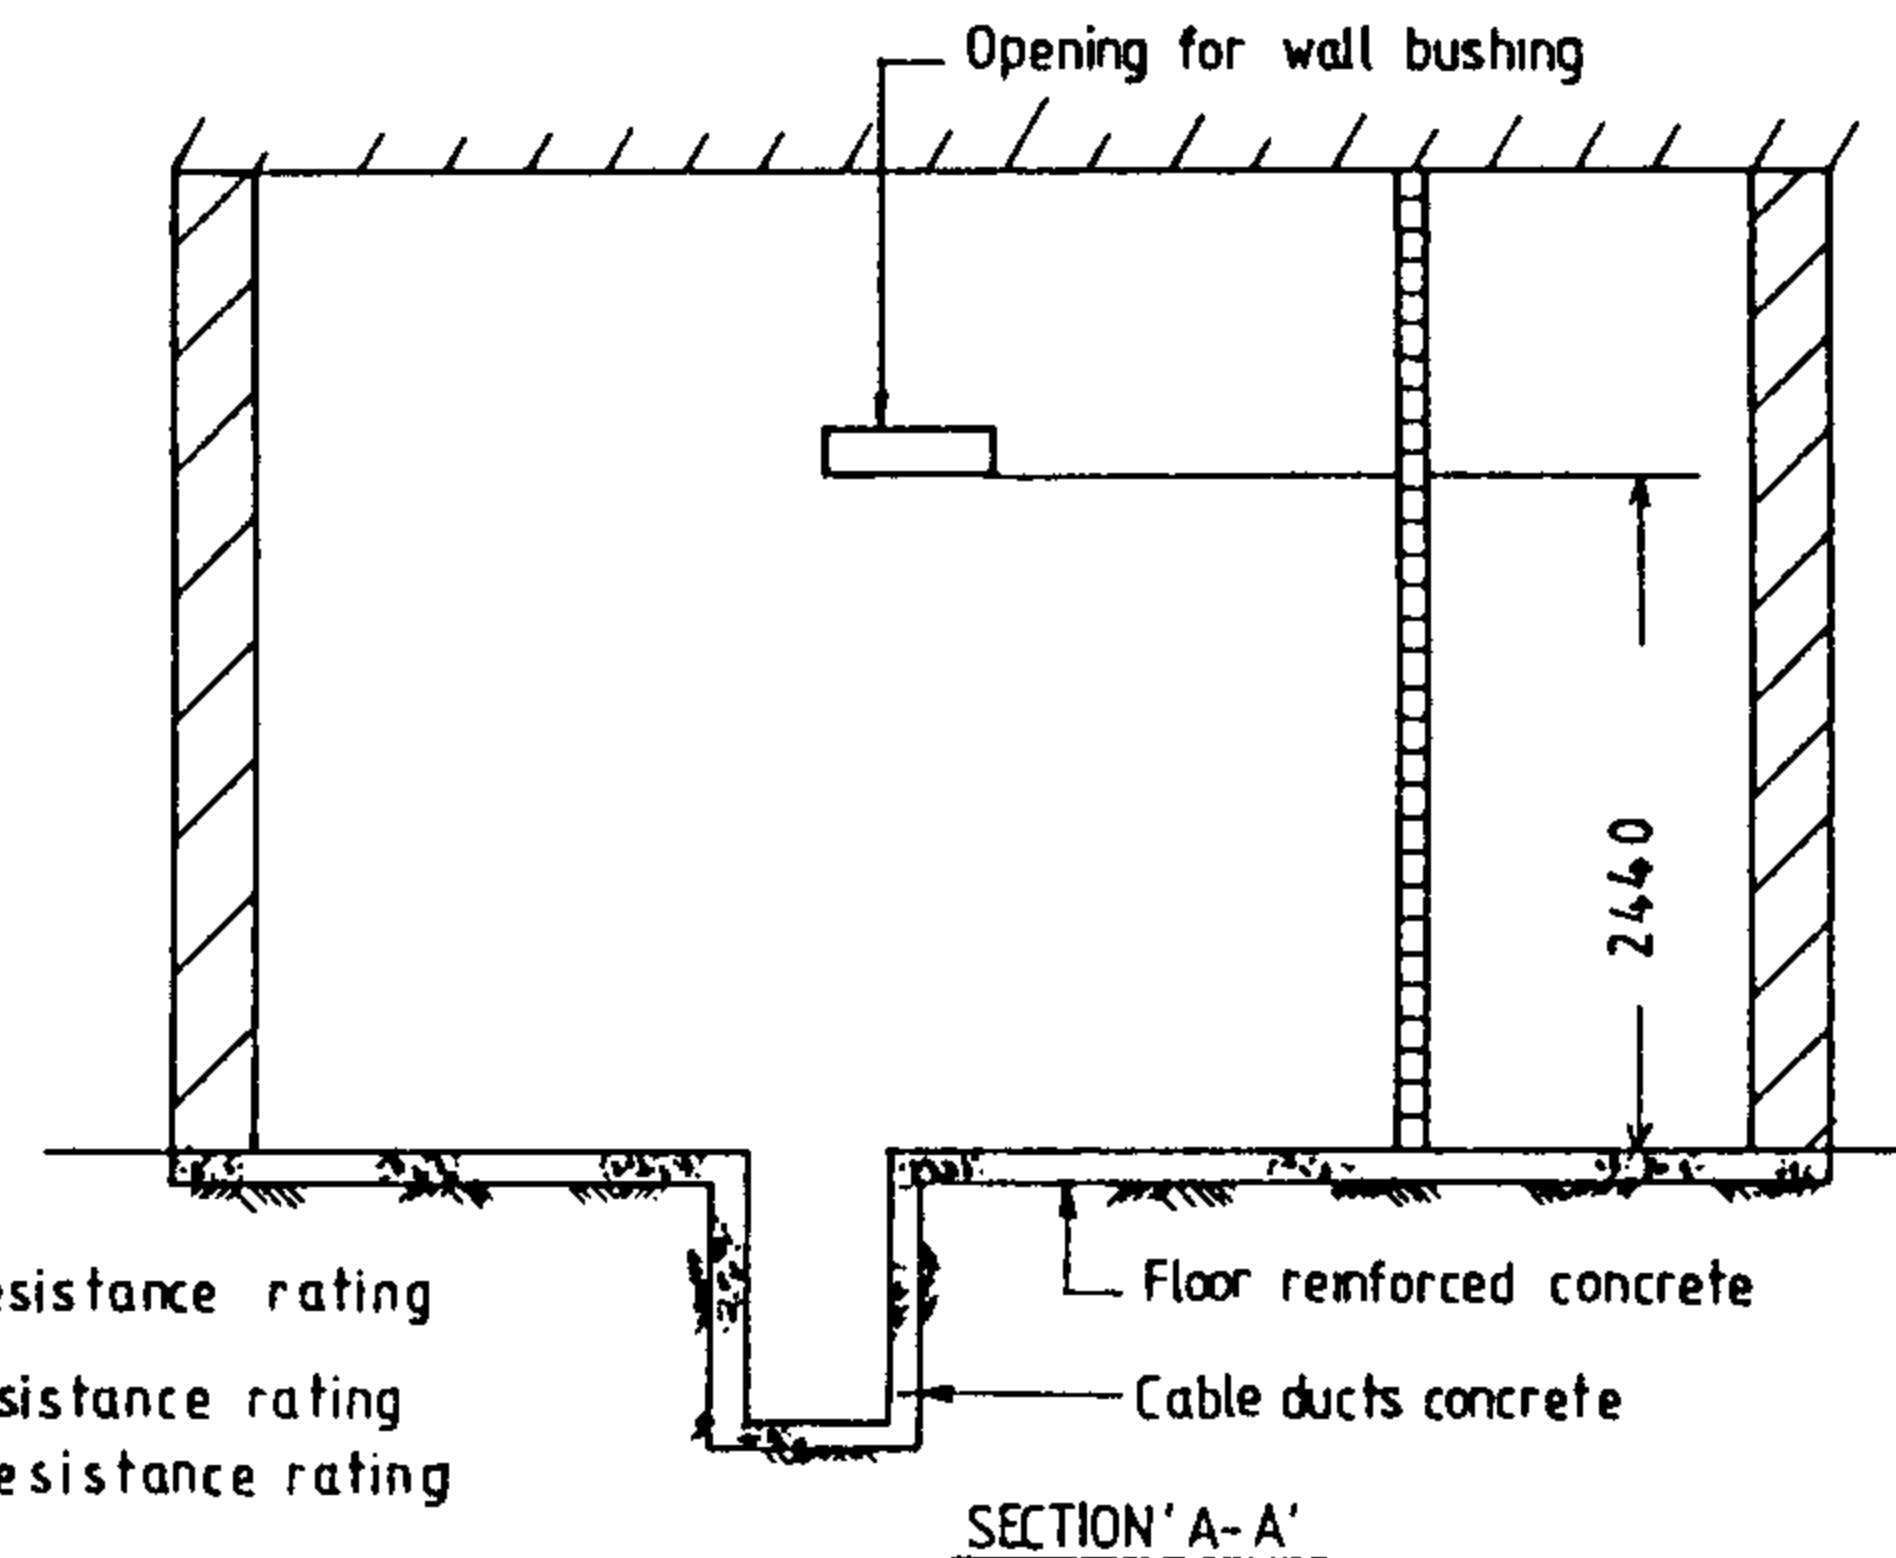


LEGEND
 4 Hour fire resistance rating
 1 Hour fire resistance rating
 4 Hour fire resistance rating

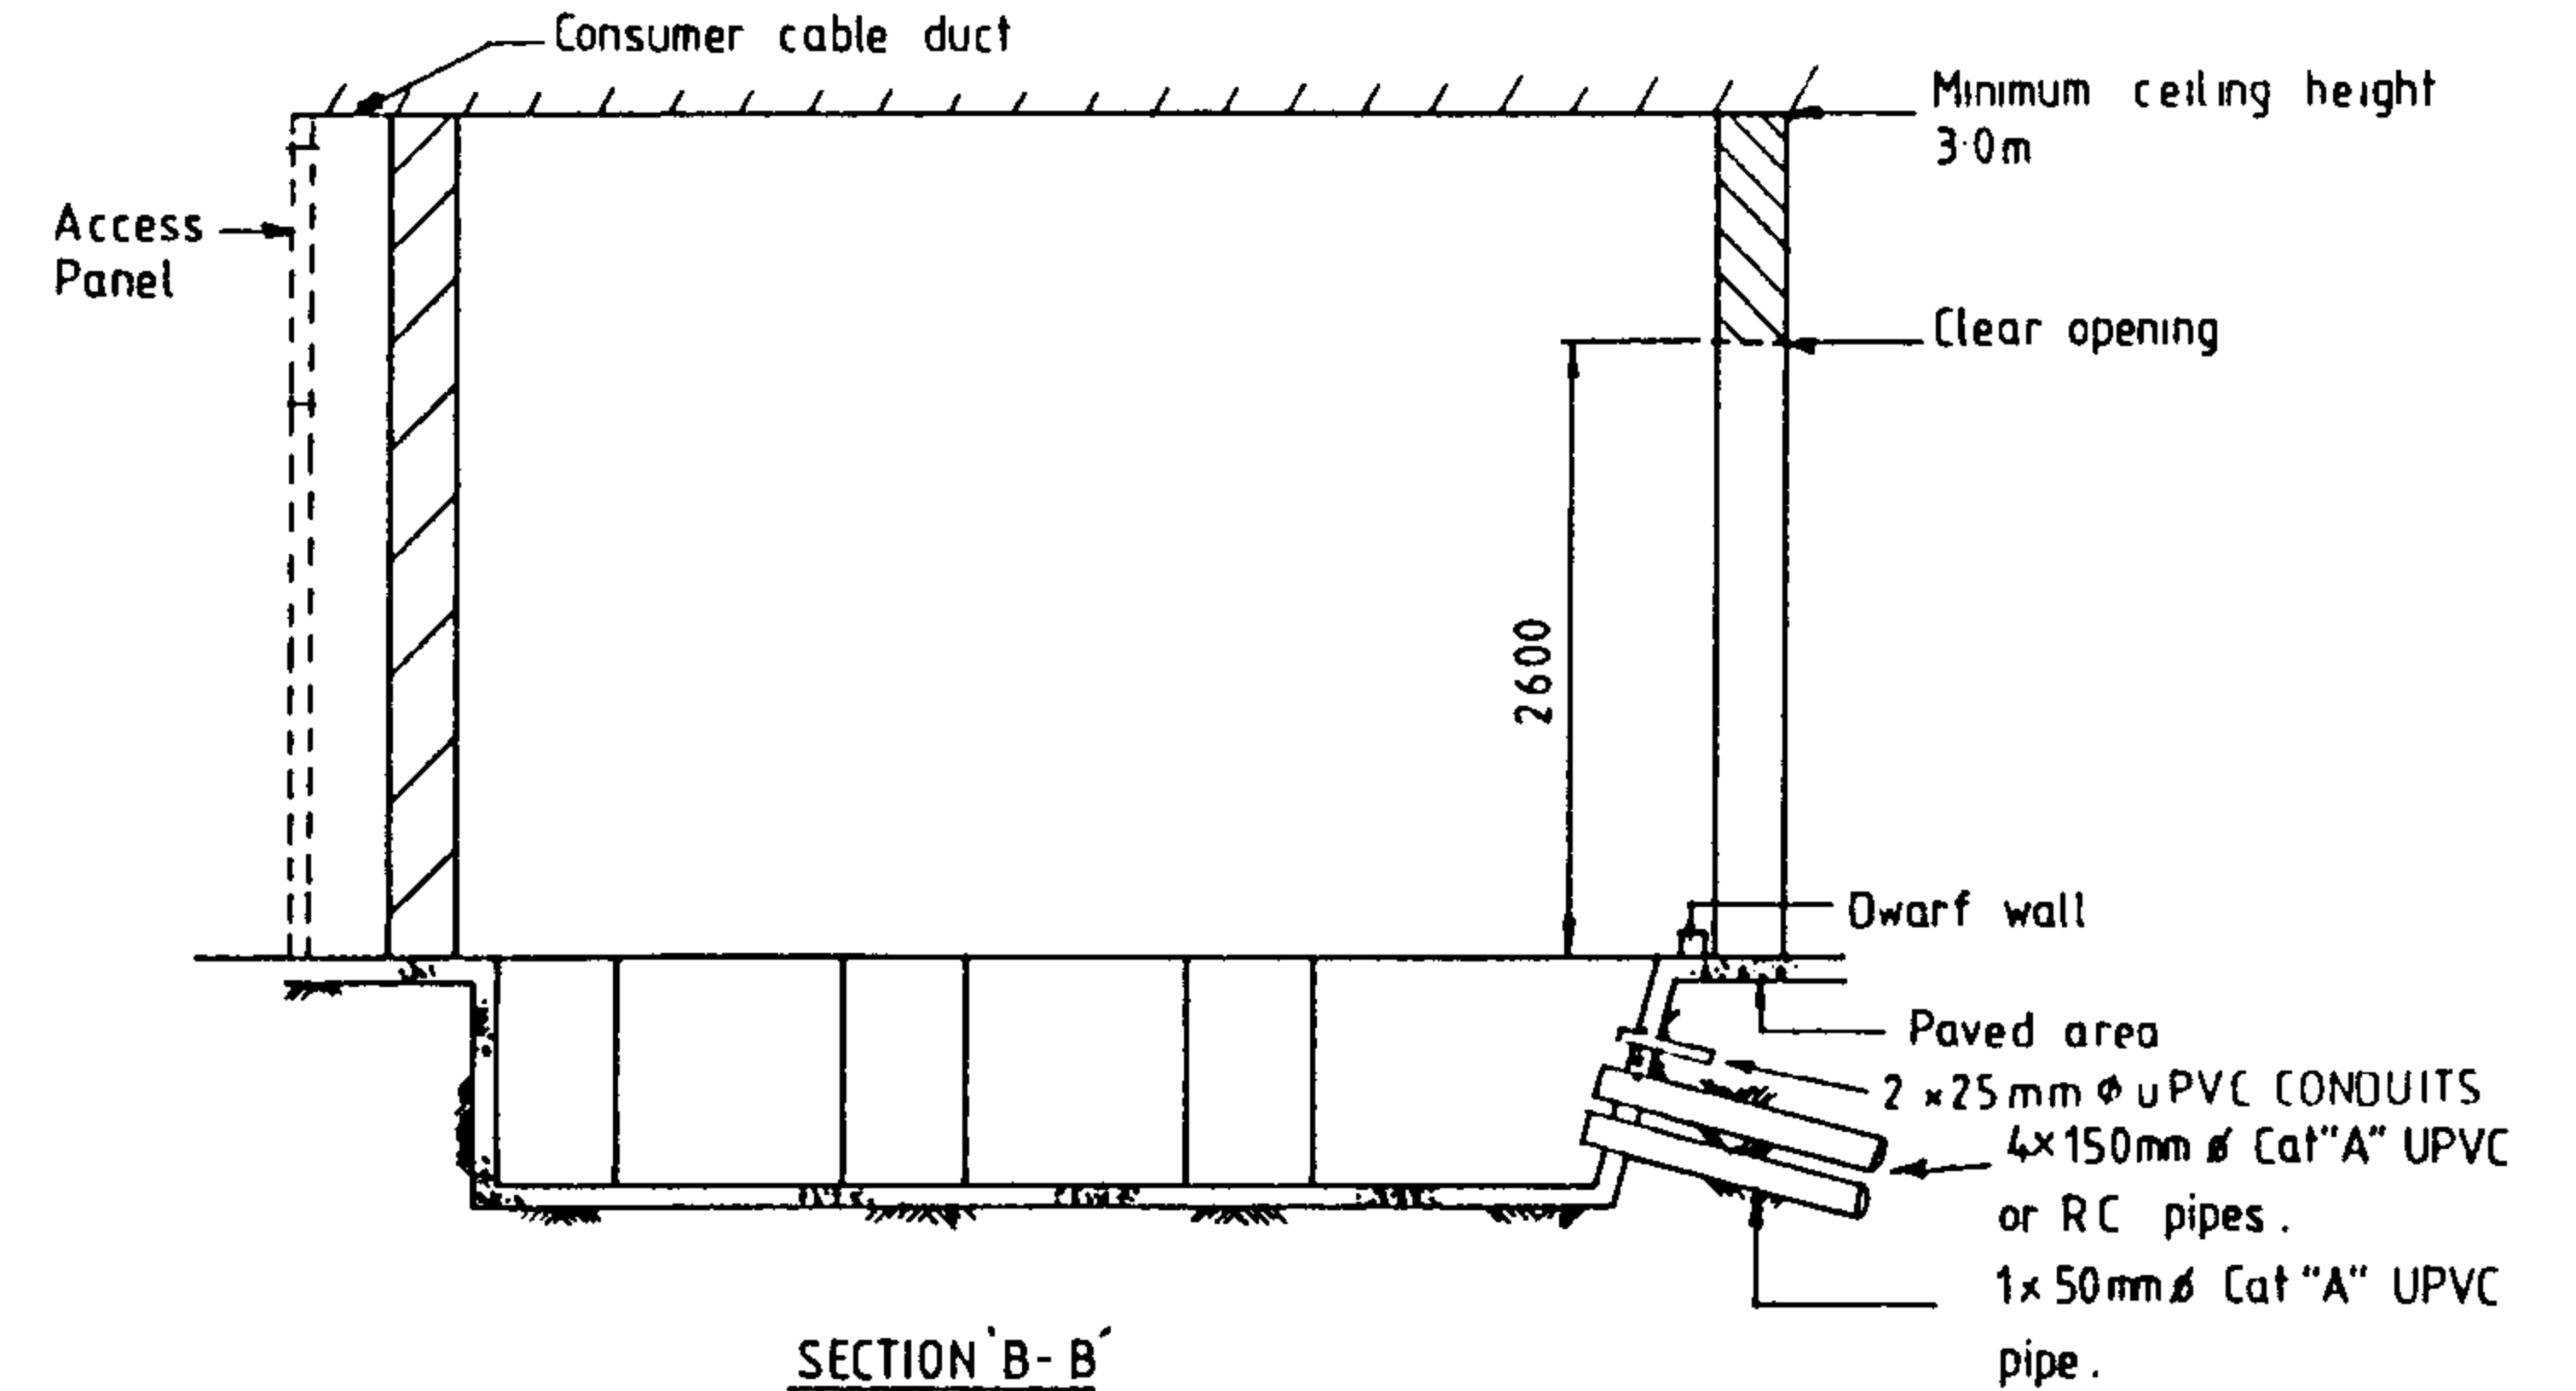

- NOTES**
1. FILLING OF HOLLOW CORE BLOCKS TO ACHIEVE 4HR. RATING TO BE SUPERVISED BY PAWA.
 2. REFER TO Drg NO S2-2-6-15 FOR RELEVANT CONSTRUCTION NOTES.

POWER AND WATER AUTHORITY

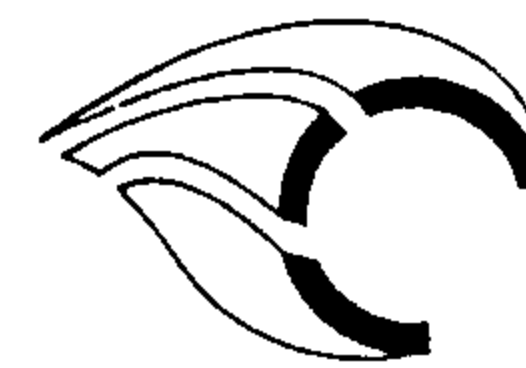

POWER DIRECTORATE

DES J. HASSANEN N T STANDARD DRAWING

DRN R. BUZZO

CKD *[Signature]*

APPD *[Signature]*

ISSUED 5.2.86

DRAFTING STANDARD TO A.S. 1100

ALL DIM. IN mm

TITLE CIVIL
 INDOOR SUBSTATION
 1000kVA MAXIMUM
 CONSTRUCTION DETAILS

A3

DRAWING NUMBER S2-2-6-13

SCALE N.T.S.

SHEET



AMDT.

7	25 mm CONDUITS ADDED		
6	TRENCH LAYOUT AMENDED	<i>[Signature]</i>	3/90

5	DIMENSIONS ALTERED	12/89	M.P.
4	TITLE & Drg NUMBER CHANGED	5/88	<i>[Signature]</i>
3	DIMENSIONS ALTERED	4/86	R.P.P.