
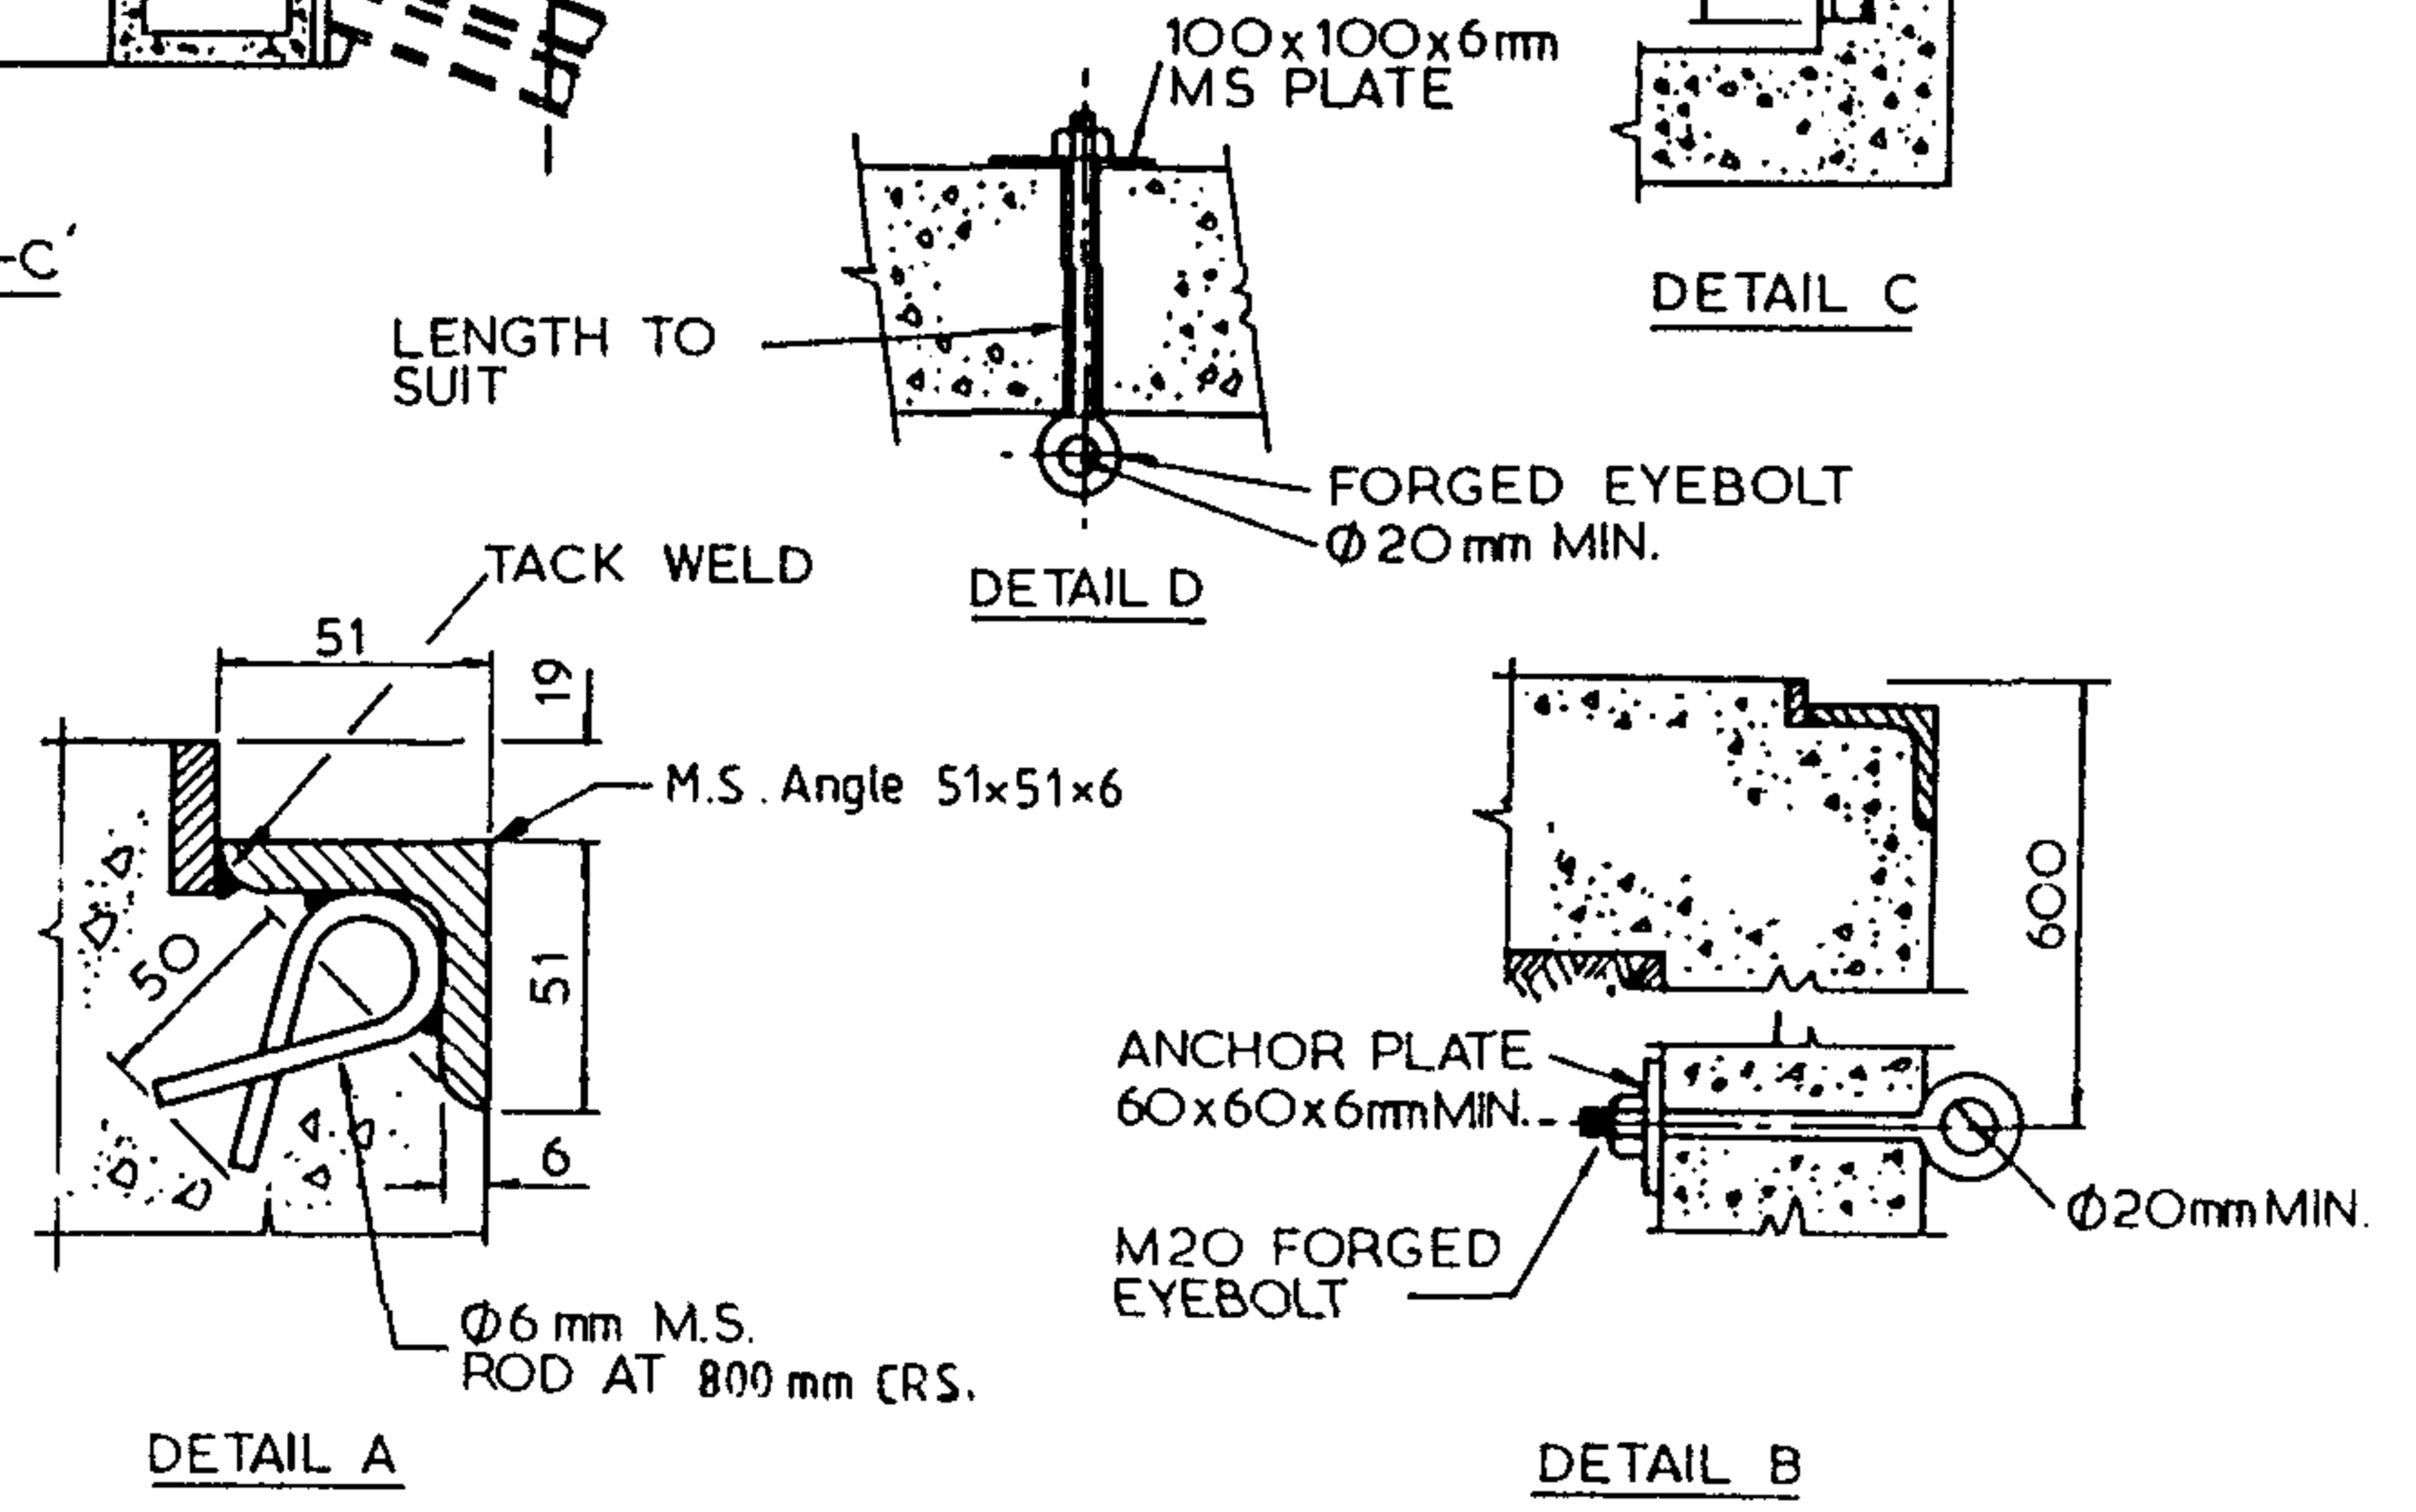
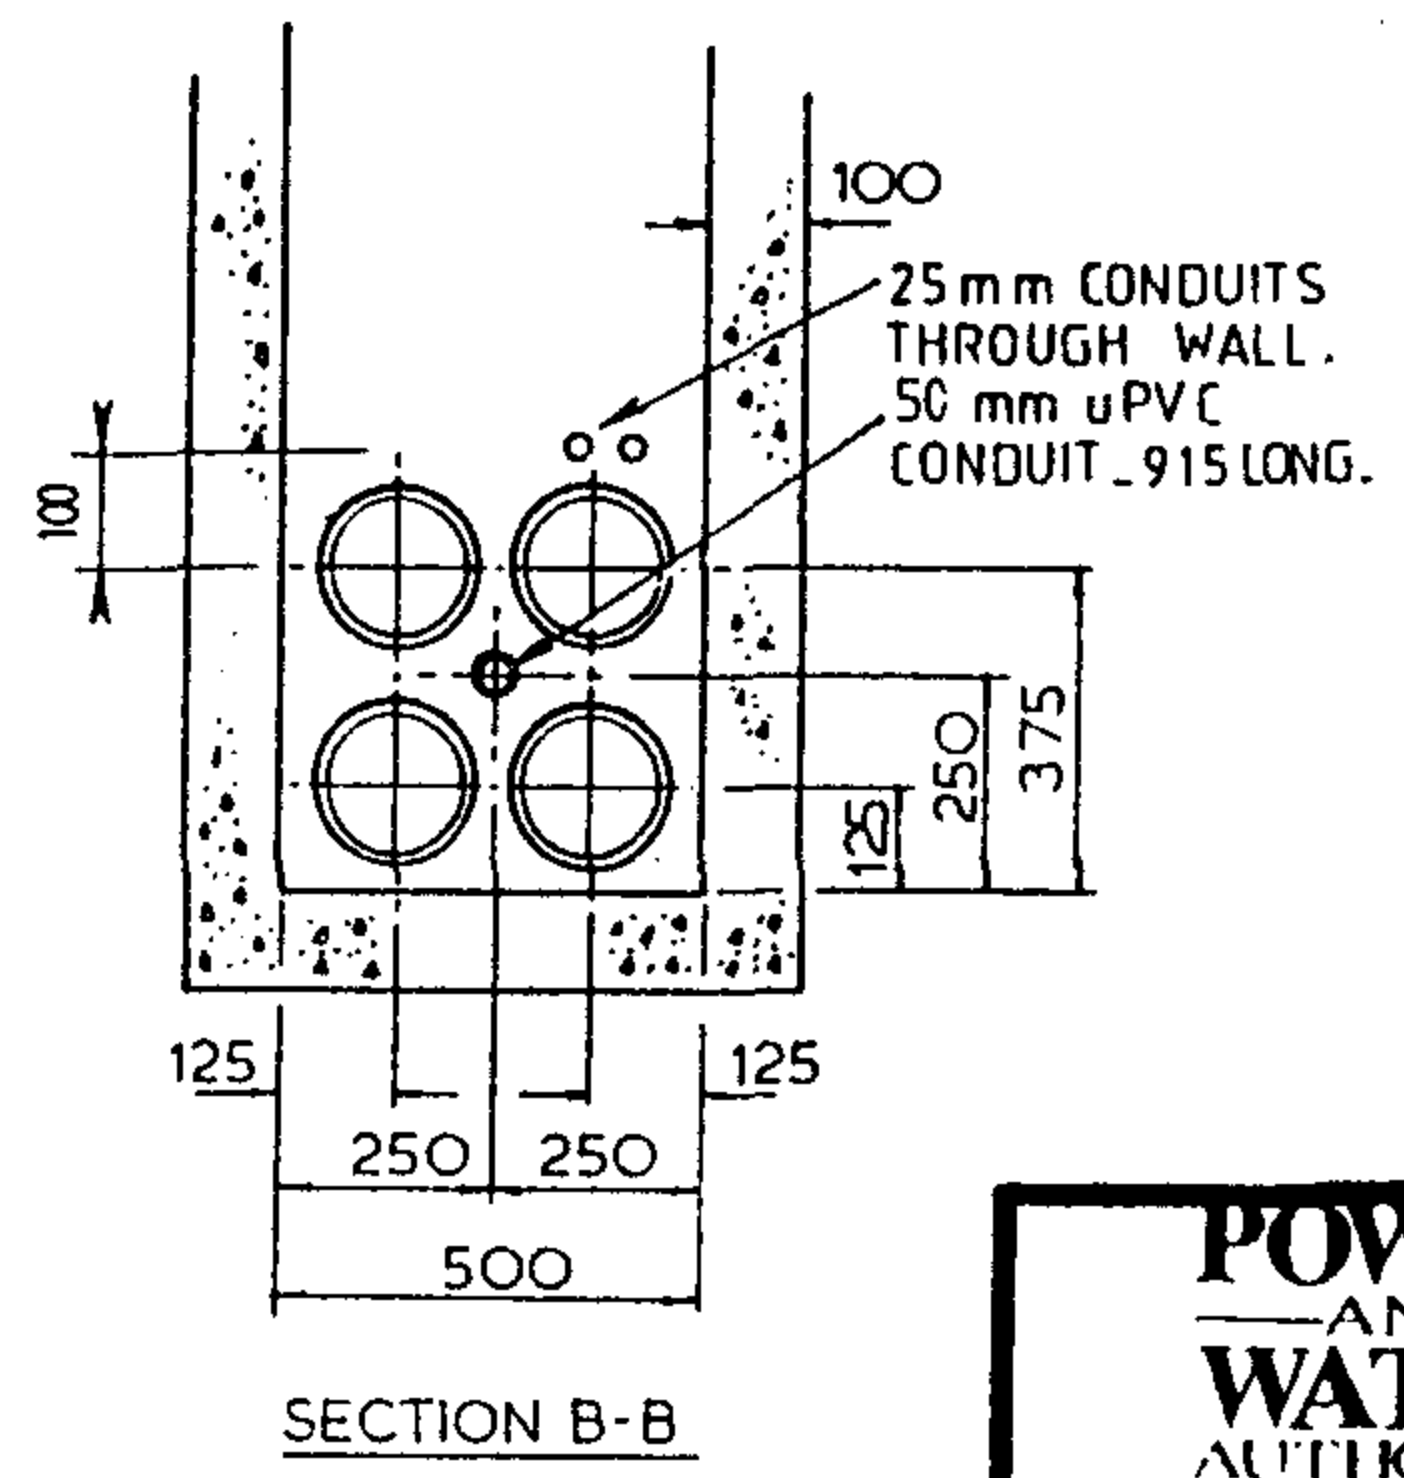
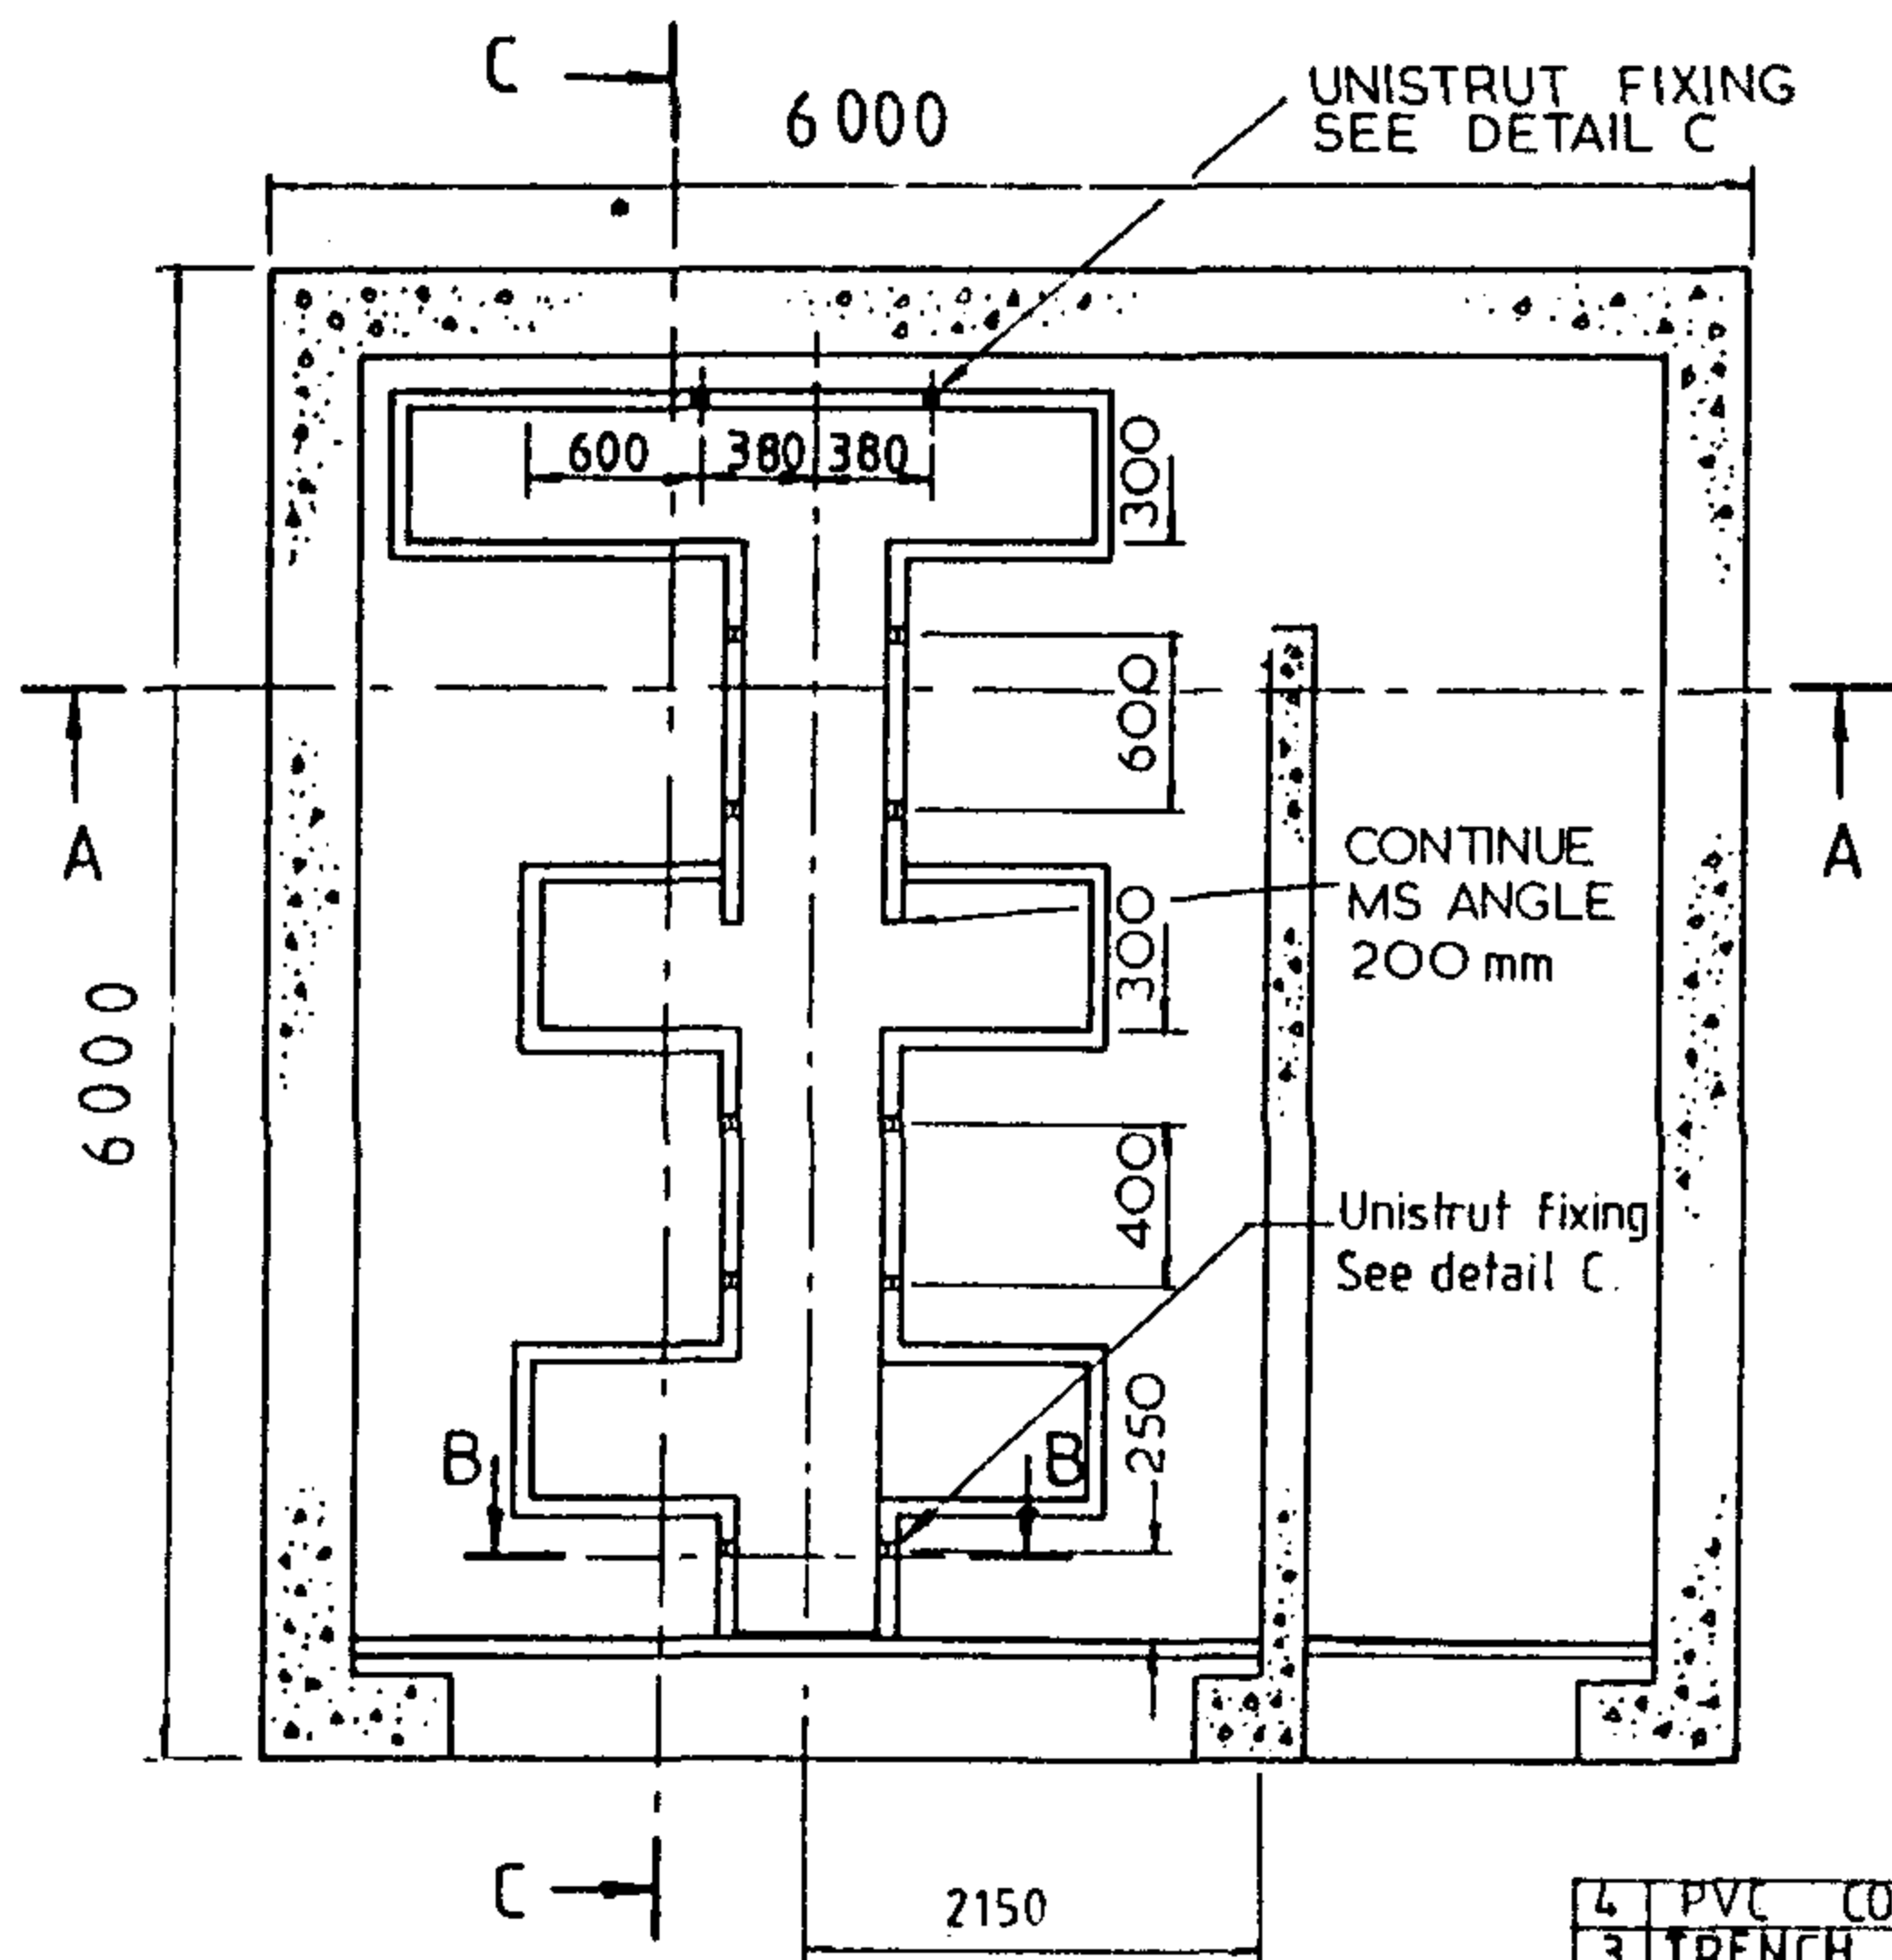
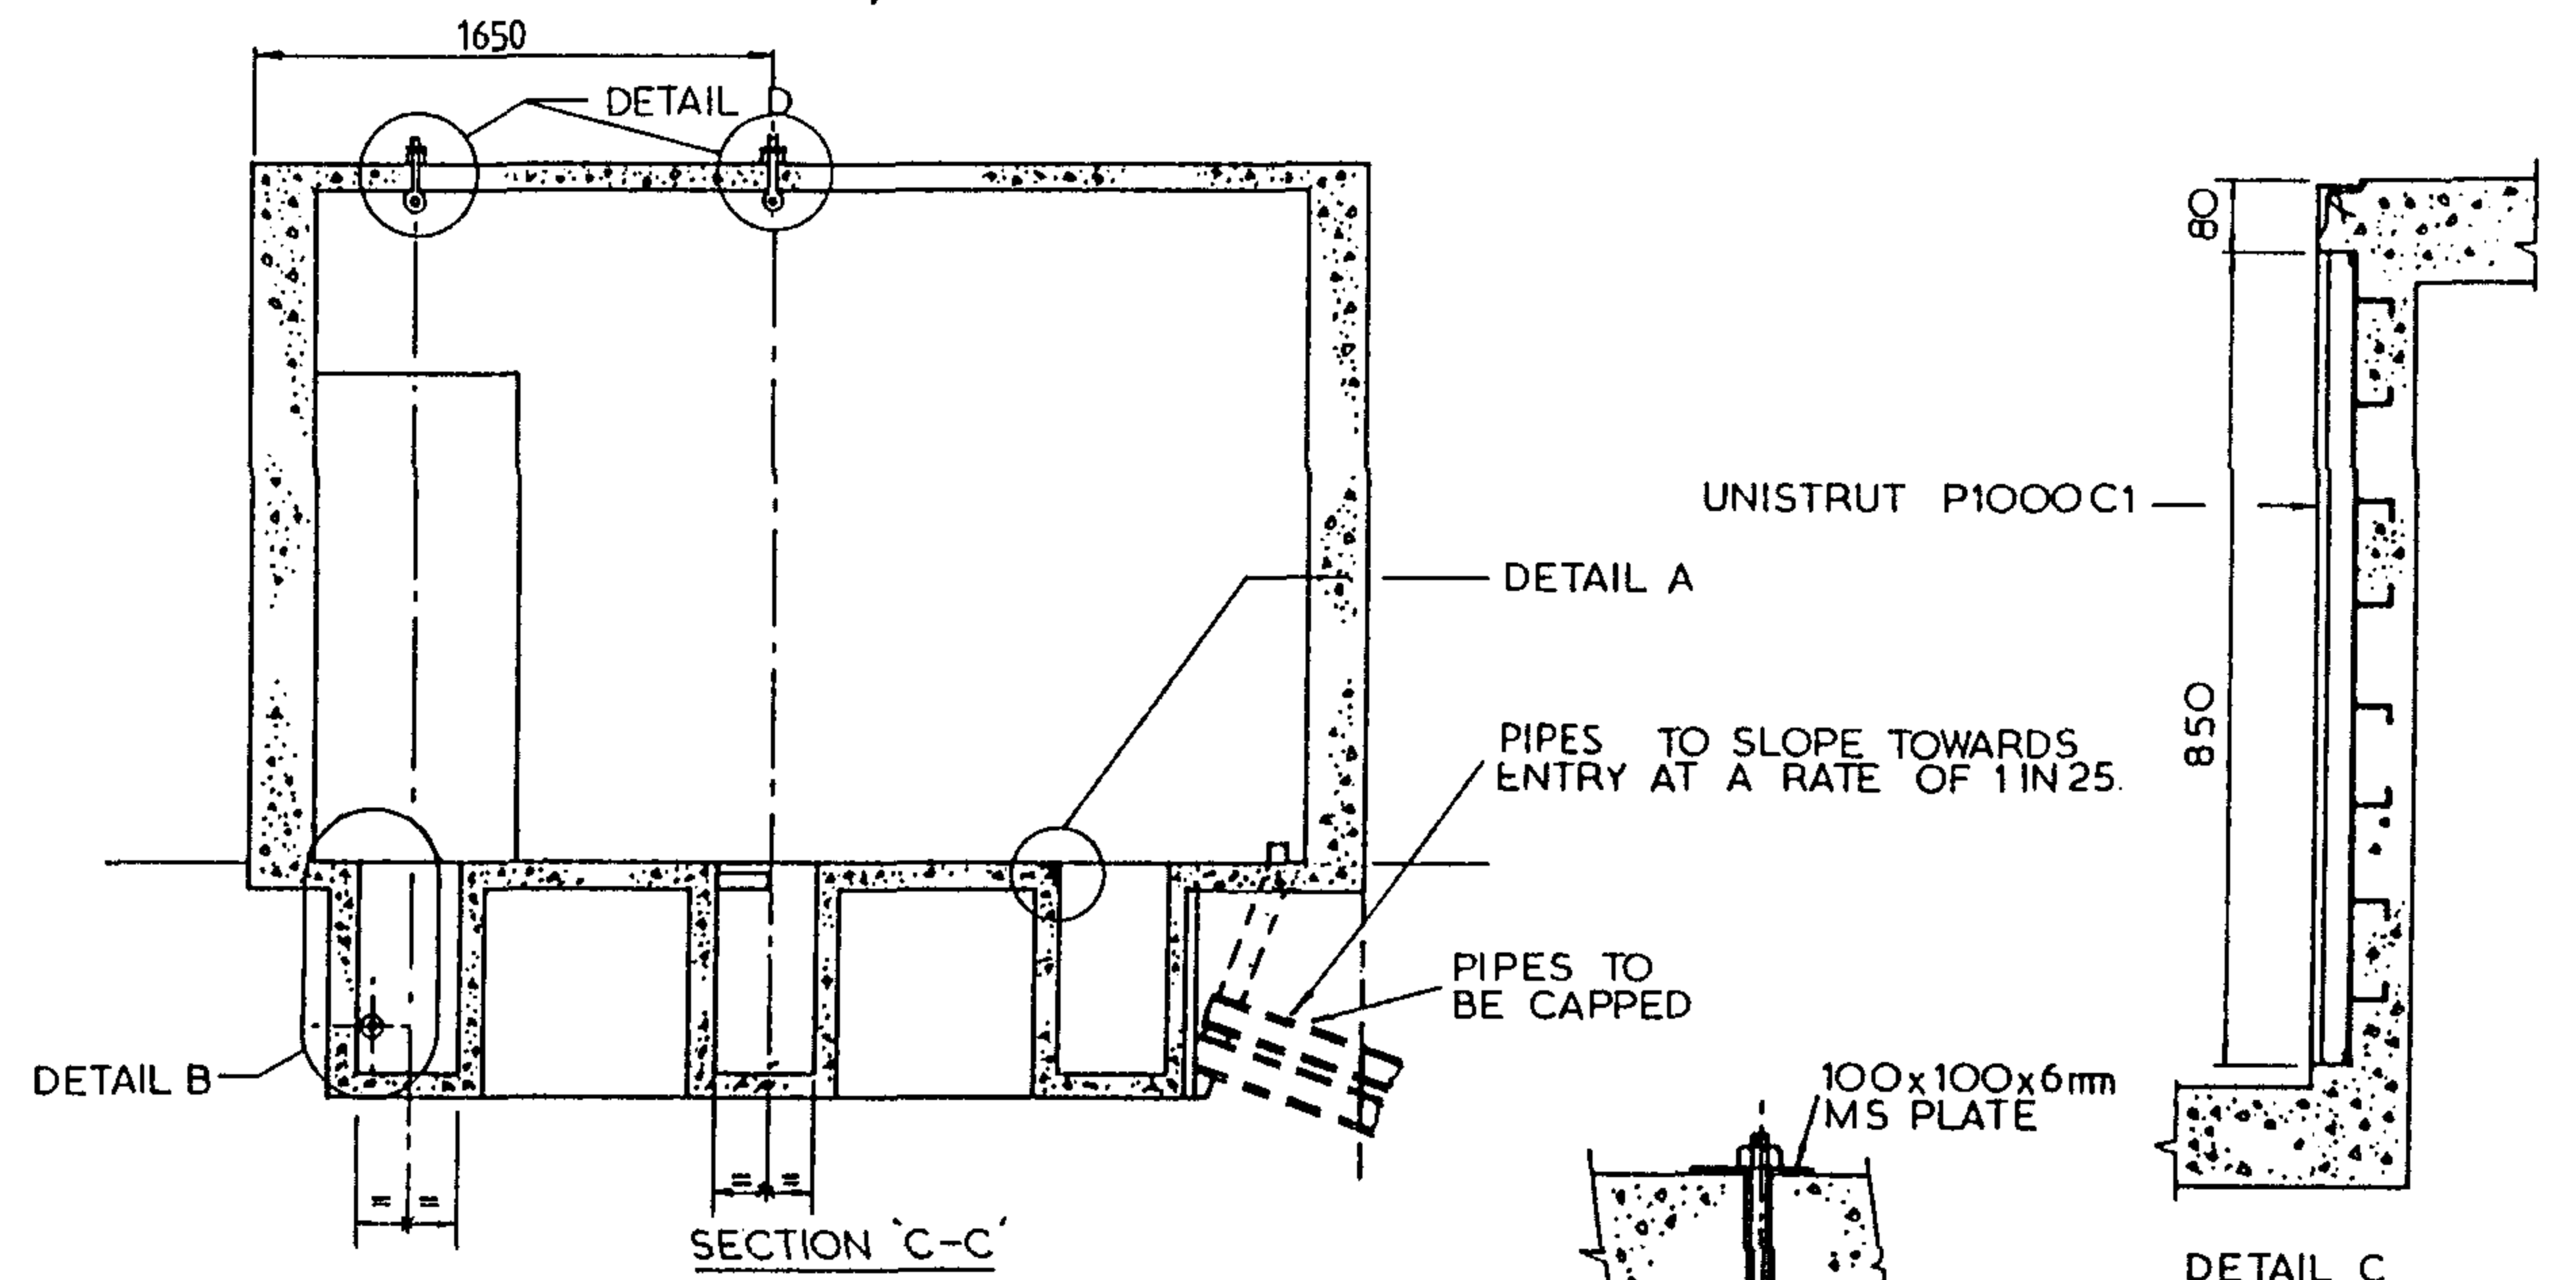


3RD ANGLE -- DO NOT SCALE -- REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

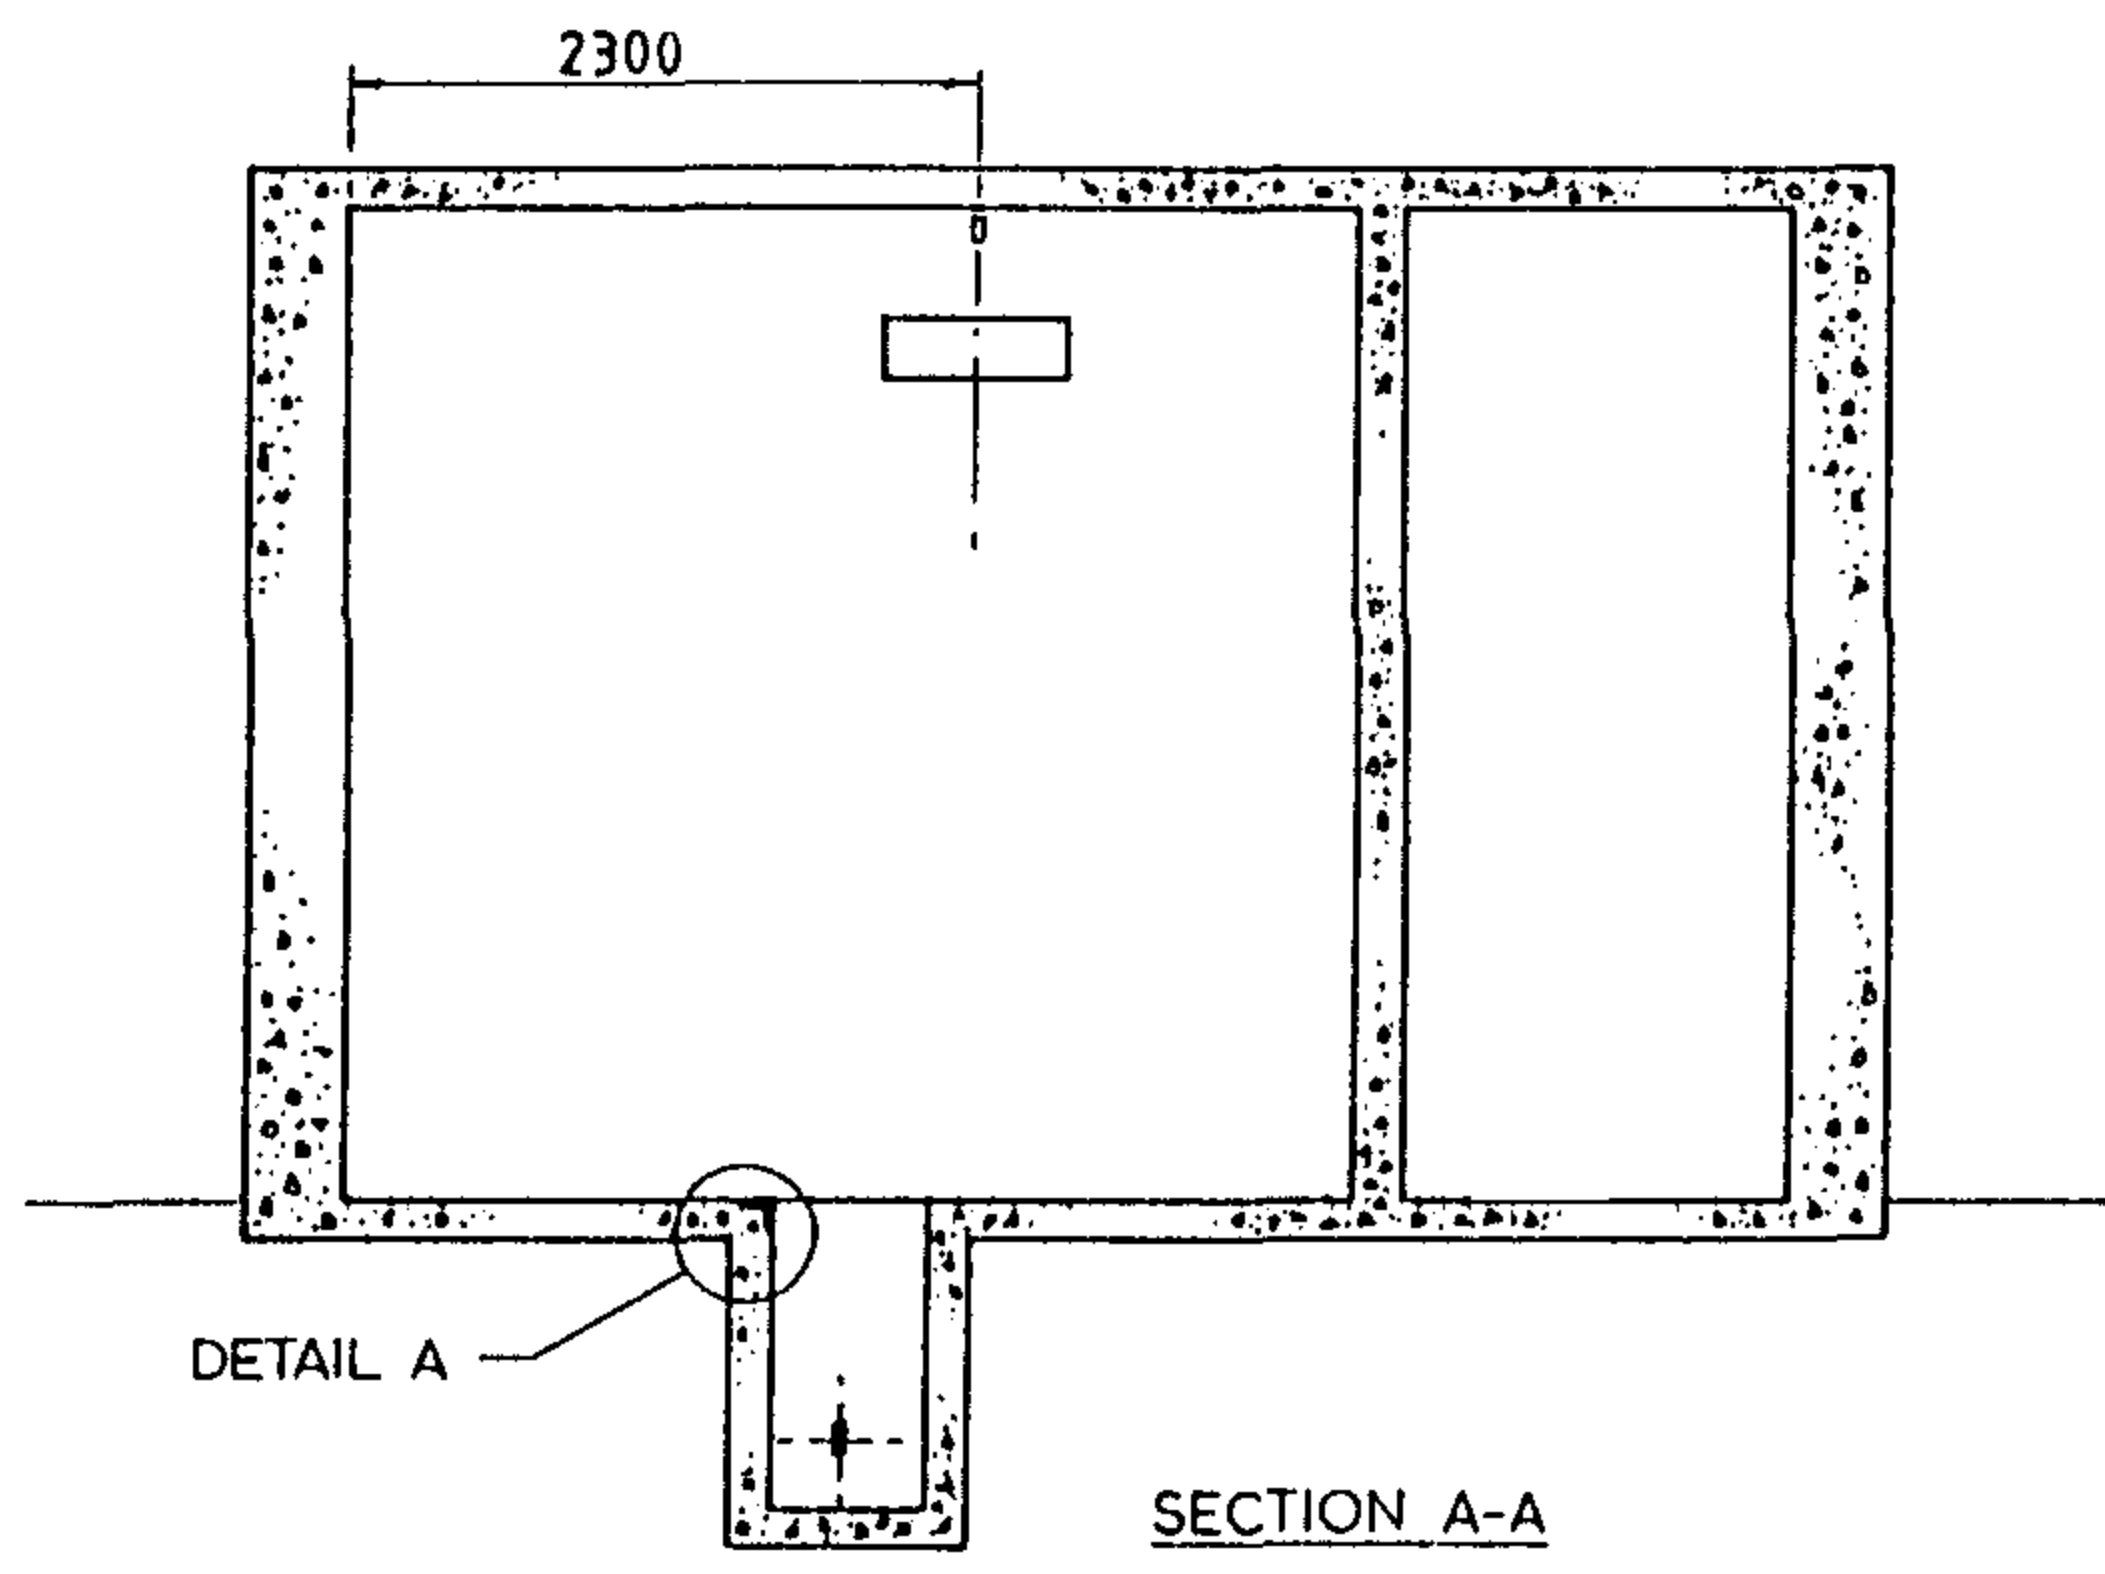

NO	DESCRIPTION	DATE	INIT.
4	PVC CONDUITS ADDED	10/91	g.l.
3	TRENCH LAYOUT AMENDED	6/88	84
2	TITLE & Drg NUMBER CHANGED	6/88	223
1	BLIND WALL MOVED TO OUTSIDE EXTER.	5/88	RPP

<p>POWER AND WATER AUTHORITY</p>	DES J. HASSANEN	N T STANDARD DRAWING	
	DRN R. HAIGH	TITLE	CIVIL
	CKD <i>[Signature]</i>	INDOOR SUBSTATION	
	APPD <i>[Signature]</i>	DUCTS, DRAINAGE & UNISTRUTS	
ISSUED 5.2.86	ARRANGEMENT & DETAILS		
DRAFTING STANDARD TO A.S. 1100	A3	DRAWING NUMBER	S2-2-6-14
ALL DIM. IN mm	SCALE	N.T.S.	SHEET
POWER DIRECTORATE			AMDT. 4