


- NOTES:**
1. PRE CAST PIT LID HAVE LIFTING LUGS AT EACH CORNER.
  2. AN EARTH COPPER CONDUCTOR WILL BE LAID COVERED WITH MIN. 50mm SAND.
  3. A CEMENT STABILIZED SAND BACKFILL SHALL BE PLACED BETWEEN CONDUITS. CONDUITS TO BE SPACED A MINIMUM OF 50mm FROM EACH OTHER. WITH COMMUNICATION CONDUITS 100mm FROM ANY POWER CONDUITS. OTHER UNDERGROUND SERVICES SHALL BE SPACED 100mm APART. (AS/NZS 3000:2000 Clause 3.11.4 )



0	ISSUED FOR CONSTRUCTION	K.I.	AUG'05	R.C.	C.C.
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					

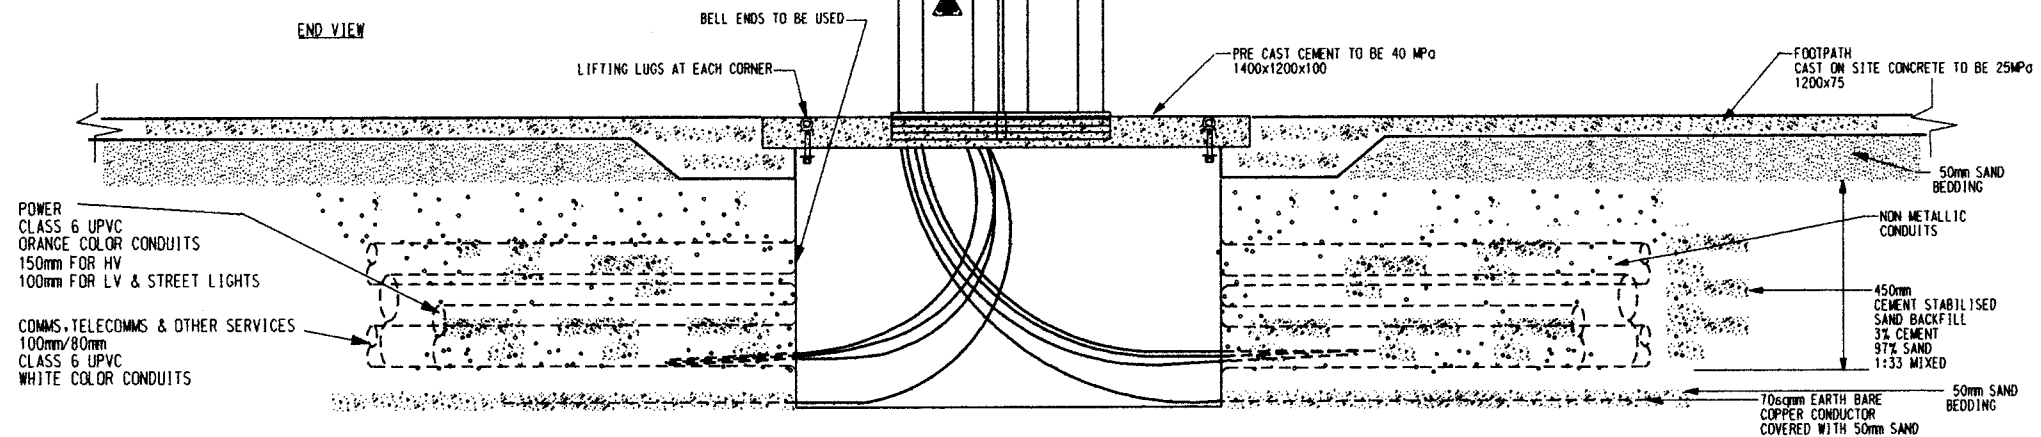

DES	R. CLEOPAS
DRN	K.I. / R.C.
CKD	C. CAMILLERI
APPD	C. CAMILLERI
SCALE	NTS
ISSUED	JUNE'05
ALL DIM.	IN mm
DRAFTING STANDARD TO A.S.1100	

<b>POWER STANDARD DRAWING</b>	
<b>CIVIL TRENCH SECTION IN FOOTPATH CONCRETE ENCASED</b>	
A3	DRAWING NUMBER S02-2-6-26
DRAFTING STANDARD TO A.S.1100 CAD PRODUCT - DO NOT AMEND MANUALLY	

