


NOTES:

1. THIS APPLICATION IS TO BE USED IN THE FOLLOWING:
 - A. TELECOM TELEPHONE CABINETS.
 - B. BUS SHELTERS (SUPPLY TO BE FUSED ON POLE).
 - C. OTHER APPLICATIONS AS APPROVED BY POWER AND WATER.
2. CONSUMER TO MAKE APPLICATION FOR ELECTRICITY SUPPLY PRIOR TO INSTALLATION.
3. ALL WORK TO BE CARRIED OUT IN ACCORDANCE WITH S.A.A. WIRING RULES AND POWER AND WATER REGULATIONS.
4. BAKELITE BOX TO BE POSITIONED FACING AWAY FROM CARRIAGE WAY.

LINE POLE:

4	REDRAWN IN CAD	K. I.	FEB '05	R.C.	C.C.
3	TITLE & DRG No. CHANGED MEASUREMENT REDUCED	..	JUN '88
2	GENERAL REVISION	G.M.	OCT '85
1	REDRAWN & REVISED	T.R.	JAN '85
NO	DESCRIPTION	DRN	DATE	CKD	APPD
AMENDMENTS					

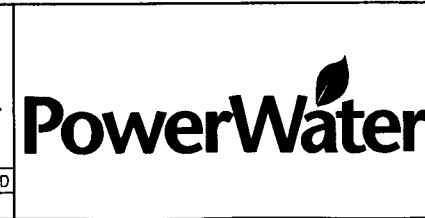

DES	R.HAIGH	POWER STANDARD DRAWING			
DRN	...	INSTALLATIONS			
CKD	...	UNMETERED SERVICE			
APPD	...	OVERHEAD MAINS TO UNDERGROUND MAINS			
SCALE	NTS	A3	DRAWING NUMBER	S02-2-1-01	4
ISSUED	FEB '86				
ALL DIM.	IN mm	DRAFTING STANDARD TO A.S.1100			CAD PRODUCT — DO NOT AMEND MANUALLY