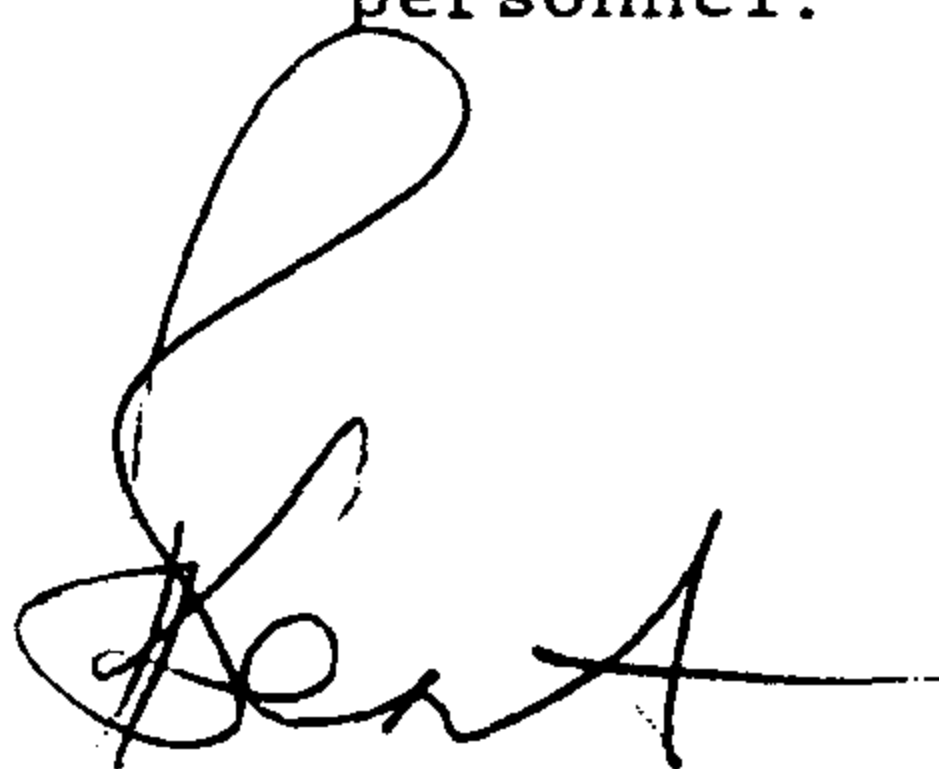


- 5) New modified three (3) phase operating handles are used for ganged three (3) phase switch assemblies.
- 6) It is making or breaking parallel feeders that are supplied from the same Zone Sub-station which has the Bus Tie C.B.'s closed.
- 7) It is energising or de-energising cables only.
i.e. All load removed

NOTE: a) Fully home indicators and poly-carbonate collars will be available from Standards Branch.

b) New three (3) phase handles have been issued to regional operational personnel.

A handwritten signature in black ink, appearing to read 'B. Kent', with a large loop at the top and a horizontal stroke at the bottom.

BRIAN KENT
STANDARDS MANAGER POWER