


3RD ANGLE — DO NOT SCALE — REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

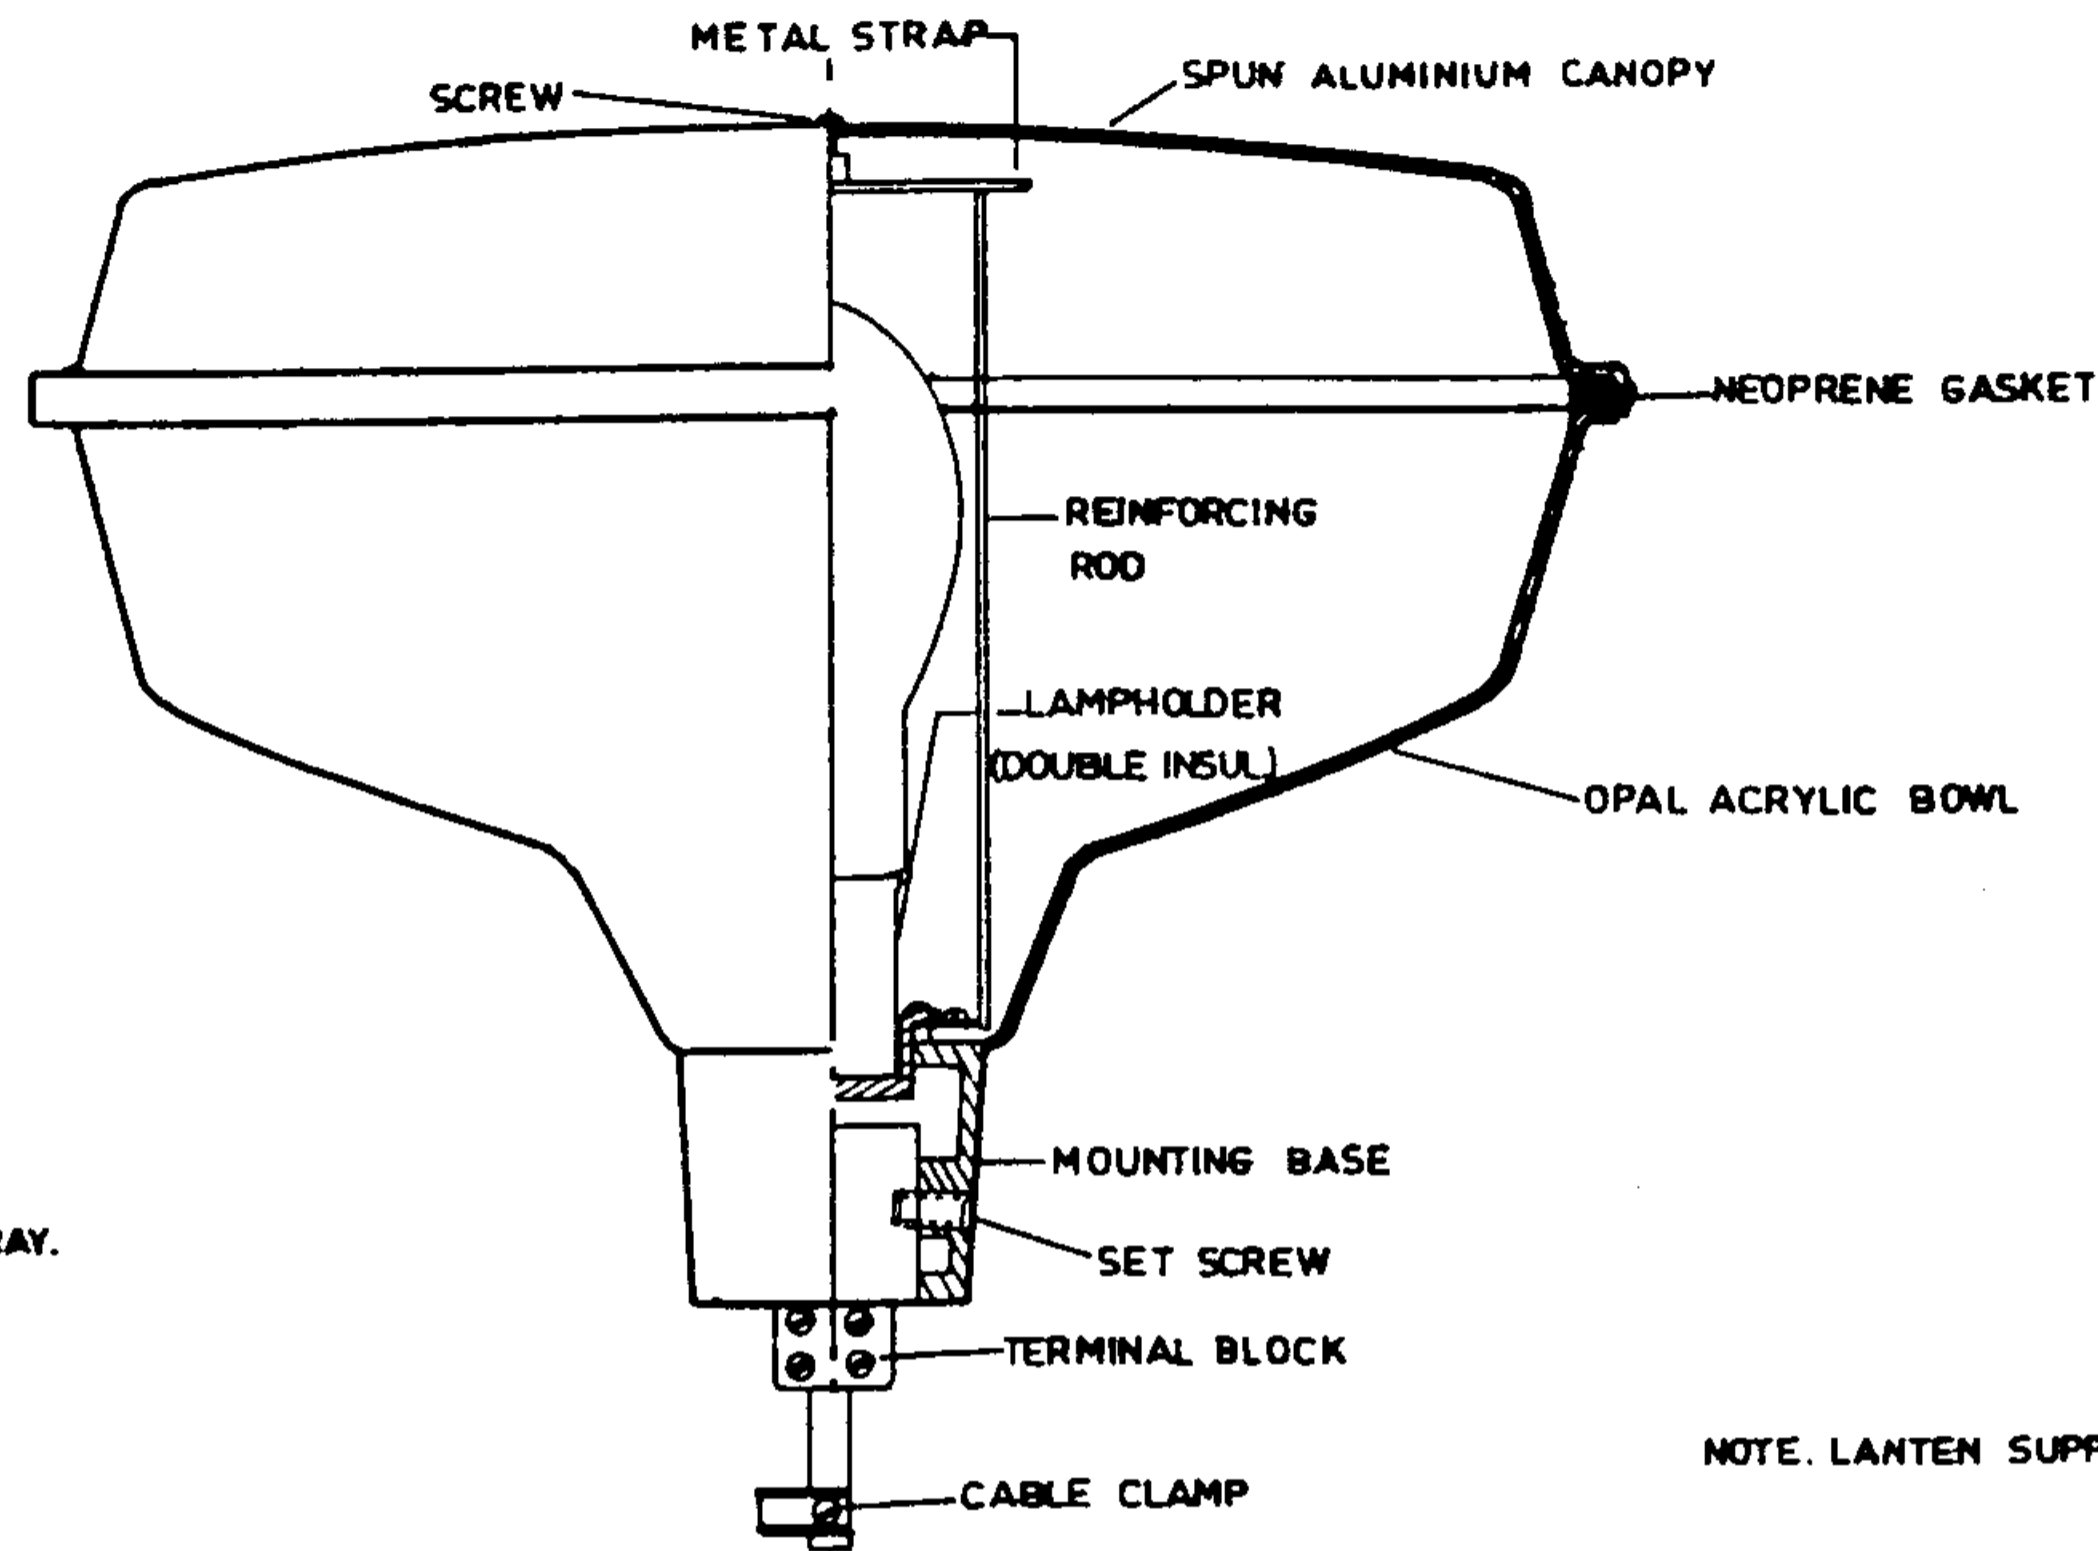

SPECIAL CRITERIA FOR N.T. PUBLIC LIGHTING LANTERNS:

1. DELETION OF BUILT-IN FUSE WITHIN LANTERN.
2. PROVISION OF REMOVABLE GEAR TRAY.
3. PROVISION OF QUICK DISCONNECT PLUGS BETWEEN BASE AND REMOVABLE TRAY. (SIMILAR TO UTILUX M/N 1542-2.)
4. EARTH ATTACHMENT TO BODY OF LANTERN.
5. LANTERN TO COMPLY WITH AS8771 FOR CATEGORY 'B' ROAD LUMINAIRES.

NOTE. LANTEN SUPPLIED LESS LAMP

MAINTENANCE PURPOSES ONLY

ITEM		STOCK CODE	GEC. CAT No.
1	COMPLETE FITTING	11718	Z 5602
2	BOWL	7104	—
3	LAMP (80W)	10389	—

				<p>POWER AND WATER AUTHORITY</p> <p>POWER DIRECTORATE</p>	DES <i>S.M.S.</i>	STANDARD DRAWING	
					DRN <i>L.P. 100/86.</i>	TITLE LANTERN & LAMPS	
					CKD <i>S.M.S.</i>	MINOR ROADS	
					APPD <i>W.A.</i>	INTEGRAL-MERCURY VAPOUR 80-125W	
				ISSUED <i>20.2.86</i>	POST TOP TYPE		
				DRAFTING STANDARD TO A.S. 1100	A3	DRAWING NUMBER. S3-1-4-3	<p>4 AMD T</p>
				ALL DIM IN m.m.	SCALE	SHEET	
4	NOTES A AMENDED	<i>M</i>	FEB 91	R.J.F.			
3	NOTE N° 6 ADDED		6/89	@.			
2	TITLE & DRAWING NUMBER CHANGED		12/87	Q.L.I.			
1	ITEM & STOCK CODES ADDED		01.87	W.S.			
No	AMENDMENT		DATE	INIT			