



3RD ANGLE -DO NOT SCALE - REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

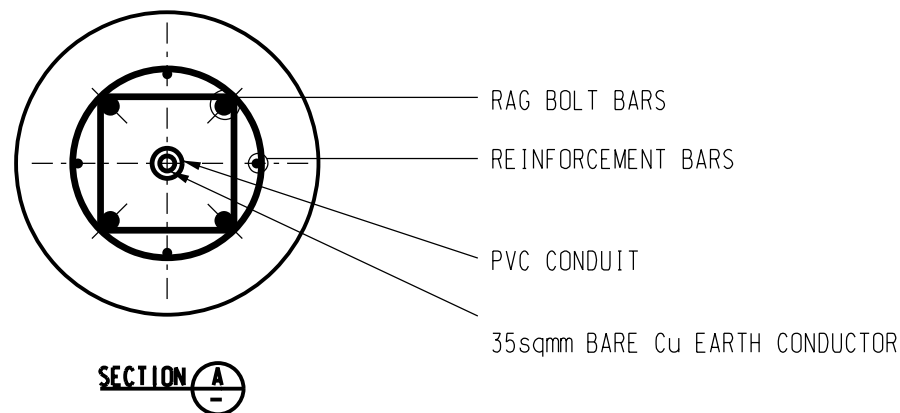

COLUMN DESCRIPTION	RAG BOLT STOCK CODE	FOUNDATION DIMENSIONS		RAG BOLT TYPE
		'A'	'B'	
5.5 METRE POST TOP & 5.5 METRE SINGLE OUTREACH	11809	1100	600	5
12 METRE POST TOP & 9 METRE SINGLE OUTREACH	6668	1200	600	9
12 METRE SINGLE & DOUBLE OUTREACH	11825	1500	600	12
18 METRE POST TOP 3 WAY SPIGOT	11841	2000	900	18

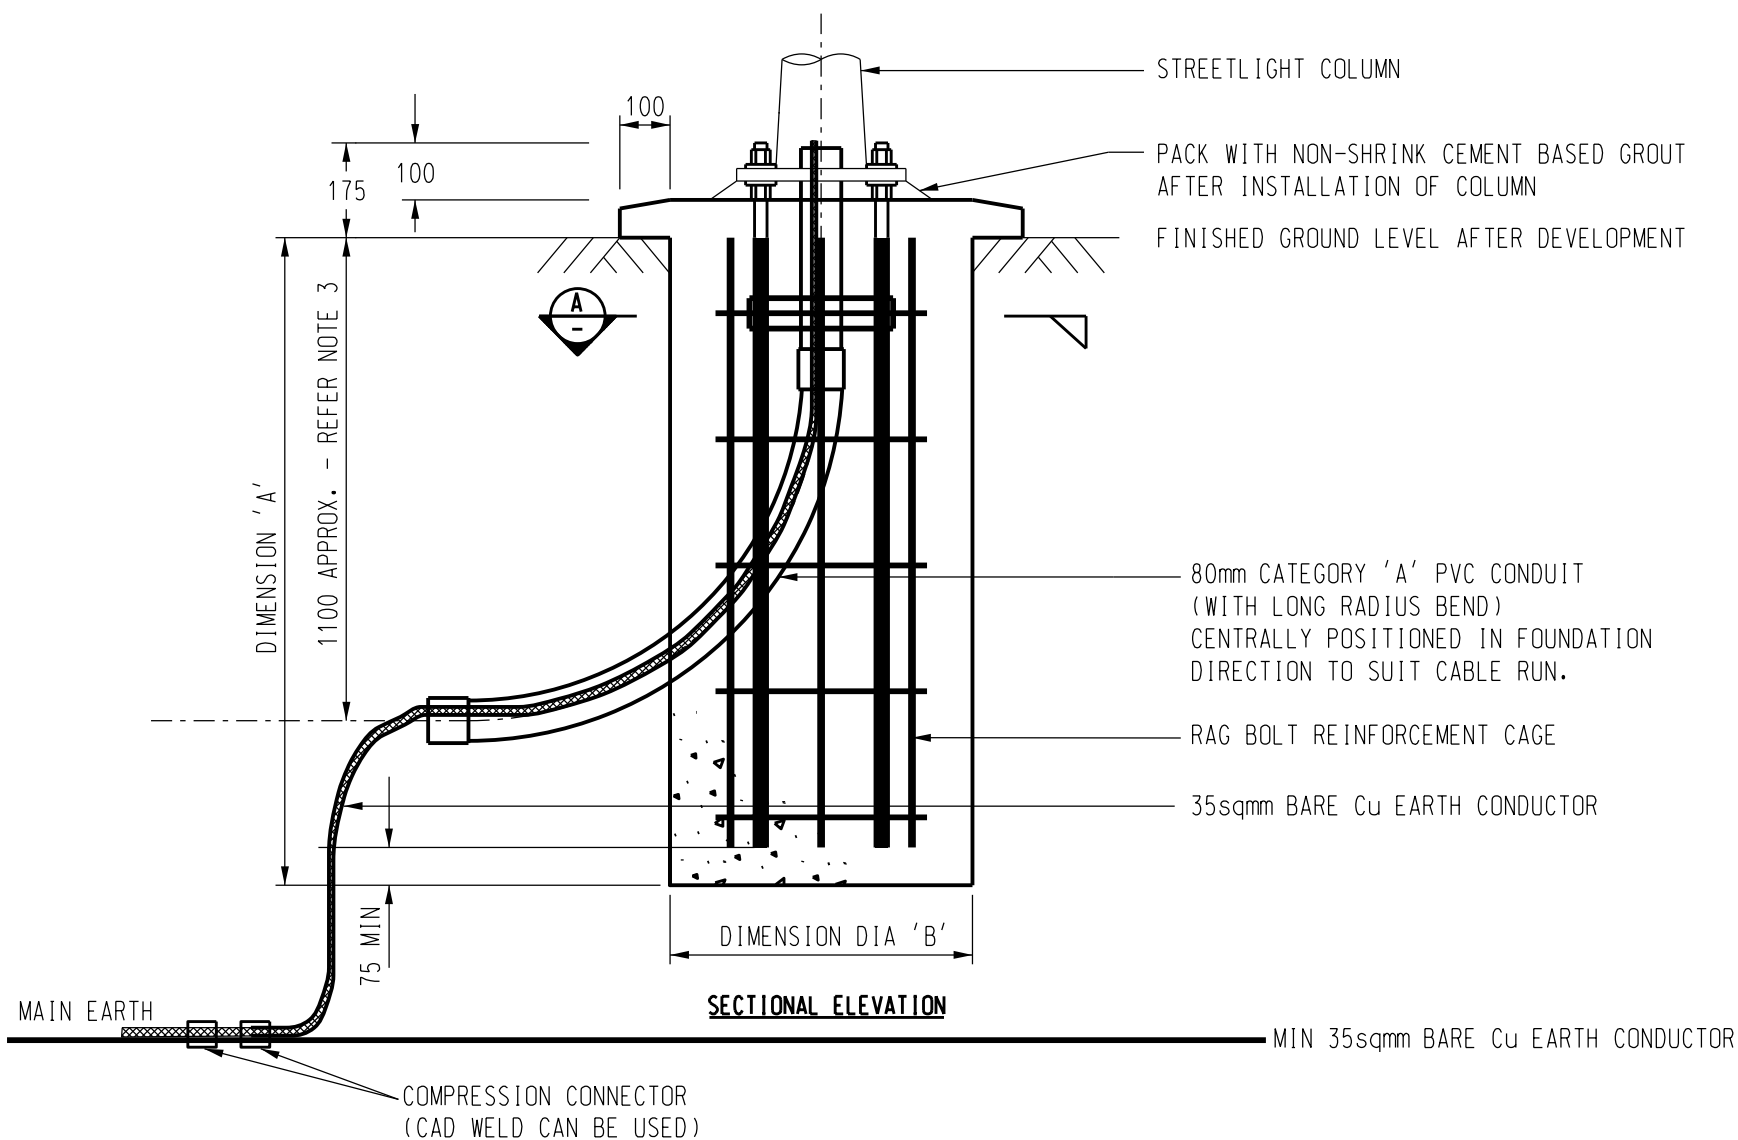

NOTES :

1. ALL REINFORCEMENT, CONCRETE AND CONCRETE MATERIALS SHALL BE IN ACCORDANCE WITH AS3600.
2. MINIMUM COMPRESSIVE DESIGN STRENGTH (f'_c) SHALL BE 20MPa AT 28 DAYS.
3. WHERE CONNECTION TO STREETLIGHT COLUMN IS FROM A CABLE PIT, DEPTH OF CONDUIT FOR CABLE ENTRY TO BE DEPENDENT ON LOCATION AND DEPTH OF CABLE PIT.
4. COVER TO REINFORCEMENT SHALL BE 75mm MINIMUM.

REFERENCE DRAWINGS

- S03-1-2-01 RAG BOLT REFORCEMENT TYPE 5 & TYPE 9
- S03-1-2-02 RAG BOT REINFORCEMENT TYPE 12 & TYPE 18
- S03-1-2-06 RAG BOLT REINFORCEMENT, BAR - DEFORMED

NO	DESCRIPTION	DRN	DATE	CKD	APPD
20	EXTRA EARTH CONNECTOR ADDED	C.C.	AUG'17	I.B.	B.C.
19	FINISHED GROUND LEVEL ADDED	A.T.	APR'13	B.C.	B.C.
18	CHANGE 70sqmm TO 35sqmm	K.I.	SEP 05	C.C.	C.C.
17	ADD 70sqmm Cu EARTH DETAILS	K.I.	APR 05	C.C.	C.C.
16	REDRAWN ON CAD	A.D	05/98	R.I.	F.R.
15	NOTE 3 AMENDED	gmck	12/91	-	NS



DES	-	POWER STANDARD DRAWING		
DRN	A.DAVIS	RAG BOLT REINFORCEMENT TYPE 5, 9, 12, AND 18 FOUNDATION ARRANGEMENT SHEET 1 OF 2		
CKD	R.INNES	A3	DRAWING NUMBER	S03-1-2-03
APPD	F.ROBSON			
SCALE	1:15	DRAFTING STANDARD TO A.S.1100		
ISSUED	MAY'98	CAD PRODUCT - DO NOT AMEND MANUALLY		
ALL DIM. IN mm		AMDT		