


3RD ANGLE -DO NOT SCALE - REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

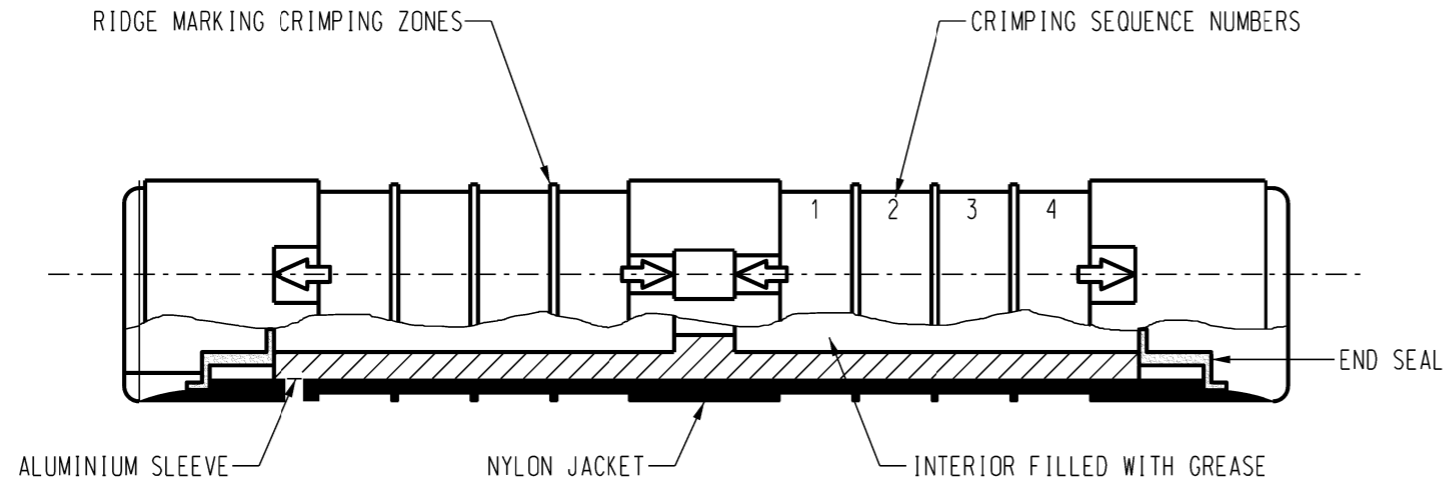

DETAIL OF SLEEVE

95sq.mm SLEEVE SHOWN.

NOTES :

1. CABLE INSULATION TO BE REMOVED TO DIMENSION SHOWN ON LINK AND FULLY INSERTED INTO LINK BEFORE COMPRESSION.
2. JOINTS TO BE MADE WITH INDIVIDUAL CORE JOINTS STAGGERED MIN 150mm.
3. NUMBER E215 ON LINK BODY INDICATE ACROSS FLATS DIMENSIONS FOR THE HEXAGONAL DIES i.e. E215-21.5mm
4. LINK TO HAVE EMBOSSED ON THE INSULATION:
 - STRIPPING LENGTH,
 - COMPRESSION DIE SIZE,
 - NUMBER, LOCATION AND SEQUENCE OF COMPRESSIONS.

ITEM NO	DESCRIPTION	(kN)	HEXAGONAL COMPRESSION DIE ACROSS FLATS (mm)	STOCK CODE	RING COLOUR
1	LINE COMPRESSION FULL TENSION 95SQMM	16.8	21.5	229039	GREY
2	LINE COMPRESSION FULL TENSION 95SQMM	7	21.5	206664	GREY
3	LINE COMPRESSION FULL TENSION 150SQMM	7	21.5	415590	VIOLET

NO	DESCRIPTION	DRN	DATE	CKD	APPD
5	150sqmm VERSION ADDED	A.T.	MAR'12	B.C.	S.C.
4	AMENDED NOTES	J.C.	FEB'08	B.C.	S.C.
3	TABLE AND NOTE 4 AMENDED, NOTE 5 ADDED, DIMENSIONS 'A' AND 'B' REMOVED, REDRAWN ON CAD REVISED AND REDRAWN	R.G.I	NOV'99	G.H.	F.R.
2		A.D	MAY'98	R.I.	F.R.
1		R.T.F	OCT'89	-	G.S.
AMENDMENTS					



DES	A.B.	POWER STANDARD DRAWING		
DRN	A.DAVIS	LV AERIAL BUNDLED CABLE LINK - COMPRESSION		
CKD	R.INNES			
APPD	F.ROBSON			
SCALE	N.T.S.			
ISSUED	MAY'98			
ALL DIM. IN mm	A3	DRAWING NUMBER	S04-1-2-17	
DRAFTING STANDARD TO A.S.1100		CAD PRODUCT - DO NOT AMEND MANUALLY		