




3RD ANGLE -DO NOT SCALE - REPORT ANY ERRORS, OMISSIONS TO DRAFTING OFFICE

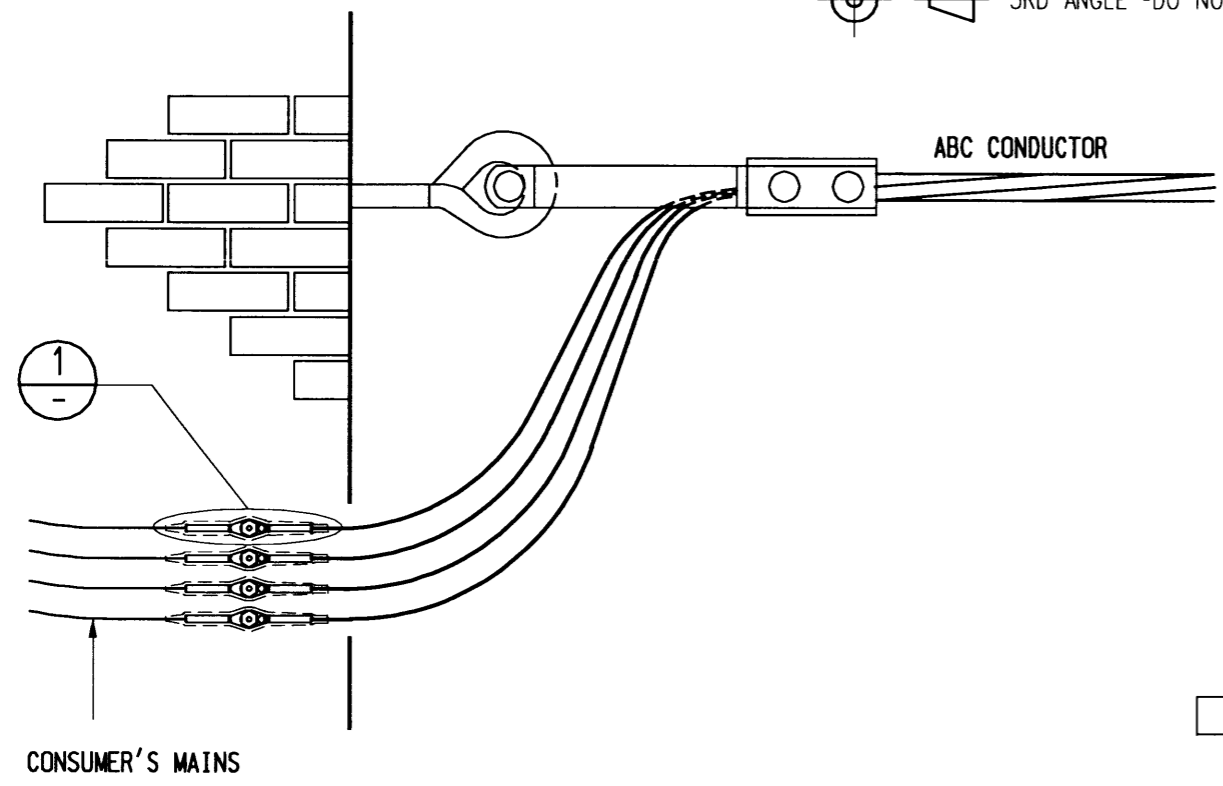


ABC SERVICE - IN LINE CONNECTION
ASSEMBLY LINE - ABC/S1

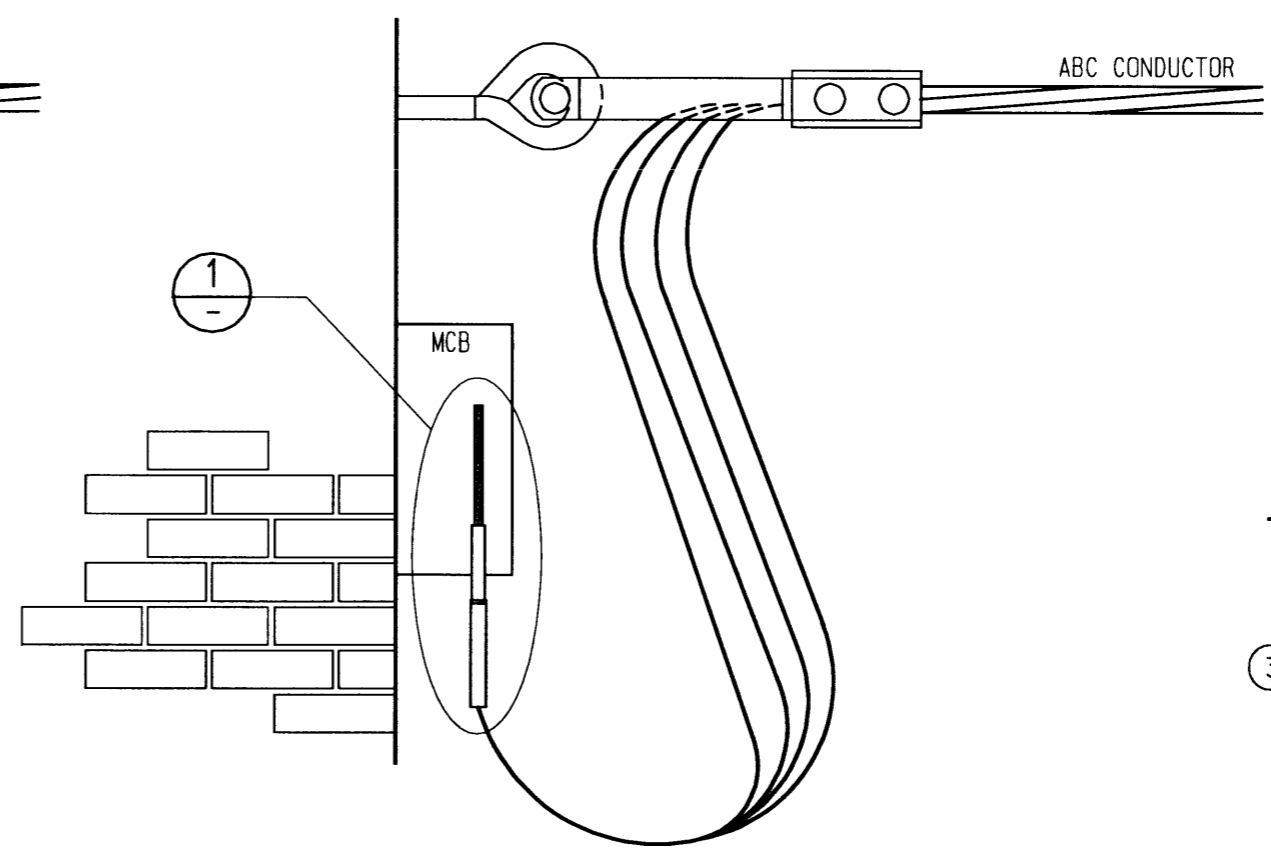

ABC SERVICE - MCB CONNECTION
ASSEMBLY LINE - ABC/S2

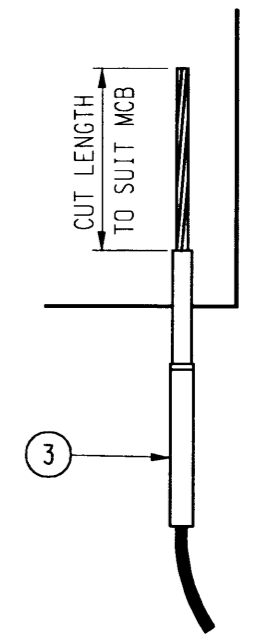

DETAIL 2

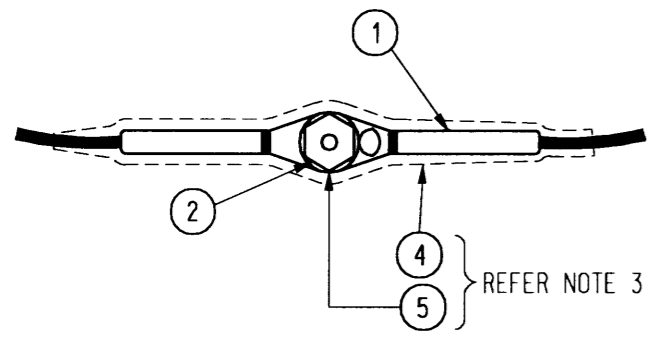



DETAIL 1

NOTES :

1. VINYL MASTIC TAPE TO BE WRAPPED AROUND BOLTED CONNECTION UNDERNEATH HEATSHRINK. CARE IN APPLYING HEAT TO THE CENTRE OF THE JOINT IS REQUIRED TO AVOID SPLITTING OF THE HEATSHRINK TUBE BY THE BOLT.

TAG No	ABC/S1	ABC/S2	DESCRIPTION	STOCK CODE
5	AS REQ	-	TAPE - VINYL MASTIC	157305
4	AS REQ	-	HEATSHRINK-HEAVY DUTY-C/W ADHESIVE COATED	3129
3	-	4	INSULATED COMP. LINK 95sq.mm Al-50sq.mm Cu	250753
2	4	-	M10 BOLT C/W NUT AND WASHER	114009
1	4	-	95sq.mm BI-METAL LUG	5264

1 REDRAWN ON CAD		A.D	MAY'98	R.I.	F.R.	 POWER AND WATER AUTHORITY NORTHERN TERRITORY	DES A.T.	POWER STANDARD DRAWING	
NO	DESCRIPTION	DRN	DATE	CKD	APPD		DRN A.DAVIS	ASSEMBLIES LV - ABC SERVICES - CONSUMER'S END	
AMENDMENTS							APPD F.ROBOSN	SCALE N.T.S.	A3 DRAWING NUMBER S4-2-1-19
							ISSUED MAY'98		
							ALL DIM. IN mm		
									AMDT