


3 x SINGLE PHASE CONSUMERS

NOT FOR NEW CONSTRUCTION

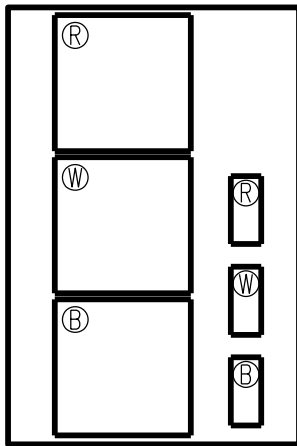


1 x THREE PHASE CONSUMER


NOTES :

1. FOR COMPONENT DRILLING DETAILS SEE FIG. 22 & 23
2. MAIN SWITCH SHALL BE SINGLE PHASE IF THREE PHASE SUPPLY NOT AVAILABLE.
3. PANEL SIZE AND COMPONENT ARRANGEMENT FOR 1 x THREE PHASE CONSUMER IS IDENTICAL TO THAT FOR 3 x SINGLE PHASE CONSUMERS.

PowerWater	1	CHANGED TO SHEET 1 OF 3	C.M.	01.13	B.N.	DES DRN A.SCHMID CKD APPD SCALE 1:10 ISSUED	FIG.4 - MULTIMETERING PANELS FOR 3 METERS SHEET 1 OF 3	A4	DRAWING NUMBER S11-2-7-4_1	AMDT
	0	SHEET 2 ADDED	J.C.	09.09	A.T.					
	A	ISSUED FOR COMMENT	A.S.	15.10		ALL DIM. IN mm				
AMENDMENTS						DRAFTING STANDARD TO A.S.1100		CAD PRODUCT — DO NOT AMEND MANUALLY		

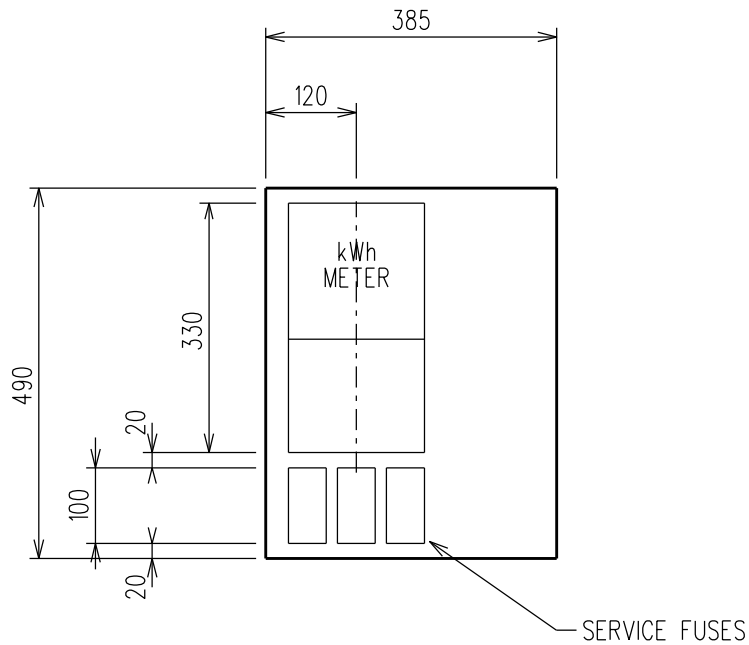



NOT FOR NEW CONSTRUCTION

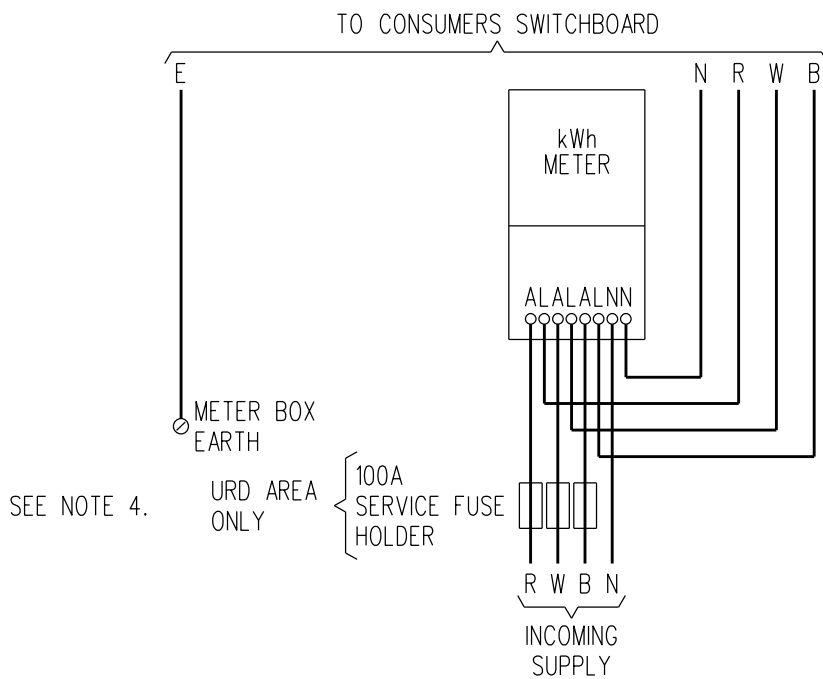

NOTES :

1. FOR METER DRILLING DETAILS SEE FIG 22 SHEET 3
2. TOP OF SERVICE FUSE (WHEN FITTED) SHALL BE LIVE.
3. METER BOX EARTH SHALL BE CONNECTED TO INSTALLATION MAIN EARTH.
4. UNDERGROUND RESIDENTIAL DISTRIBUTION.
5. FOR 3x1PHASE CONSUMERS, REFER TO FIG 1 SHEET 2 FOR WIRING DETAILS AND FIG 37 FOR PANEL ARRANGEMENT

					DES N.COAD	FIG.4A 1 x 3 PHASE CONSUMER UP TO 100A SHEET 2 OF 3
					DRN R.WILLIAMS	
					CKD N.COAD	
					APPD B.KISON	
					SCALE 1 : 10	
	2	CHANGED TO SHEET 2 OF 3	C.M.	01.13	B.N.	A4 DRAWING NUMBER S11-2-7-4_2
	1	SHEET 2 ADDED	J.C.	09.09	A.T.	
	0	APPROVED FOR INSTALLATION	R.W.	4.9.09	N.C.	
	A	ISSUED FOR COMMENT	R.W.	4.9.09	N.C.	
	NO	DESCRIPTION	DRN	DATE	APPD	ISSUED 4.9.09
AMENDMENTS						ALL DIM. IN mm
DRAFTING STANDARD TO A.S.1100						CAD PRODUCT — DO NOT AMEND MANUALLY

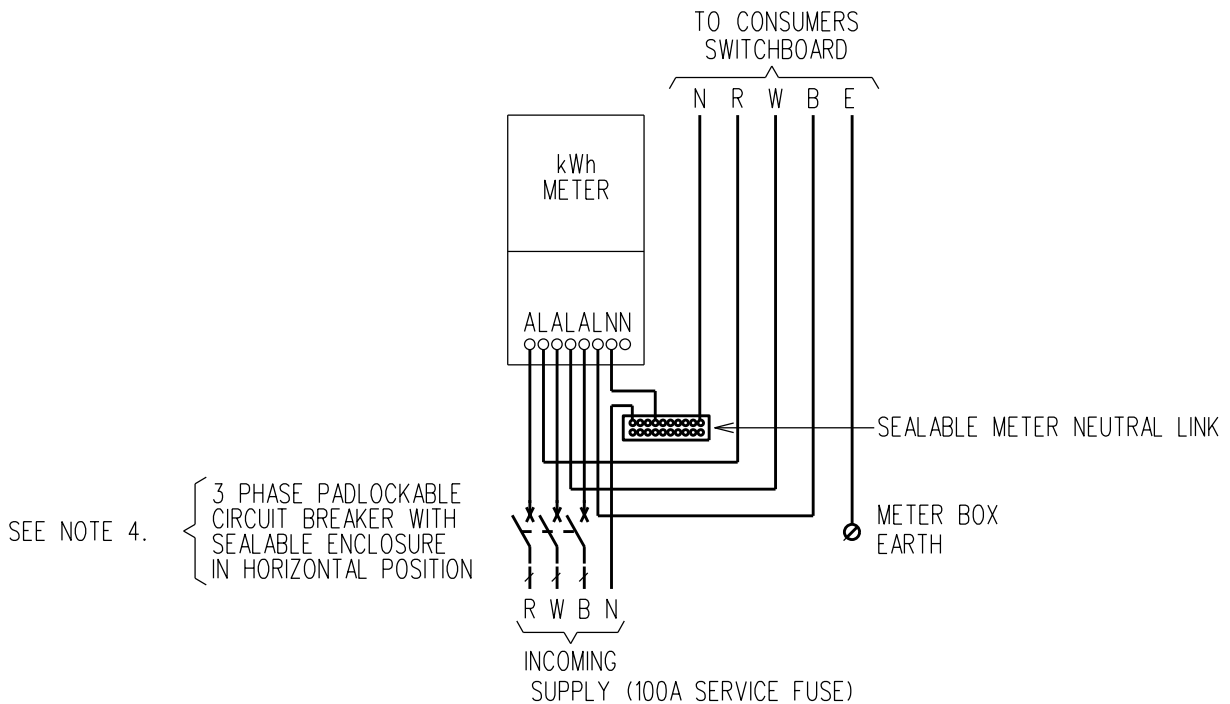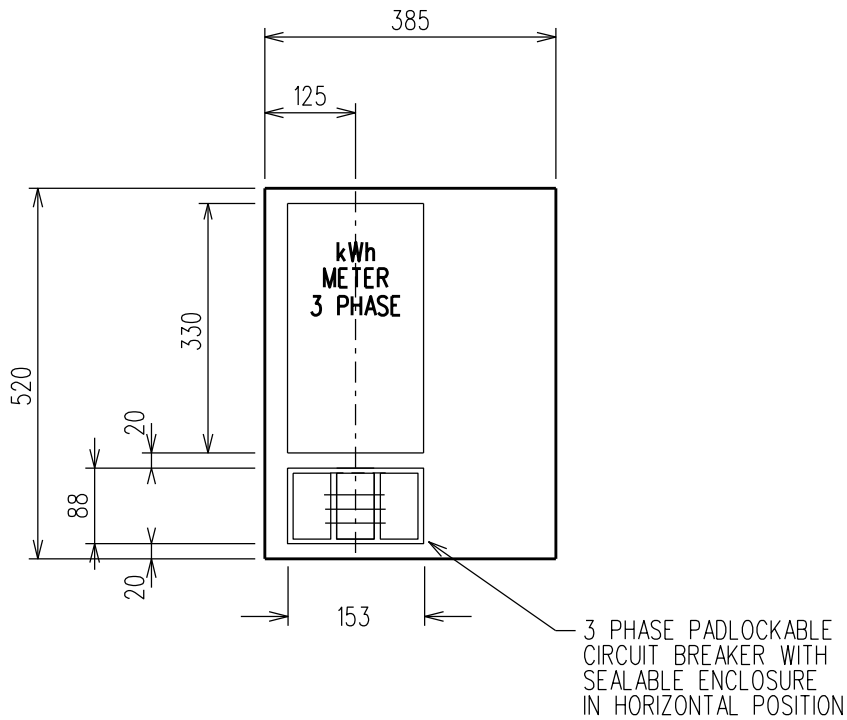

NOTES :

1. FOR METER DRILLING DETAILS SEE METERING STD DWG S11-2-7-23 SHEET 3
2. THREE PHASE CIRCUIT BREAKER SHALL BE PADLOCKABLE IN THE OFF POSITION AND INSTALLED IN THE HORIZONTAL POSITION
3. METER BOX EARTH SHALL BE CONNECTED TO INSTALLATION MAIN EARTH.
4. CIRCUIT BREAKERS SHALL BE THREE PHASE, 63A, 10kA, C CURVE TYPE CIRCUIT BREAKER
5. FOR METER PANELS FITTED WITH PADLOCKABLE CIRCUIT BREAKERS A 100A FUSE SHALL BE INSTALLED IN THE URD PILLER OR OVERHEAD SERVICE FUSE HOLDER.

PowerWater					DES B.NARAYANA	FIG.4B 1 x 3 PHASE CONSUMER UP TO 100A SHEET 3 OF 3
					DRN C.MCLAREN	
					CKD B.NARAYANA	
					APPD B.NARAYANA	
					SCALE 1 : 10	
	1	NOTE 5 ADDED	C.C.	01.14	B.C.	ISSUED 01.2013
	0	APPROVED FOR INSTALLATION	C.M.	01.13	B.N.	A4 DRAWING NUMBER S11-2-7-4_3
	A	ISSUED FOR COMMENT	C.M.	01.13	B.N.	
	NO	DESCRIPTION	DRN	DATE	APPD	ALL DIM. IN mm
AMENDMENTS						DRAFTING STANDARD TO A.S.1100
						CAD PRODUCT — DO NOT AMEND MANUALLY