

FIG. 36B

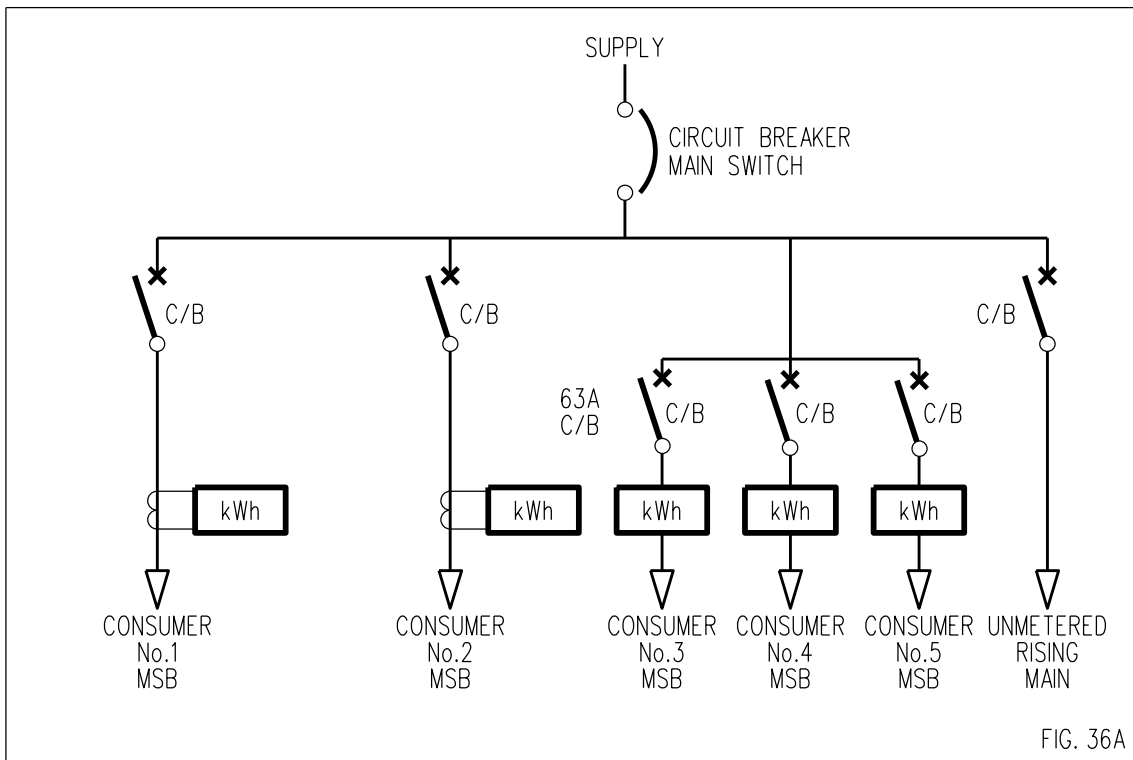


FIG. 36A

- NOTES :**
1. CONSUMER CIRCUIT BREAKER SHOULD BE PADLOCKABLE IN THE 'OFF' POSITION, EXCEPT FOR LIFT & FIRE PROTECTION FEEDER WHICH SHOULD BE PADLOCKABLE IN THE 'ON' POSITION.
 2. THE EXAMPLES SHOWN ARE ILLUSTRATIVE ONLY. OTHER ARRANGEMENTS MAY BE APPROVED.

PowerWater	4	UPDATED NOTES	CWM	29.6.12	BN	DES	FIG. 36 - MULTIMETERING INSTALLATIONS			
	3	C/B'S REPLACE FUSES	CWM	6.6.12	BN	DRN				A.SCHMID
	B	NOTE 3. ADDED	A.S.	4.2.03		CKD				
	A	ISSUED FOR COMMENT	A.S.	29.1.02		APPD				
	NO	DESCRIPTION	DRN	DATE	APPD	SCALE				NTS
AMENDMENTS						ISSUED	A4	DRAWING NUMBER	S11-2-7-37	
						ALL DIM. IN mm				
						DRAFTING STANDARD TO A.S.1100		CAD PRODUCT — DO NOT AMEND MANUALLY		